


COUNTY OF SIMCOE ORILLIA AFFORDABLE HOUSING 2 BORLAND STREET

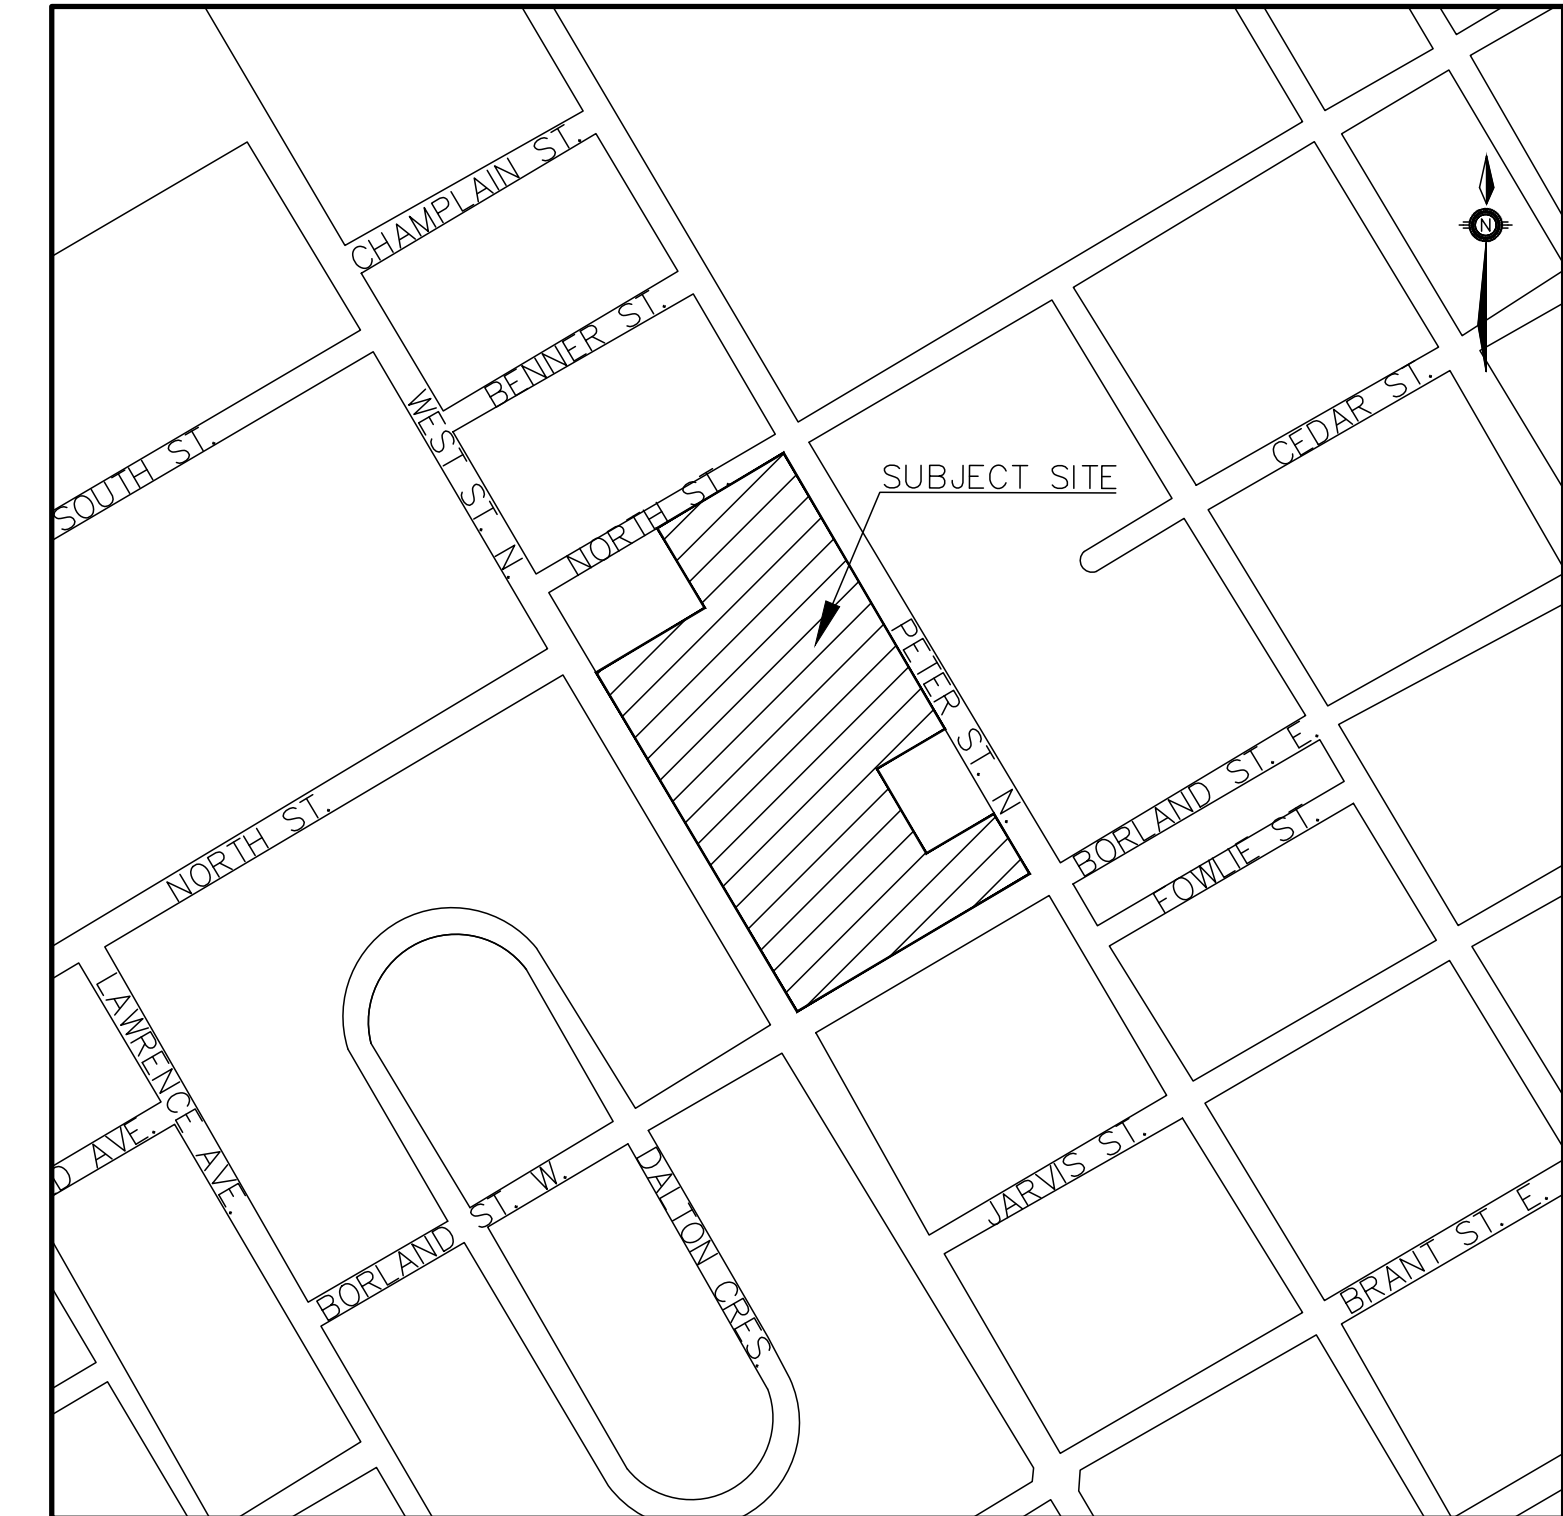

Drawing List

- ND-1 NOTES AND DETAILS (1 OF 4)
- ND-2 NOTES AND DETAILS (2 OF 4)
- ND-3 NOTES AND DETAILS (3 OF 4)
- ND-4 NOTES AND DETAILS (4 OF 4)
- SG-1 SITE GRADING PLAN (1 OF 3)
- SG-2 SITE GRADING PLAN (2 OF 3)
- SG-3 SITE GRADING PLAN (3 OF 3)
- SS-1 SITE SERVICING PLAN (1 OF 3)
- SS-2 SITE SERVICING PLAN (2 OF 3)
- SS-3 SITE SERVICING PLAN (3 OF 3)
- STM-1 PRE-DEVELOPMENT STORM CATCHMENT PLAN
- STM-2 POST-DEVELOPMENT STORM CATCHMENT PLAN
- STM-3 STORM DRAINAGE AREA PLAN
- PND-1 STORMWATER MANAGEMENT POND DETAILS
- EPR-1 ENVIRONMENTAL PROTECTION AND REMOVALS PLAN

CITY OF ORILLIA
50 ANDREW STREET SOUTH, SUITE 300
ORILLIA, ON, L3V 7T5

COUNTY OF SIMCOE
1110 HIGHWAY 26
MIDHURST, ON, L0L 1X0



PEARSON
ENGINEERING LTD.
PEARSONENG.COM PH. 705.719.4785

ALTERNATE STANDARD HEIGHTS	ALTERNATE DIMENSION
A	1980
B	1830
C	1520
D	1380

NOTES:
 1 Outlet hole size 525mm diameter maximum, location as required.
 2 200mm diameter knockout to accommodate subdrain. Knockout shall be 60mm deep.
 3 Centre reinforcing in base slab and walls ±20mm.
 4 Granular backfill shall be placed to a minimum thickness of 300mm all around the catch basin.
 5 Frame, grate, and adjustment units shall be installed according to OPSD 704.010.
 6 Pipe support shall be according to OPSD 708.020.
 7 All dimensions are nominal.
 8 All dimensions are in millimetres unless otherwise shown.

ONTARIO PROVINCIAL STANDARD DRAWING Nov 2019 Rev 4
PRECAST CONCRETE CATCH BASIN
 600x600mm
 OPSD 705.010

NOTES:
 1 The sump is measured from the lowest invert.
 2 Granular backfill shall be placed to a minimum thickness of 300mm all around the maintenance hole.
 3 Precast concrete components shall be according to OPSD 701.030, 701.031, or 701.032.
 4 Structure exceeding 5.0m in depth shall include safety platform according to OPSD 404.020.
 5 Pipe support according to OPSD 708.020.
 6 For benching and pipe opening details, see OPSD 701.021.
 7 For adjustment unit and frame installation, see OPSD 704.010.
 8 All dimensions are nominal.
 9 All dimensions are in millimetres unless otherwise shown.

ONTARIO PROVINCIAL STANDARD DRAWING Nov 2014 Rev 5
PRECAST CONCRETE MAINTENANCE HOLE
 1200mm DIAMETER
 OPSD 701.010

SOILS WITH TYPICAL BEARING STRENGTH OF 100 TO 199 kPa				
PIPE DIA	a	b	c	d
100	150	250	200	200
150	250	400	250	300
200	400	550	300	400
250	500	650	400	500
300	650	800	450	650
350	700	900	550	700
400	900	1050	600	850

SOILS WITH TYPICAL BEARING STRENGTH OF 200 TO 299 kPa				
PIPE DIA	a	b	c	d
100	150	200	150	150
150	250	250	200	200
200	400	350	250	300
250	500	450	300	350
300	650	500	350	400
350	700	600	400	500
400	900	750	400	600

SOILS WITH TYPICAL BEARING STRENGTH OF 300 kPa AND OVER				
PIPE DIA	a	b	c	d
100	150	150	150	150
150	250	200	200	200
200	400	300	250	250
250	500	400	250	300
300	650	450	300	300
350	700	550	350	350
400	900	650	350	450

NOTES:
 A Concrete shall be placed to within 50mm of the face of the bell.
 B Bond breaker shall be used between concrete and fittings.
 C The above thrust block dimensions meet or exceed the MECP Watermain Design Criteria for Future Alterations Authorized Under a Drinking Water Works Permit.
 D The assumptions made for the above calculations are:
 - Maximum operating pressure of 690 kPa,
 - Maximum surge pressure with a flow velocity change of 0.5 m/s of 790 kPa for Class 52 DI pipe and 240 kPa for PVC pipe.
 E The tables apply to both ductile iron and PVC pipe. When one length exceeded the other, the longer length was used.
 F All dimensions are in millimetres unless otherwise shown.

ONTARIO PROVINCIAL STANDARD DRAWING Nov 2018 Rev 3
CONCRETE THRUST BLOCKS FOR TEES, PLUGS, AND HORIZONTAL BENDS
 OPSD 1103.010

NOTES:
 1 Where concrete bedding is used for the main sewer, the pipe subdrain shall be placed 150mm above the top of such bedding.
 2 Subdrain pipe shall be cored into maintenance hole.
 3 Maintenance hole benching shall accommodate pipe subdrain, as required.
 4 All dimensions are in metres unless otherwise shown.

ONTARIO PROVINCIAL STANDARD DRAWING Nov 2018 Rev 4
PERFORATED PIPE SUBDRAIN IN GRANULAR TRENCH MAIN STORM SEWER CONNECTION TO DRAINAGE STRUCTURE
 OPSD 809.010

Maintenance Hole Diameter	MAXIMUM SIZE HOLE IN THE WALL IN PRECAST RISER SECTIONS			
	No. 1-4	No. 5 and 6	No. 8	No. 7
1200	700	860	780	860
1500	960	1220	960	1170
1800	1220	1485	1220	1485
2400	1485	2020	1760	1485
3000	1930	2450	2300	2450
3600	2470	3085	2730	3085

NOTES:
 1 Slopes shall be maintained from the outlet hole opening for top of benching.
 2 Concrete for benching shall be 30MPa.
 3 When benching is hand-finished, it shall be given wood float finish, channel shall be given steel trowel finish.
 4 Benching slope and height shall be as specified.
 5 When specified, maintenance holes that are 1200mm in diameter with a uniform channel for 200 or 250mm pipe may be pre-benching at the manufacturer with standardized benching slope and channel orientation.
 6 All dimensions are nominal.
 7 All dimensions are in millimetres unless otherwise shown.

ONTARIO PROVINCIAL STANDARD DRAWING Nov 2014 Rev 4
MAINTENANCE HOLE BENCHING AND PIPE OPENING ALTERNATIVES
 OPSD 701.021

Grate Type	Opening Dimensions		
	a	b	c
2H:IV	1341	66	1473
3H:IV	1265	104	1473
4H:IV	1237	118	1473
8H:IV	1216	65	1346
8H:IV	1210	68	1346
10H:IV	1206	70	1346
HOR	1200	73	1346

NOTES:
 1 The sump is measured from the lowest invert. Benchings as shown in Benching Detail.
 2 Top horizontal 10M rebar 300mm. Laps shall be placed at corners. Lap horizontal wires 300mm or weld. Welds to develop 75% of yield strength of wire. Laps or welds shall be placed at corners.
 3 End rebar or WWR in base 75mm from outside face of wall.
 4 Where inlet is placed across ditch and is accessible to vehicular traffic, grading slope shall be 8H:IV or flatter.
 5 Granular backfill shall be placed a minimum thickness of 300mm all around the ditch inlet maintenance hole.
 6 Concrete for benching shall be 30MPa.
 7 Benchings slope and height shall be as specified.
 8 Grating shall be according to OPSD 403.010.
 9 Steps shall be according to OPSD 405.010 or 405.020.
 10 Maximum pipe size: straight through-1200mm dia, right angle pipes - 700mm diameter.
 11 Pipe support shall be according to OPSD 708.020.
 12 Centre reinforcing in walls ±35mm. All other reinforcing shall have a minimum cover of 25mm.
 13 All dimensions are nominal.
 14 All dimensions are in millimetres unless otherwise shown.

ONTARIO PROVINCIAL STANDARD DRAWING Nov 2014 Rev 3
PRECAST CONCRETE DITCH INLET MAINTENANCE HOLE - TYPE B
 1200 x 1200mm
 OPSD 702.050

NOTES:
 1 Pipe shall be supported with concrete or unshrinkable fill to the first pipe joint.
 2 All dimensions are in millimetres unless otherwise shown.

ONTARIO PROVINCIAL STANDARD DRAWING Nov 2016 Rev 4
FLEXIBLE, WATERTIGHT CONNECTOR RIGID AND FLEXIBLE PIPE
 OPSD 708.020

NOTES:
 1 If first step is in an adjustment unit, the adjustment unit shall be of the type manufactured with a step in place.
 2 Centre reinforcing in adjustment unit ±10mm.
 3 Round and square adjustment units are available in sizes of 50, 75, 100, 150, and 300mm.
 4 Adjustment units shall not extend beyond the outside edge of the structure.
 5 All dimensions are in millimetres unless otherwise shown.

ONTARIO PROVINCIAL STANDARD DRAWING Nov 2014 Rev 3
PRECAST CONCRETE ADJUSTMENT UNITS FOR MAINTENANCE HOLES, CATCH BASINS, AND VALVE CHAMBERS
 OPSD 704.010

NOTES:
 A Covers shall be Type A or Type B, as specified.
 B All dimensions are in millimetres unless otherwise shown.

ONTARIO PROVINCIAL STANDARD DRAWING Nov 2018 Rev 4
CAST IRON, SQUARE FRAME WITH CIRCULAR CLOSED OR OPEN COVER FOR MAINTENANCE HOLES
 OPSD 401.010

NOTES:
 1 The company undertaking welded fabrication shall be certified according to CSA W47.1. All welding shall be according to CSA W59.
 2 All aluminium components shall be 6000 series structural aluminium.
 3 All dimensions are in millimetres unless otherwise shown.

ONTARIO PROVINCIAL STANDARD DRAWING Nov 2018 Rev 4
MAINTENANCE HOLE STEPS HOLLOW
 OPSD 405.010

Pipe Diameter	CLEARANCE TABLE	
	mm	mm
900 or less	300	300
Over 900	500	500

NOTES:
 1 Height of fill is measured from the finished surface to top of pipe.
 2 The pipe bed shall be compacted and shaped to receive the bottom of the pipe.
 3 Pipe culvert frost treatment shall be according to OPSD 803.030 and 803.031.
 4 Condition of excavation is symmetrical about centreline of pipe.
 5 Granular material placed in the haunch area shall be compacted prior to placing and compacting the remainder of the embedment material.
 6 Soil types as defined in the Occupational Health and Safety Act and Regulations for Construction Projects.
 7 All dimensions are in metres unless otherwise shown.

ONTARIO PROVINCIAL STANDARD DRAWING Nov 2014 Rev 3
FLEXIBLE PIPE EMBEDMENT AND BACKFILL EARTH EXCAVATION
 OPSD 802.010

NO.	REVISION	DATE	BY
1.	REVISED AS PER CITY ORILLIA COMMENTS	01/26/21	AA


BENCHMARK

COUNTY OF SIMCOE
 AFFORDABLE HOUSING
 ORILLIA, 2 BORLAND STREET EAST


NOTES AND DETAILS 2 OF 4

PEARSON ENGINEERING LTD.
 PEARSONENG.COM PH. 705.719.4785


DESIGNED BY	AA	HORIZ SCALE	PROJECT #	20002	
DRAWN BY	AA	VERT SCALE	DRAWING #	ND-2	
CHECKED BY	MWD	DATE	NOVEMBER 2020	REVISION #	1

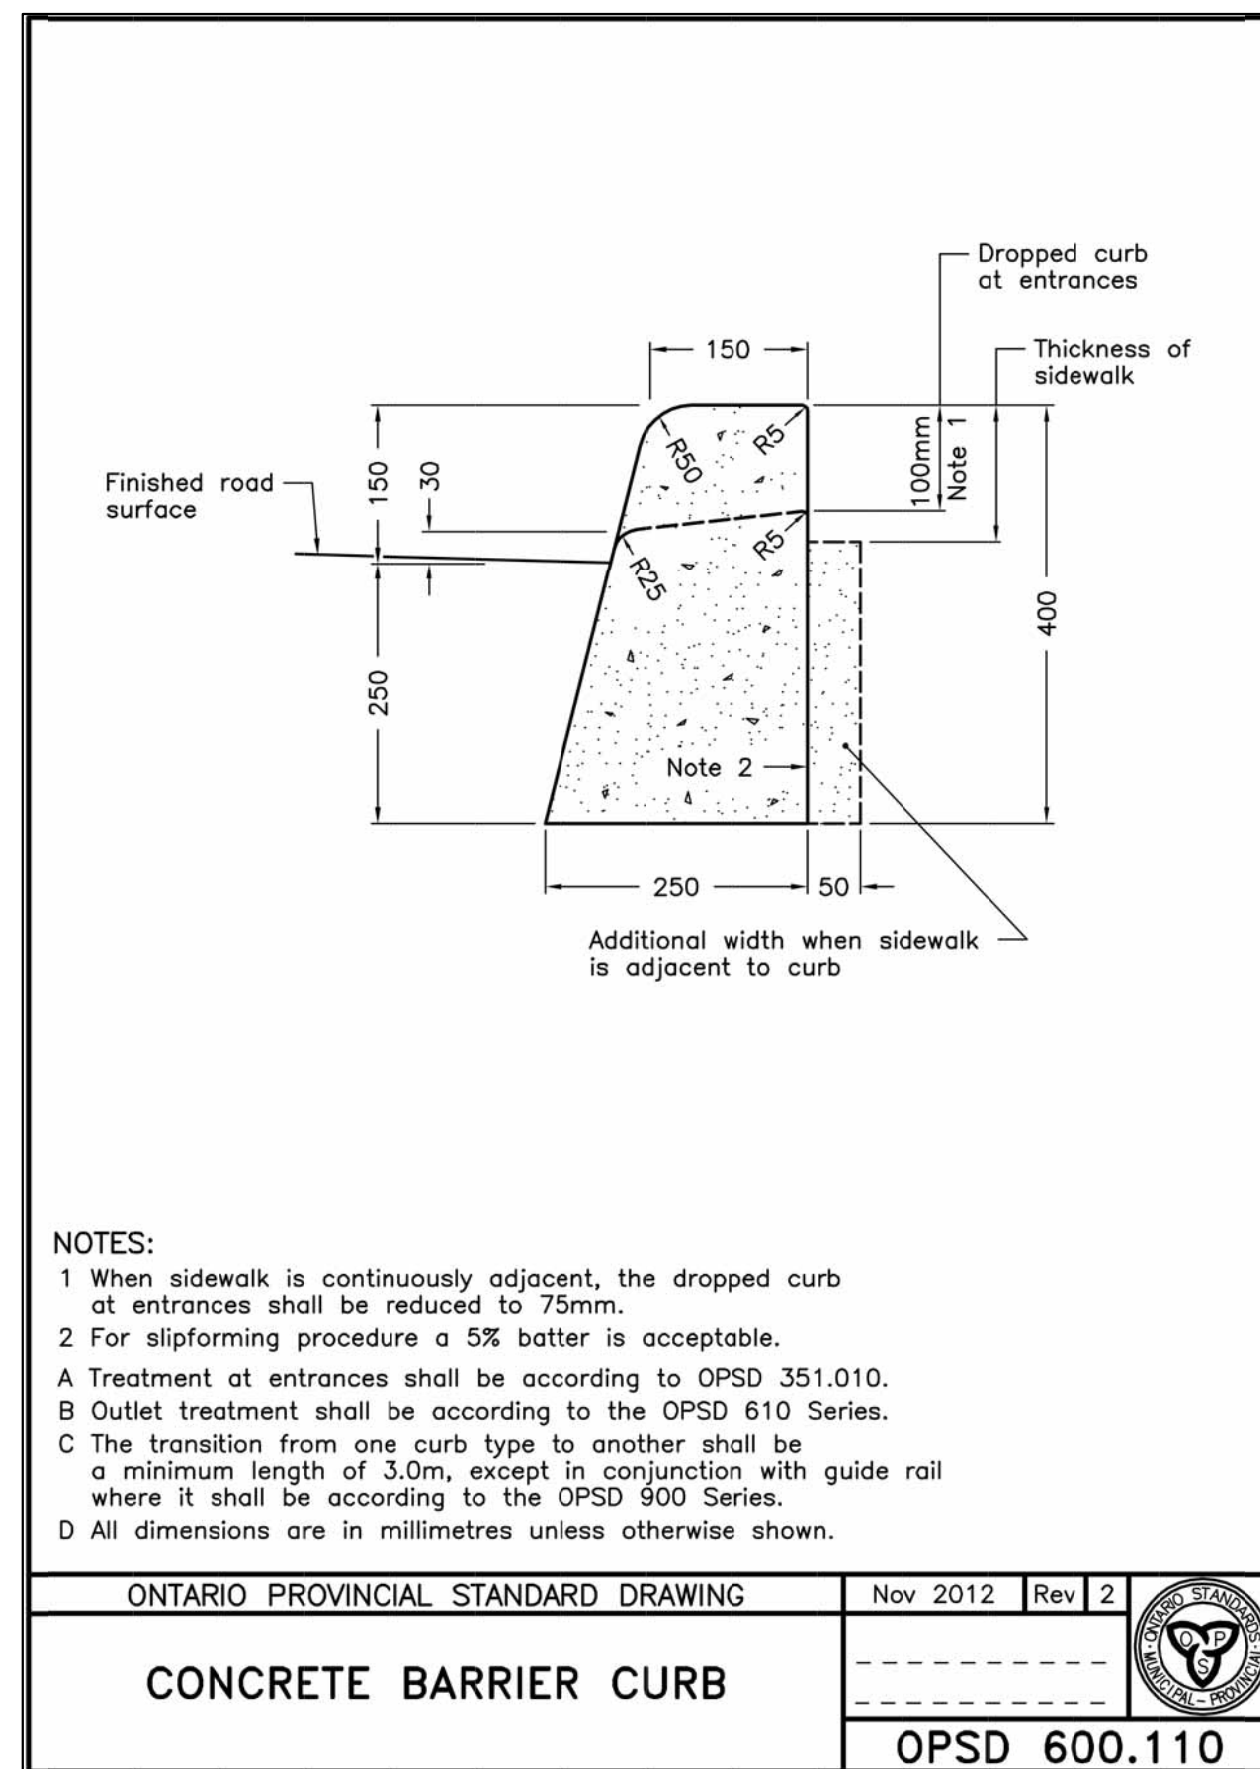


ONTARIO PROVINCIAL STANDARD DRAWING	Nov 2012	Rev 2	
CONCRETE BARRIER CURB			
			OPSD 600.110

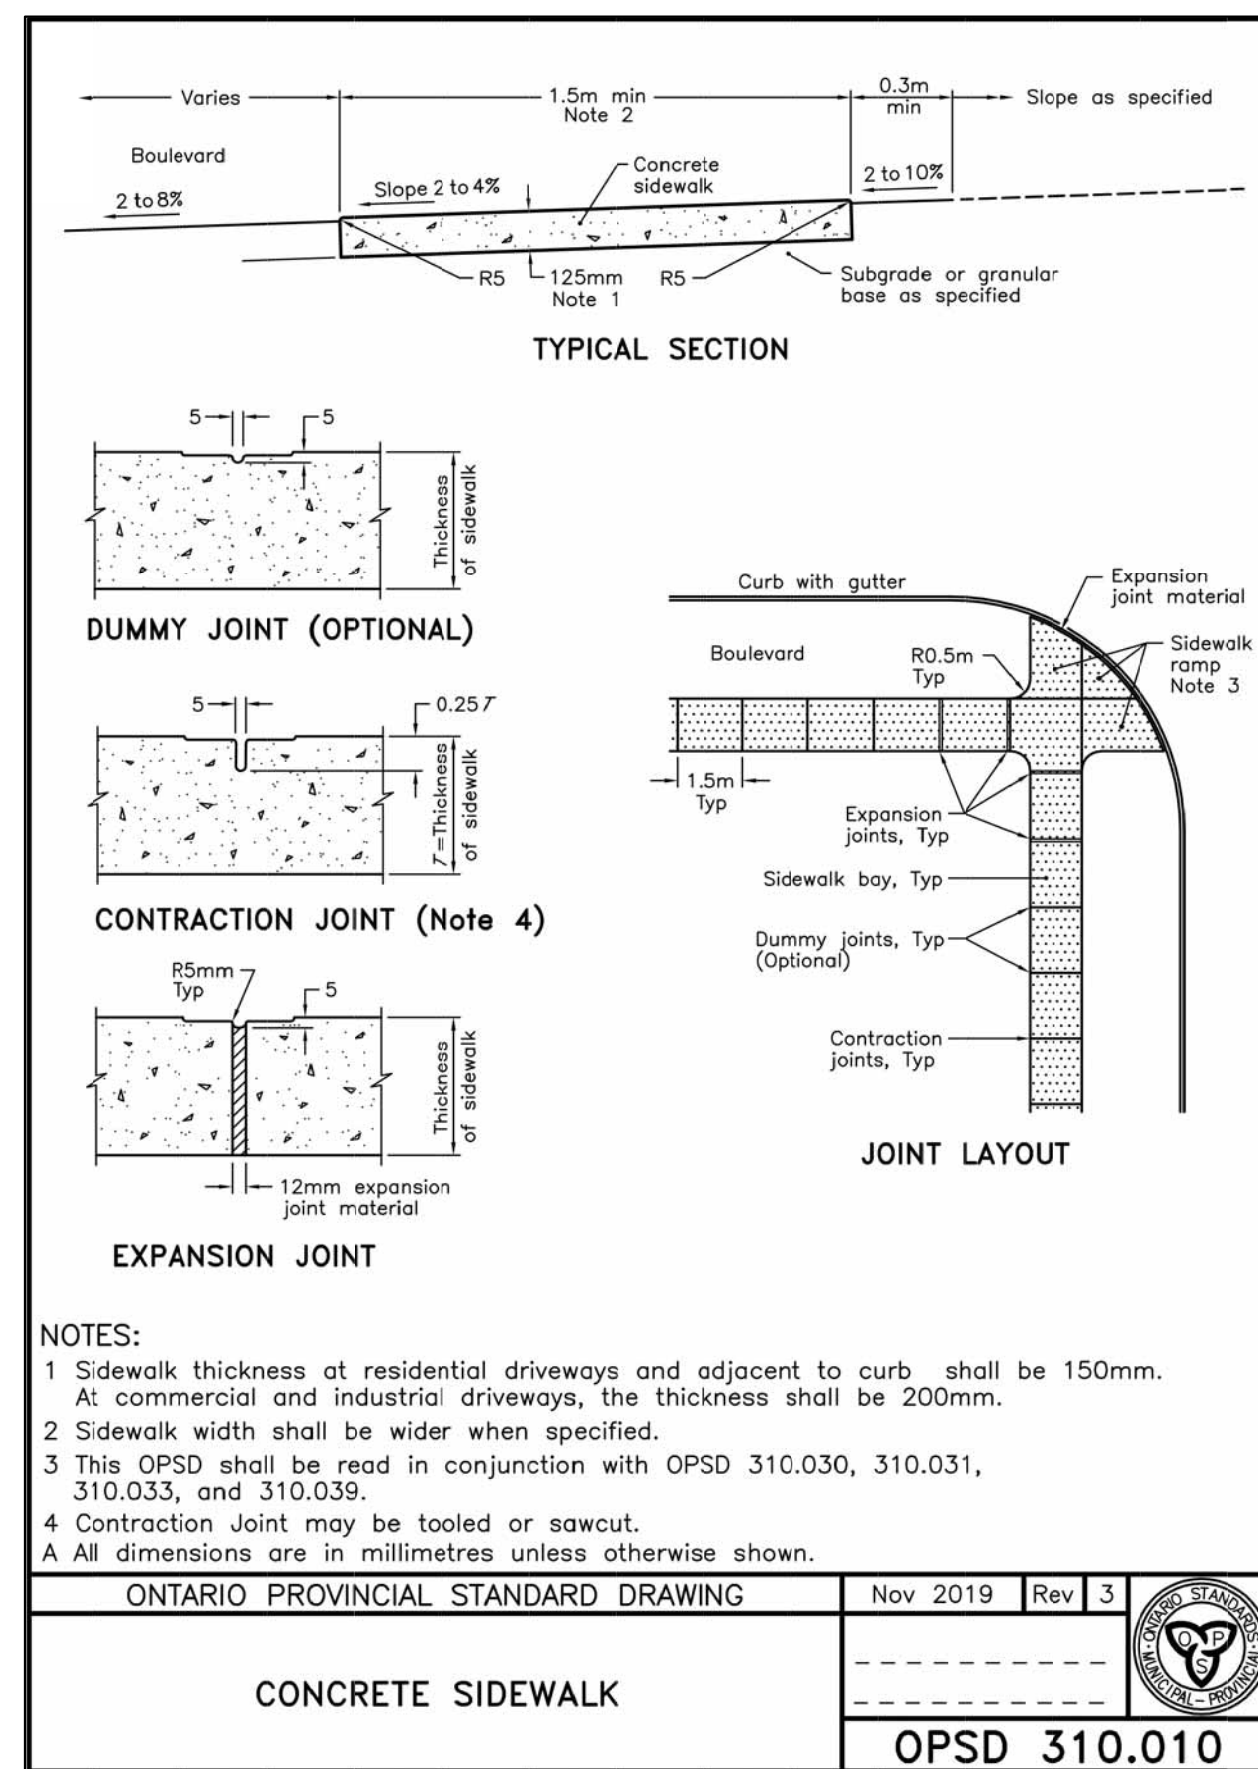


ONTARIO PROVINCIAL STANDARD DRAWING	Nov 2019	Rev 3	
CONCRETE SIDEWALK			
			OPSD 310.010

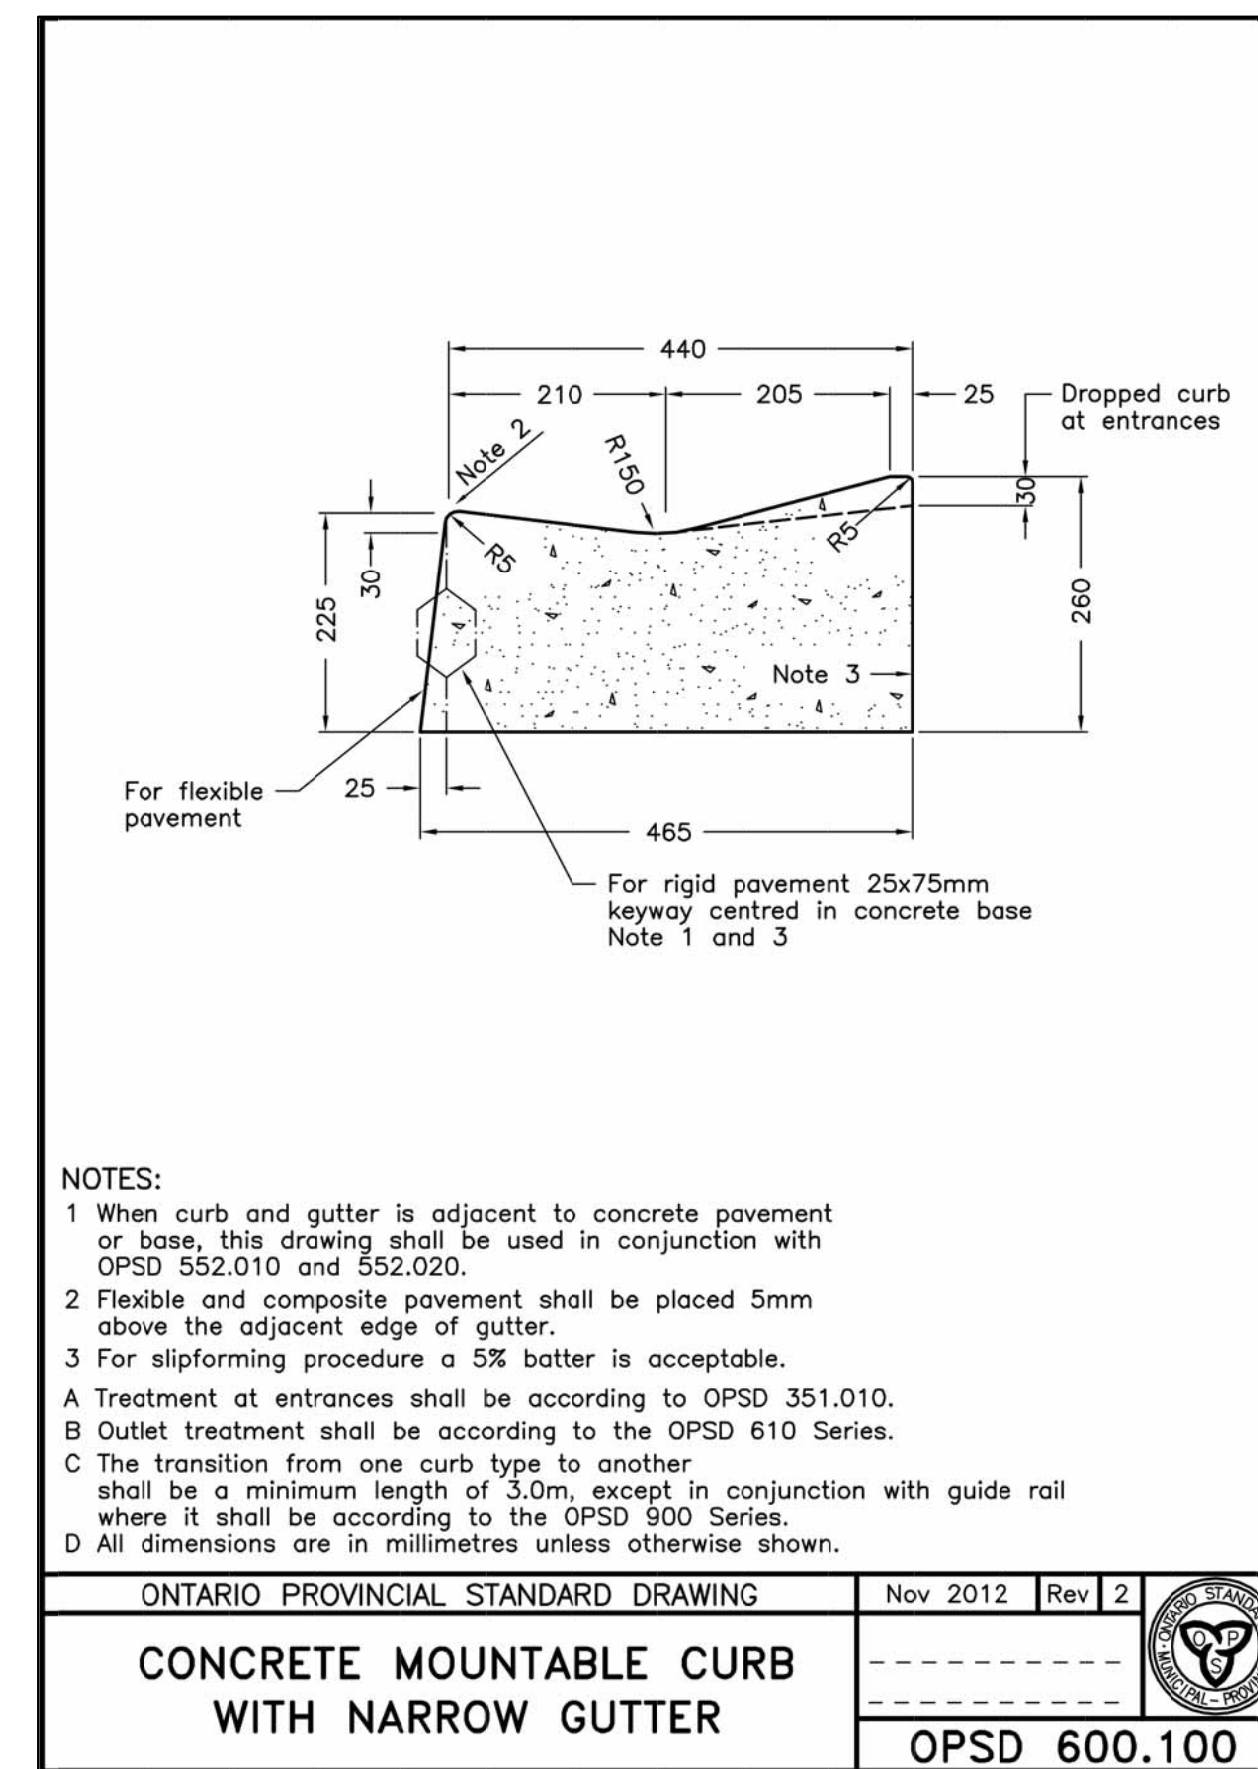


ONTARIO PROVINCIAL STANDARD DRAWING	Nov 2012	Rev 2	
CONCRETE MOUNTABLE CURB WITH NARROW GUTTER			
			OPSD 600.100

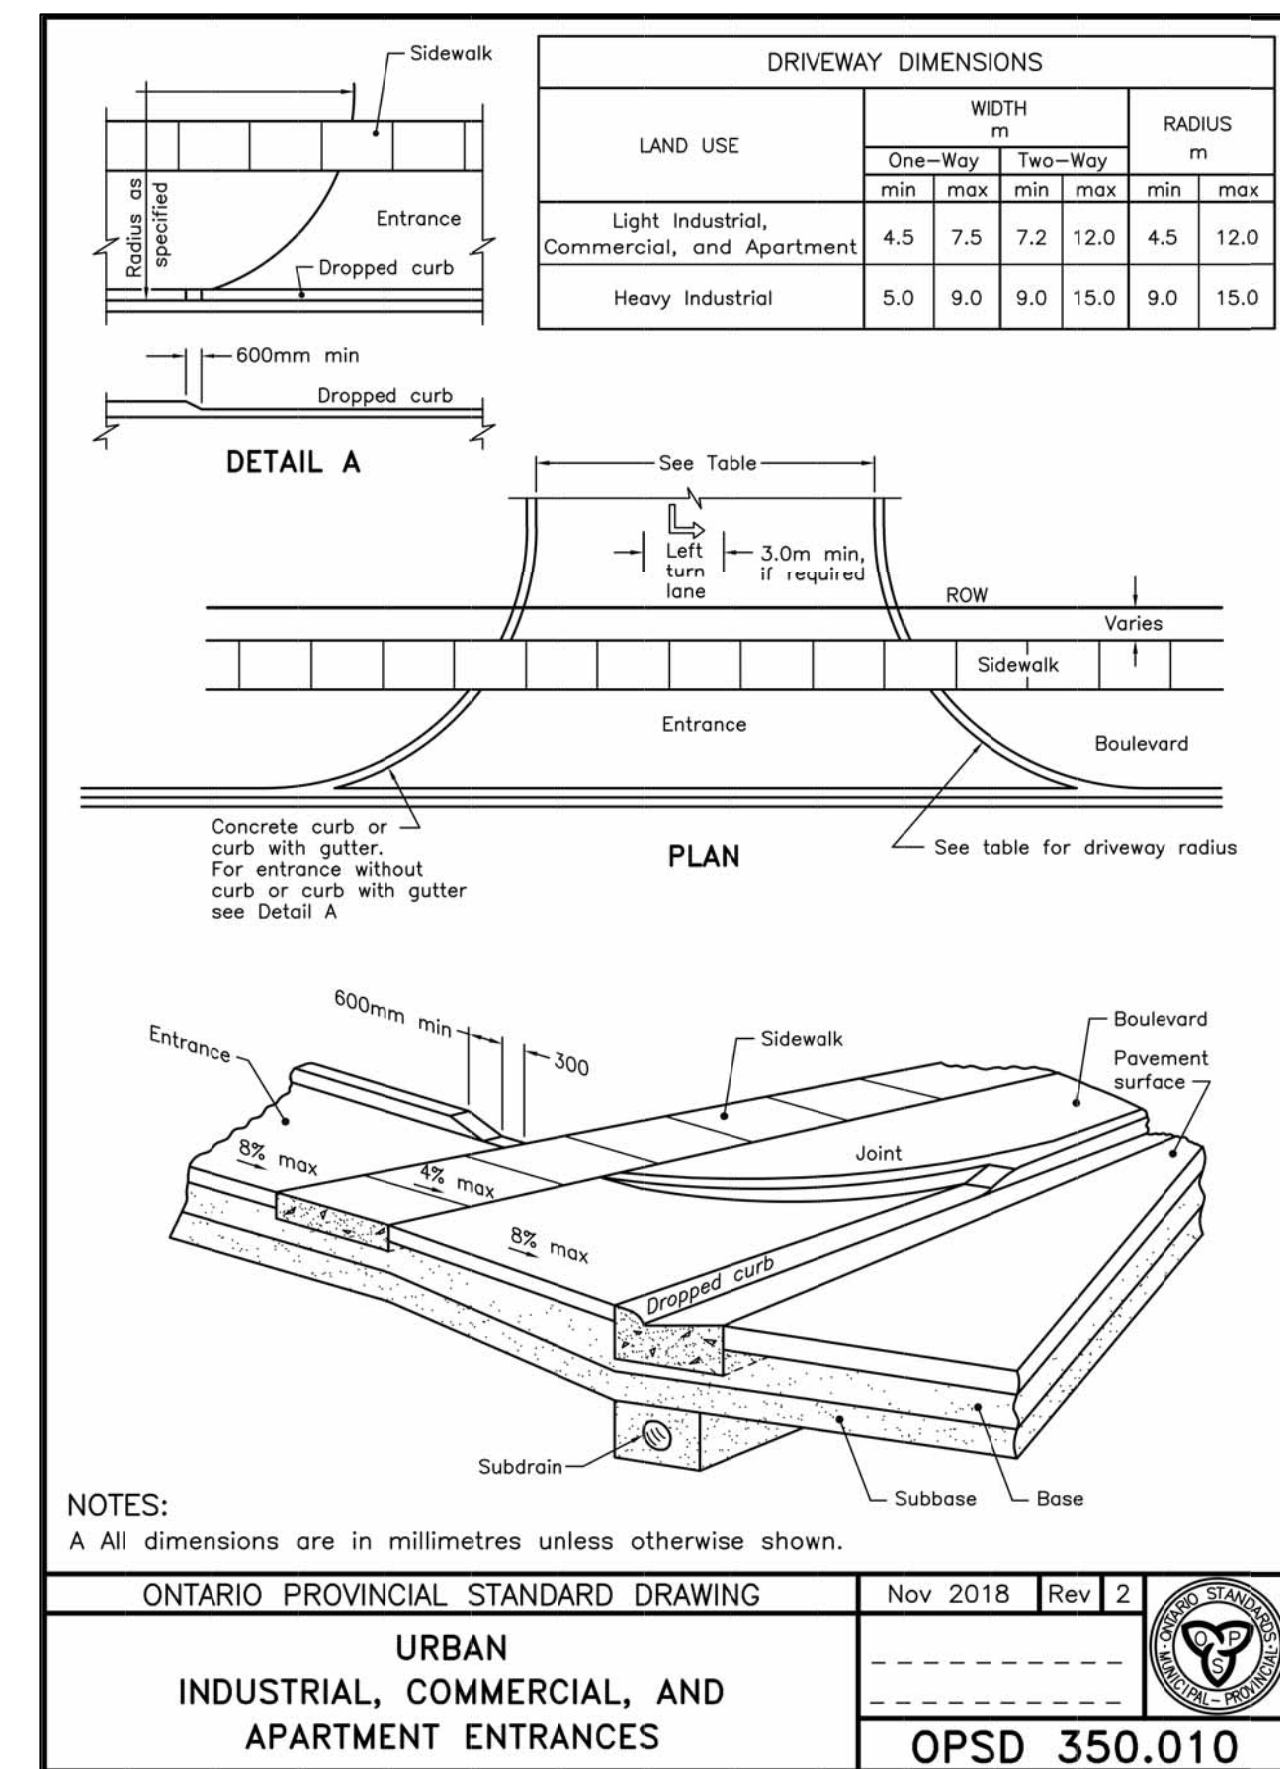


ONTARIO PROVINCIAL STANDARD DRAWING	Nov 2018	Rev 2	
URBAN INDUSTRIAL, COMMERCIAL, AND APARTMENT ENTRANCES			
			OPSD 350.010

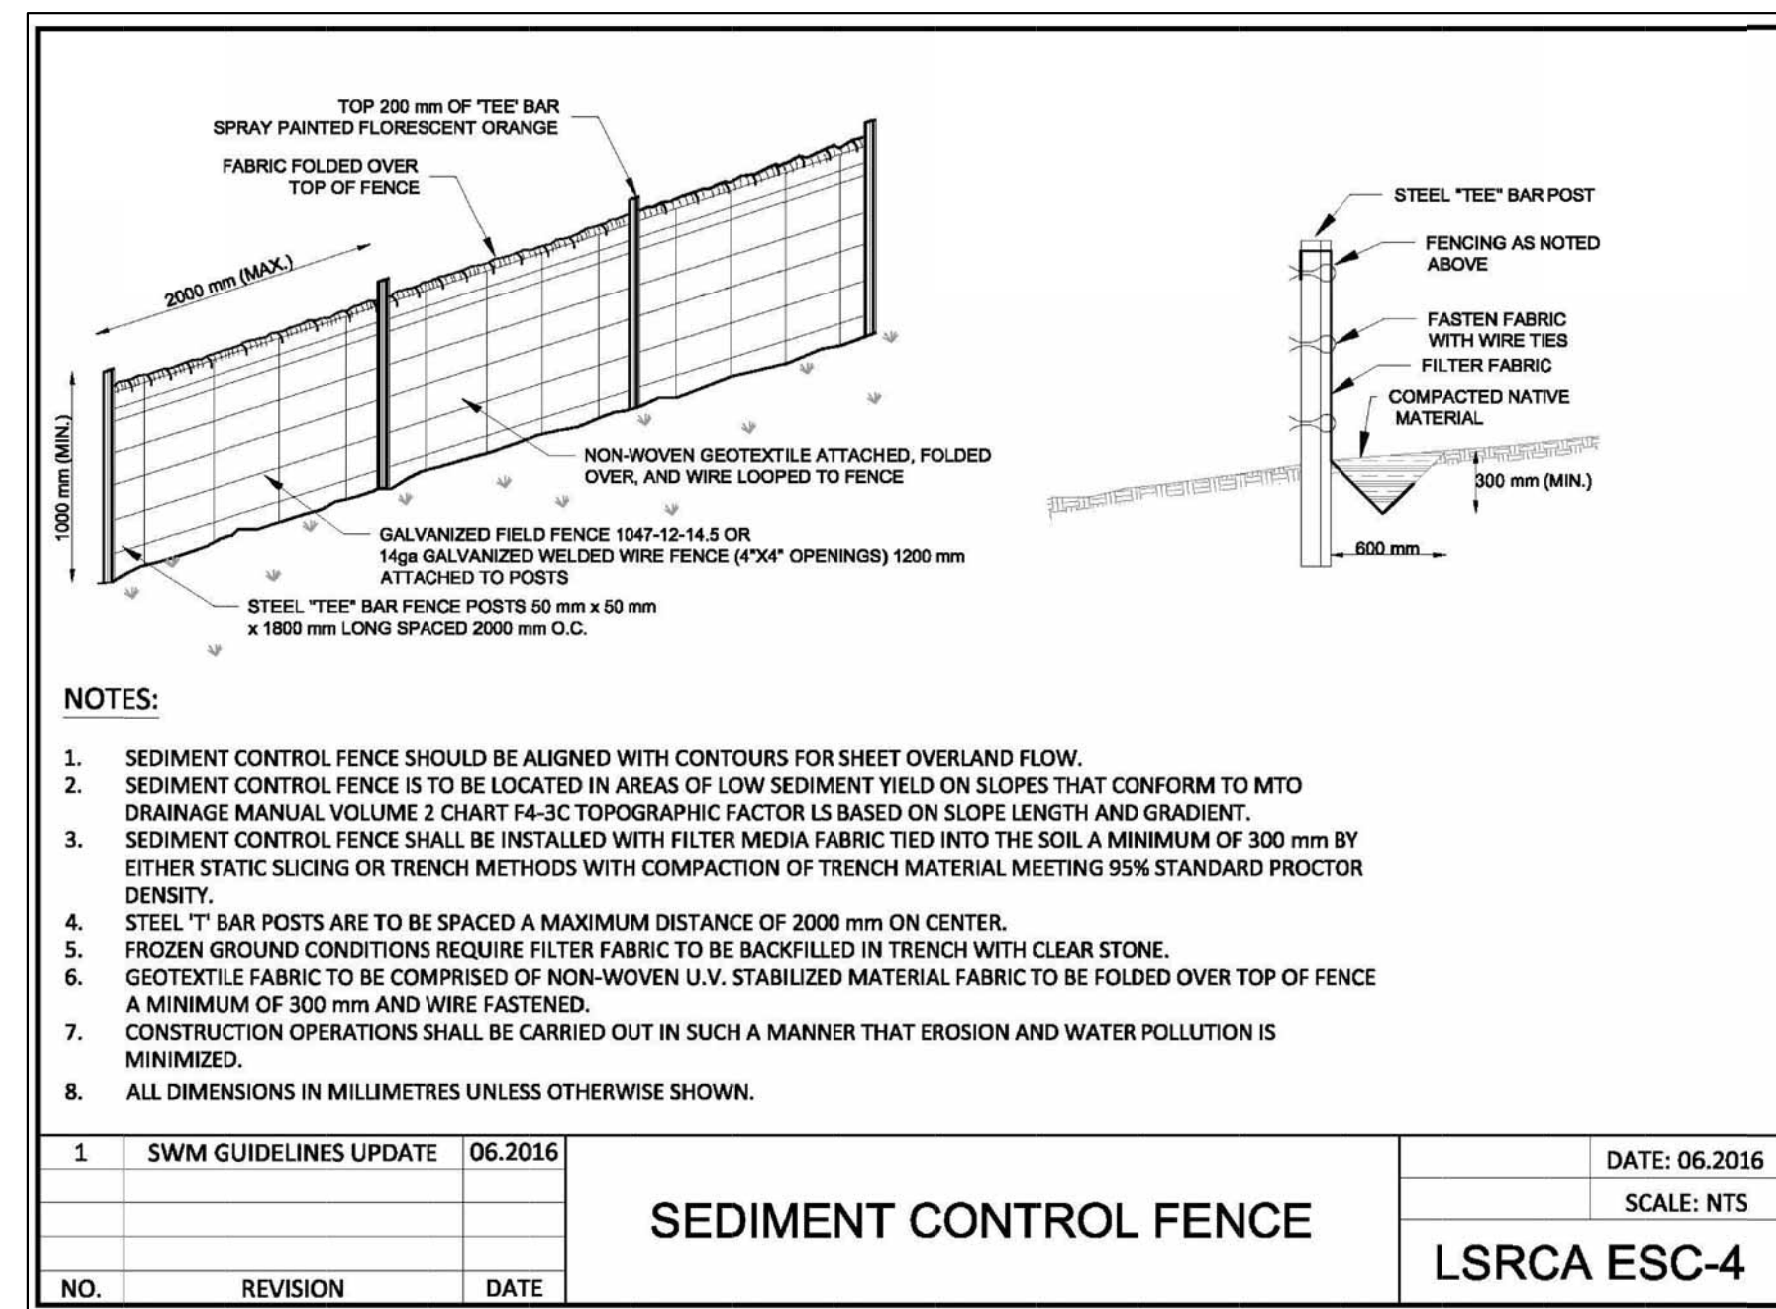

1	SWM GUIDELINES UPDATE	06.2016		DATE: 06.2016
				SCALE: NTS
SEDIMENT CONTROL FENCE				
				LSRCA ESC-4

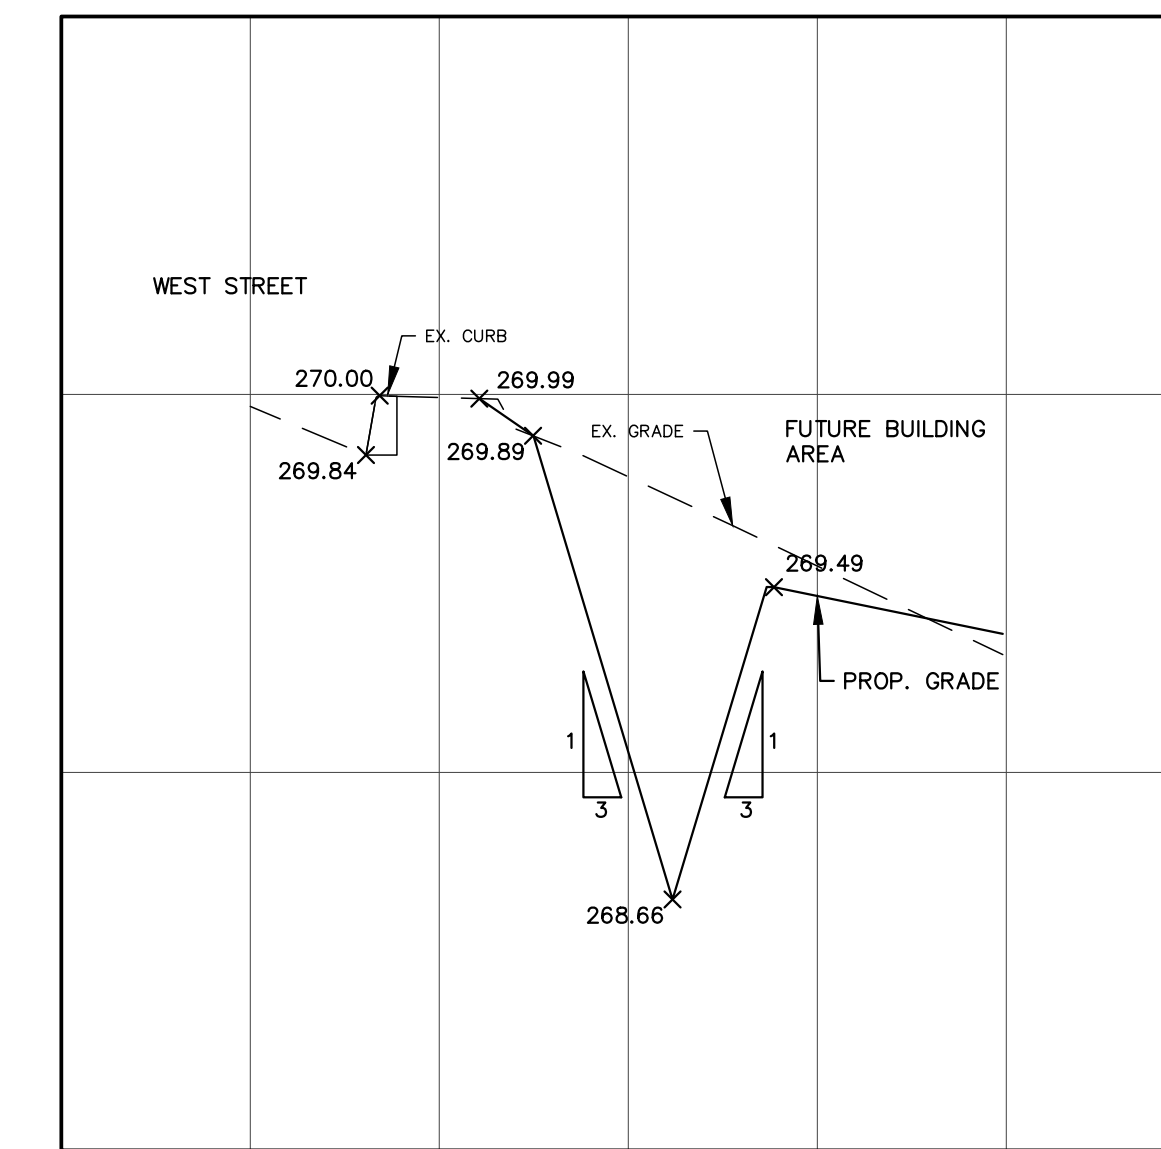

SECTION C-C: MAJOR EXTERNAL OVERLAND SWALE
 HORIZONTAL SCALE 1:200
 VERTICAL SCALE 1:20

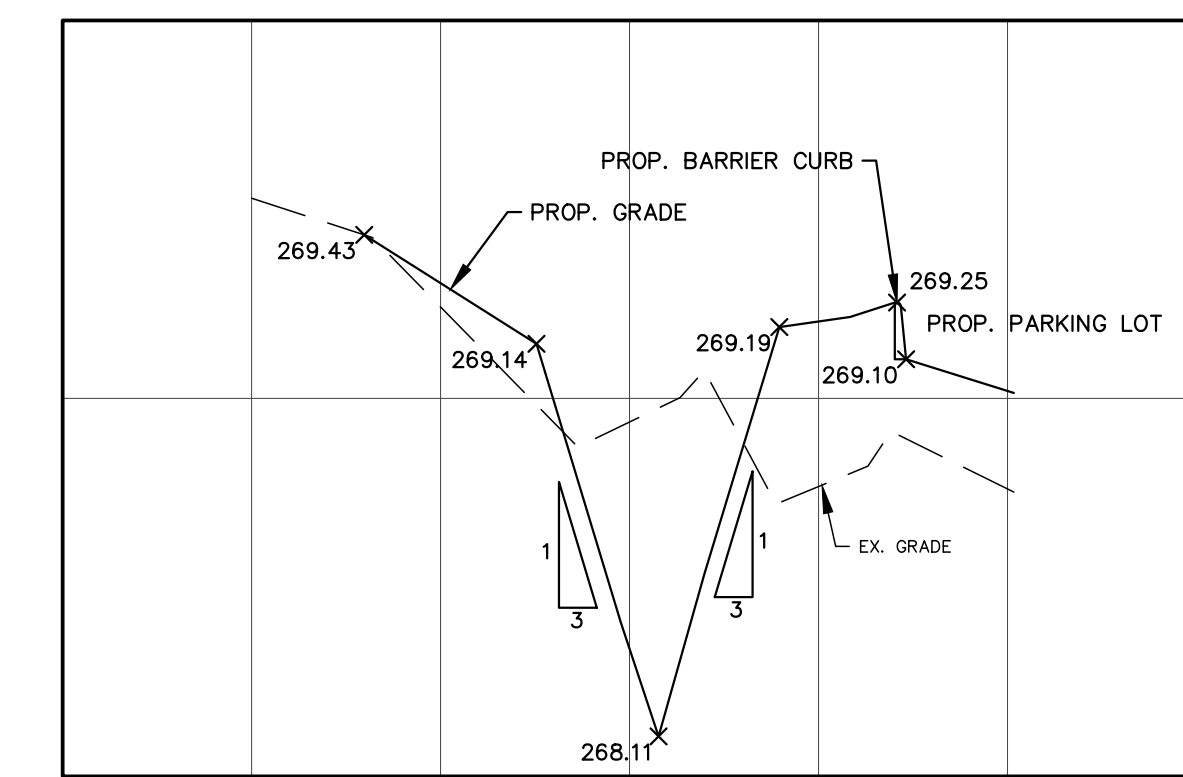

SECTION D-D: MAJOR EXTERNAL OVERLAND SWALE
 HORIZONTAL SCALE 1:200
 VERTICAL SCALE 1:20

P:\AutoCAD\Working\Folders\20002 - BASE.dwg Layout:ND-3 Plotted: Jan 29, 2021 @ 3:30pm by adelle @ PEARSON ENGINEERING LTD.







				BENCHMARK
1.	REVISED AS PER CITY ORILLIA COMMENTS	01/26/21	AA	
NO.	REVISION NOTE	DATE	BY	



COUNTY OF SIMCOE
 AFFORDABLE HOUSING
 ORILLIA, 2 BORLAND STREET EAST

NOTES AND DETAILS 3 OF 4

		DESIGNED BY	AA	HORIZ SCALE	PROJECT #	20002
		DRAWN BY	AA	VERT SCALE	DRAWING #	ND-3
		CHECKED BY	MWD	DATE	REVISION #	1
				NOVEMBER 2020		

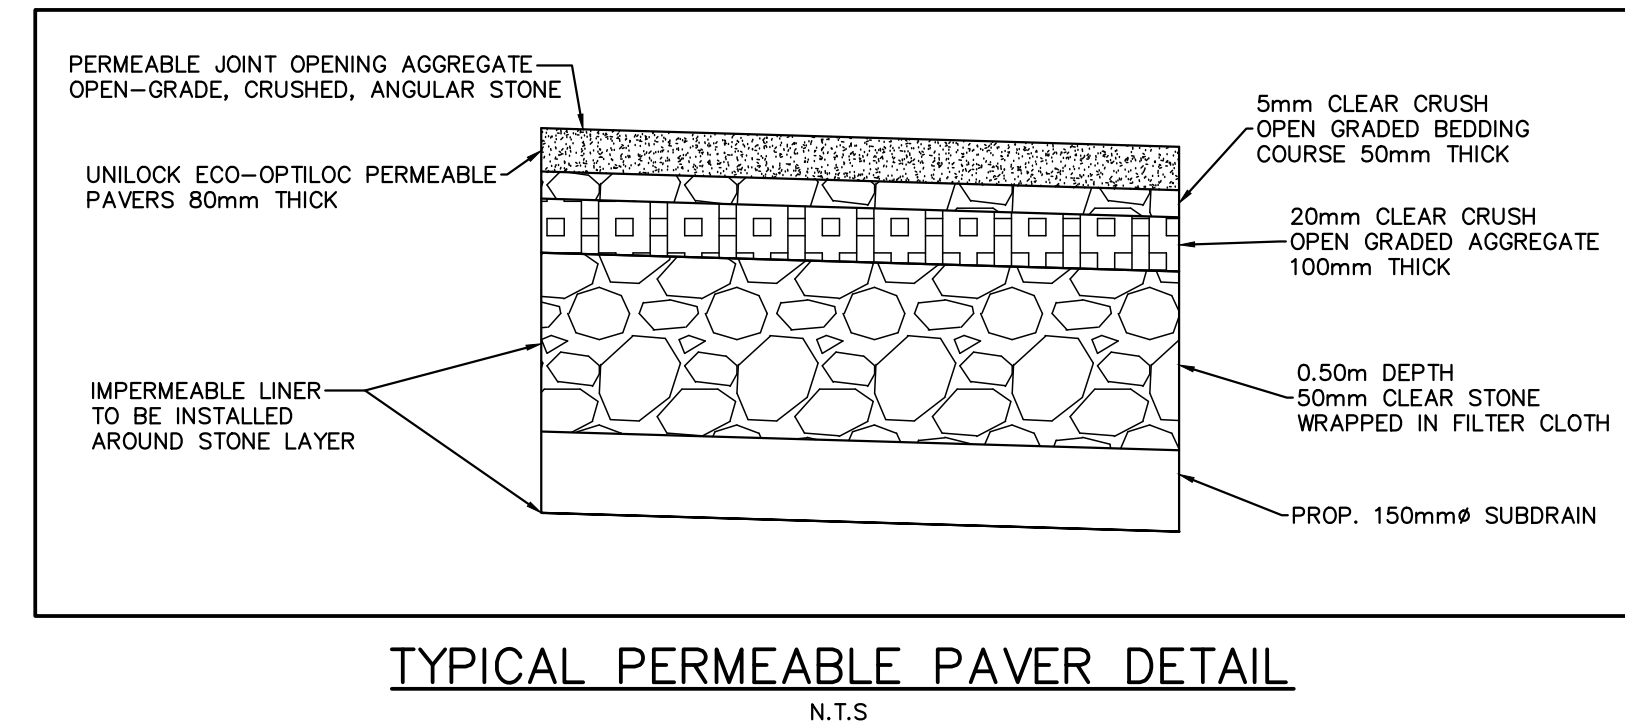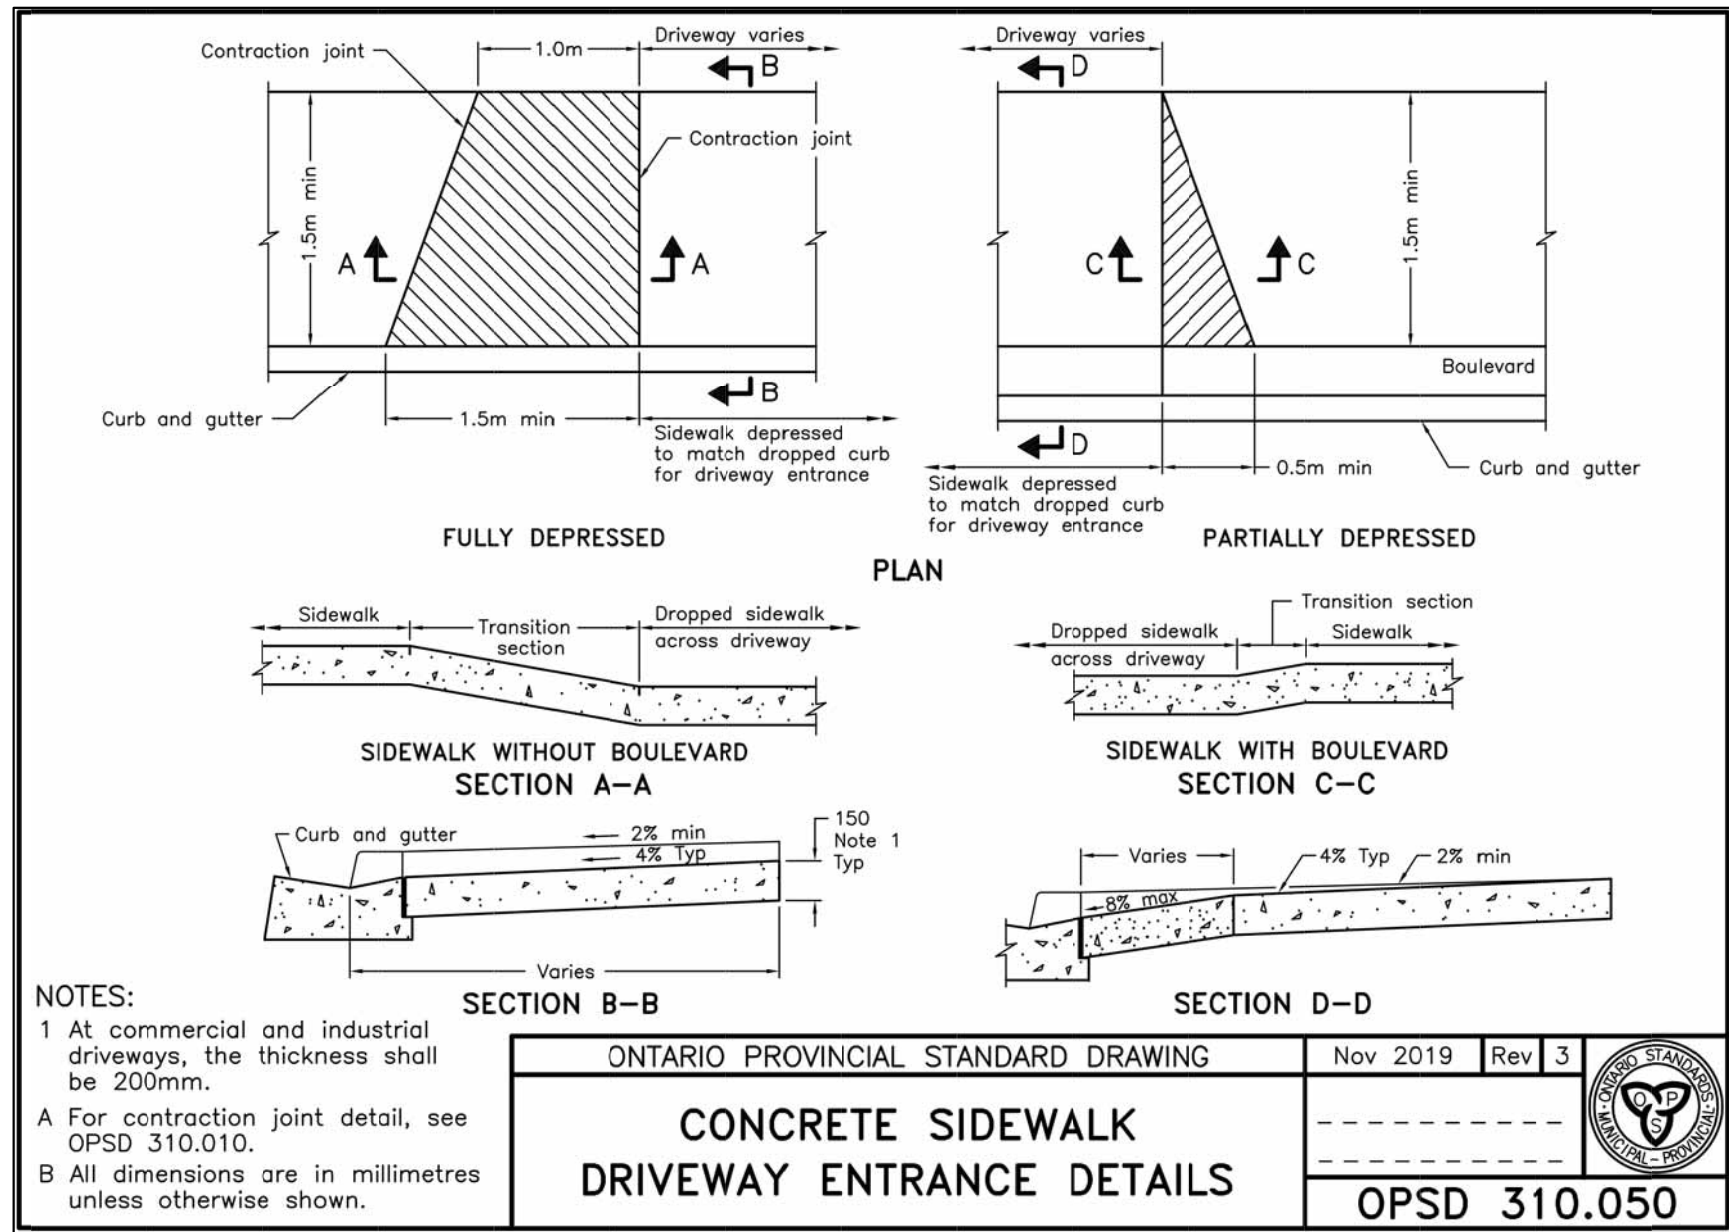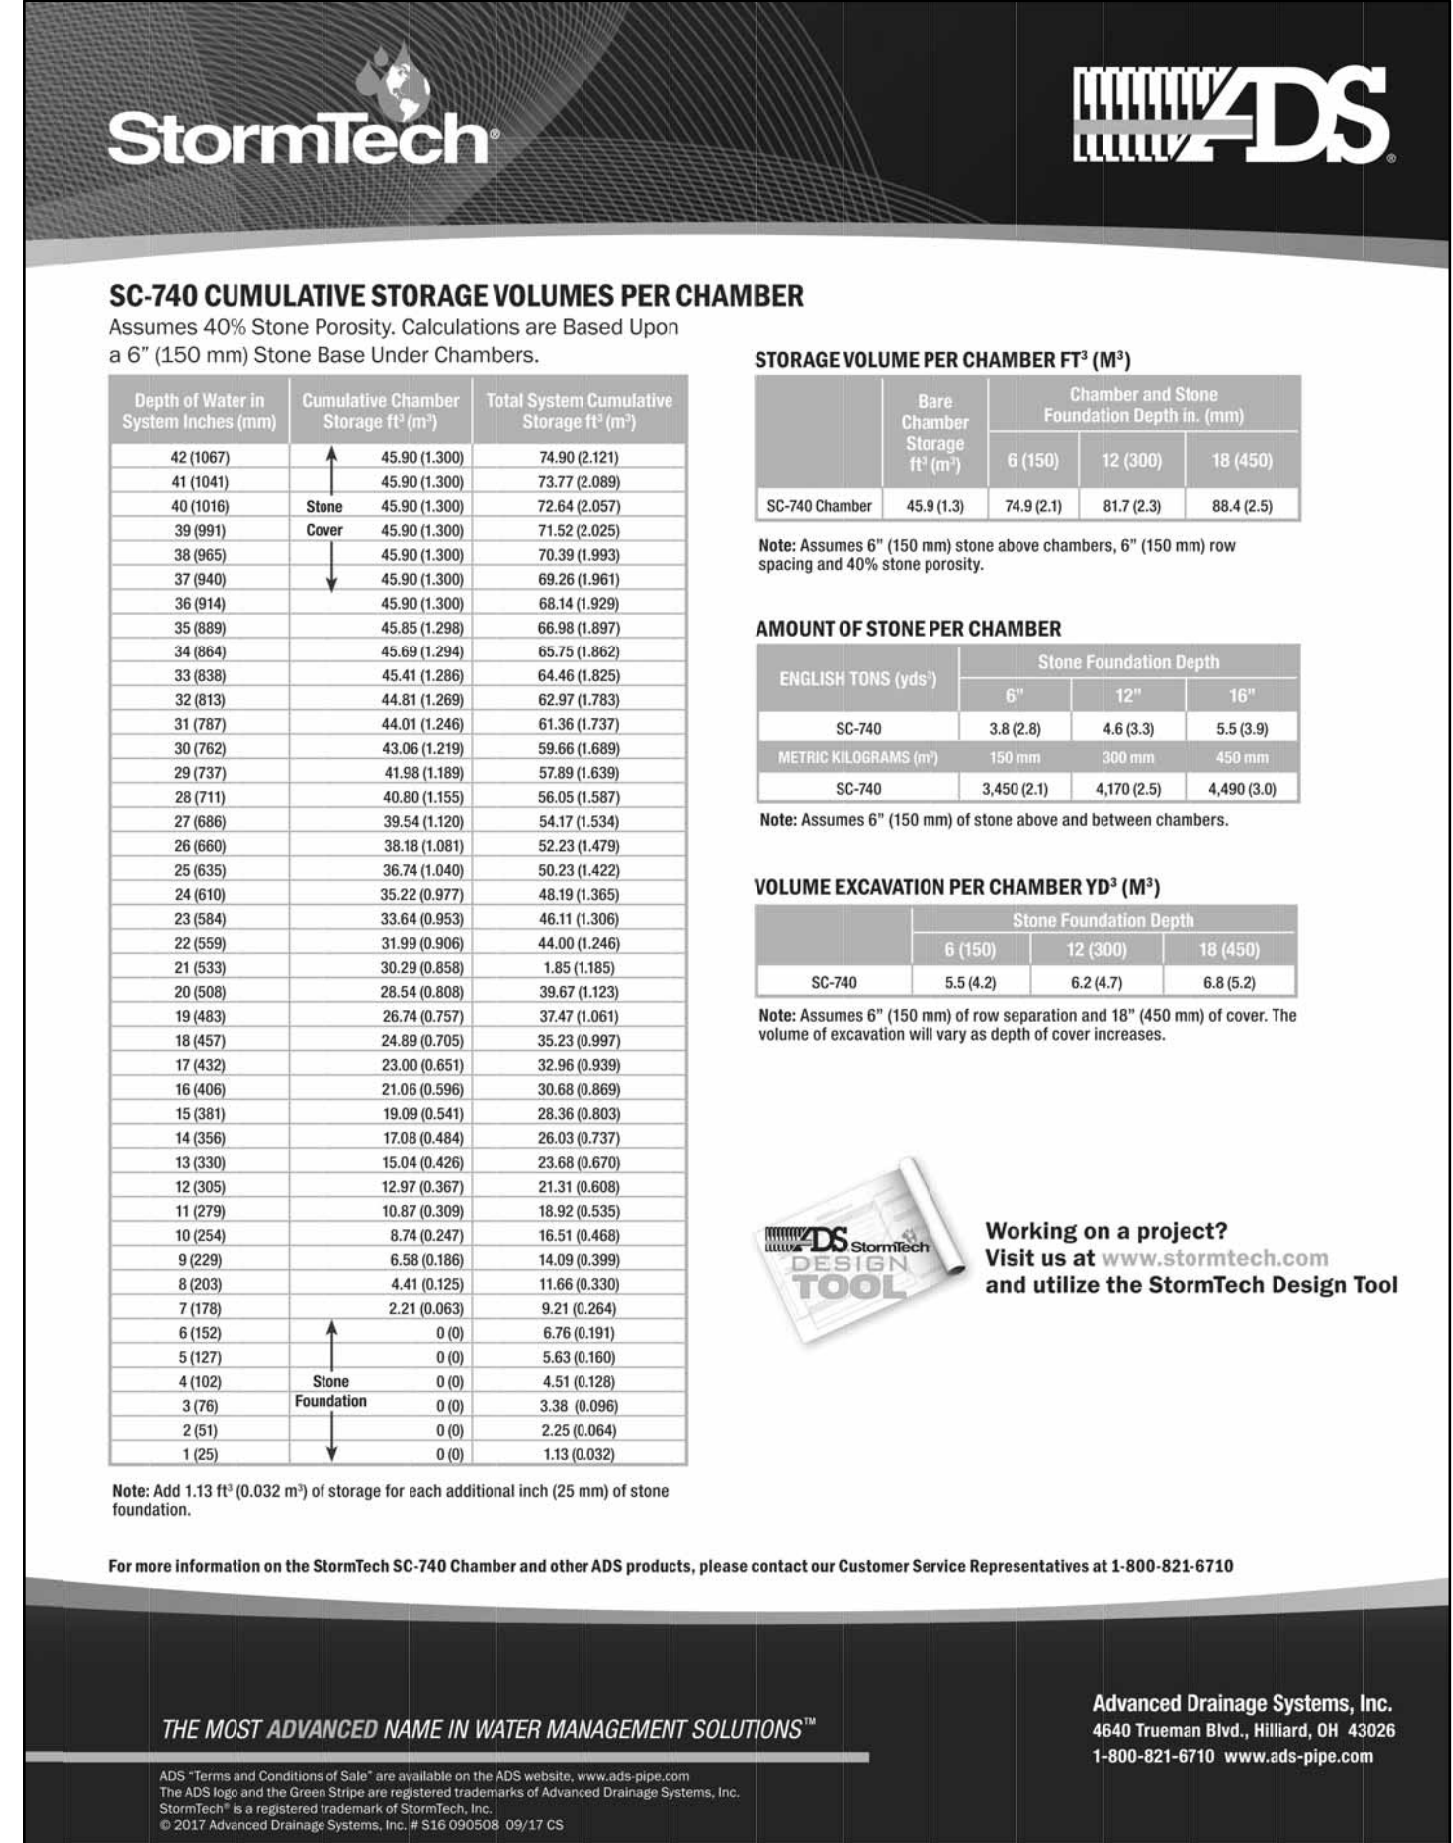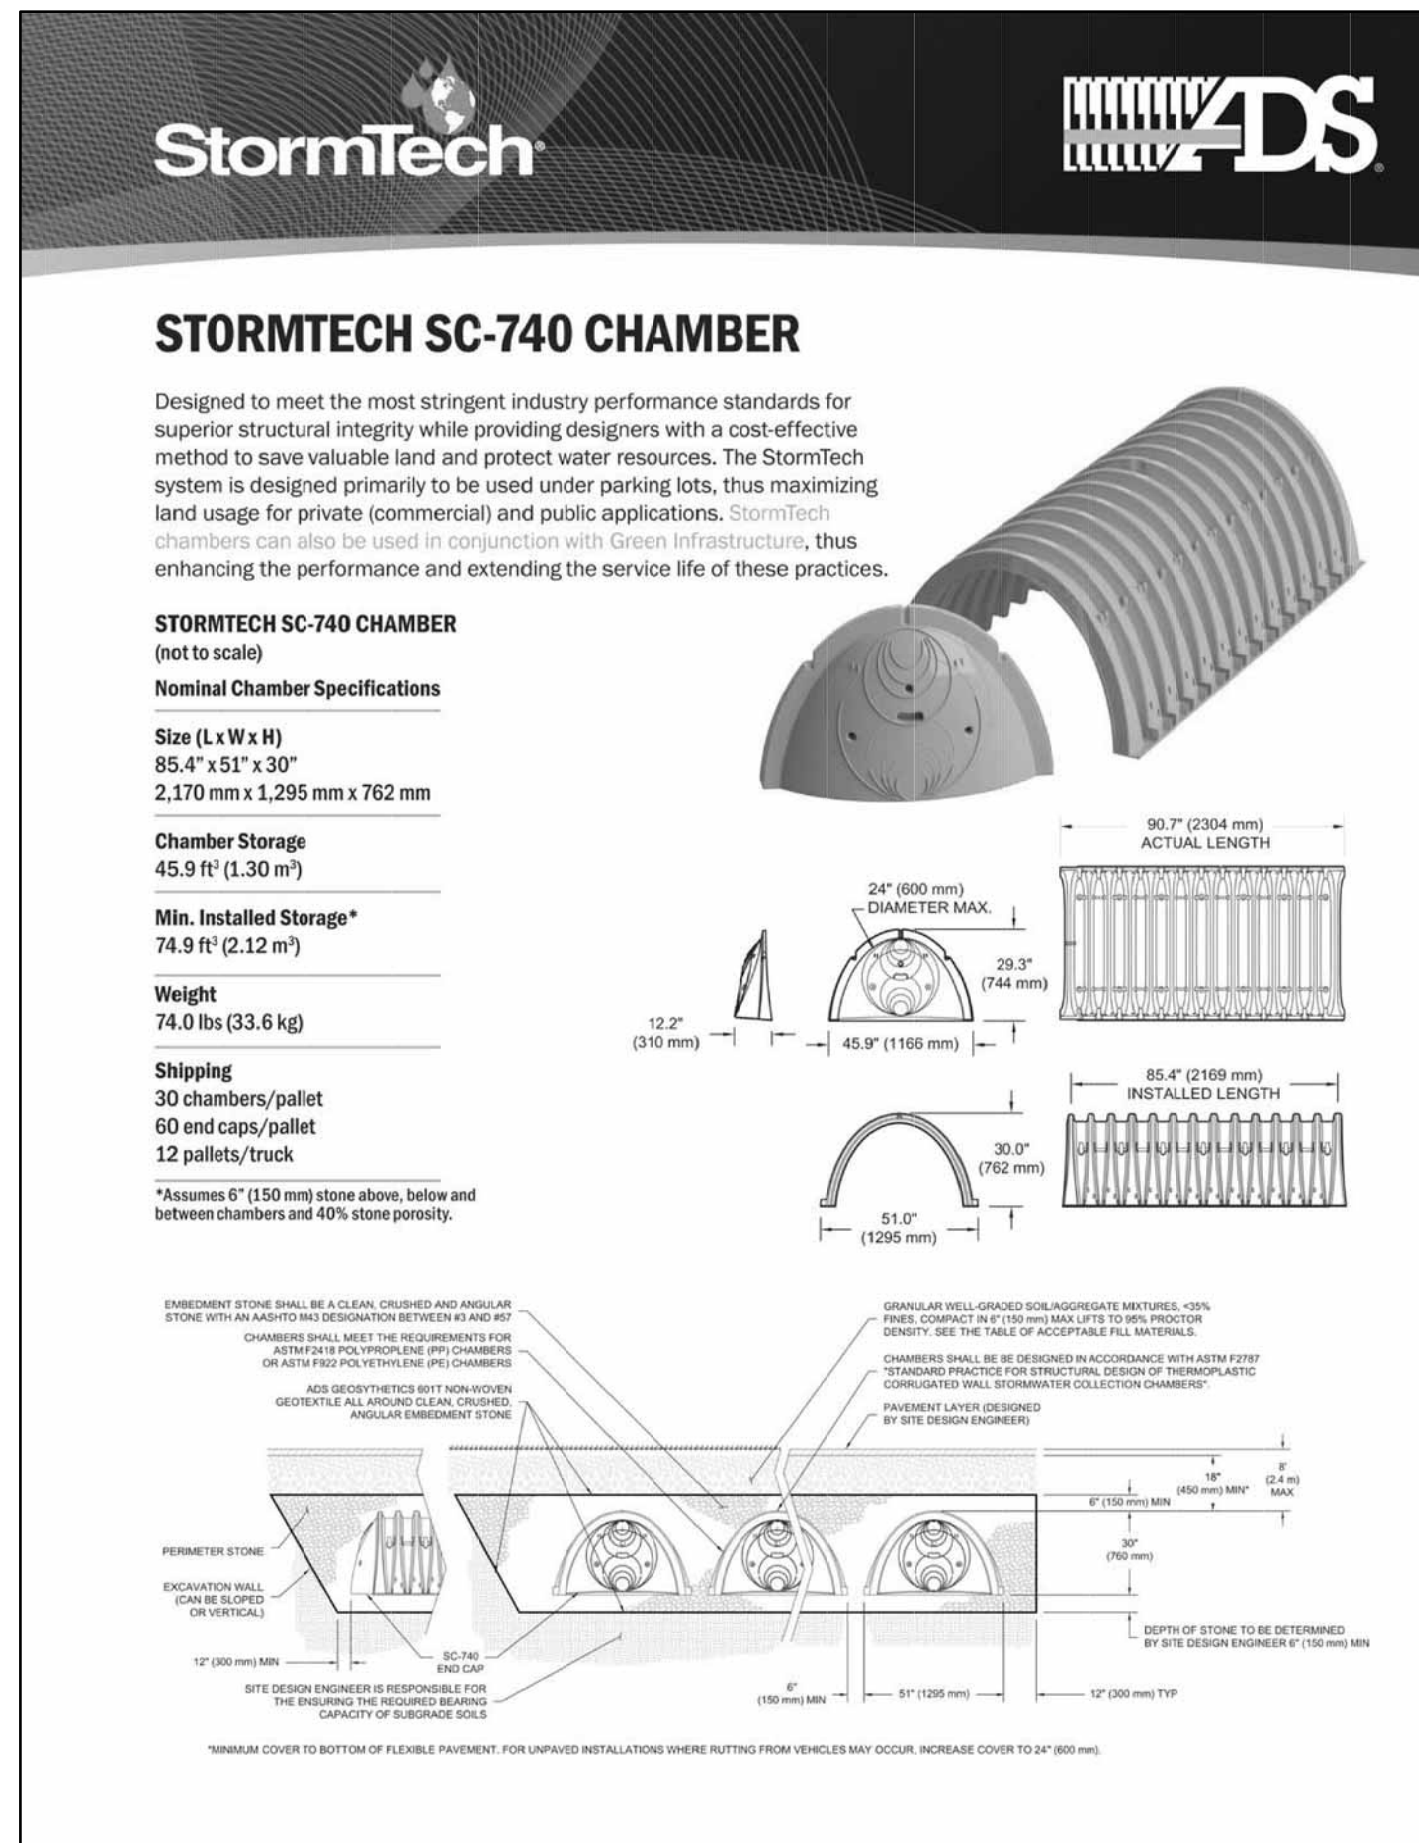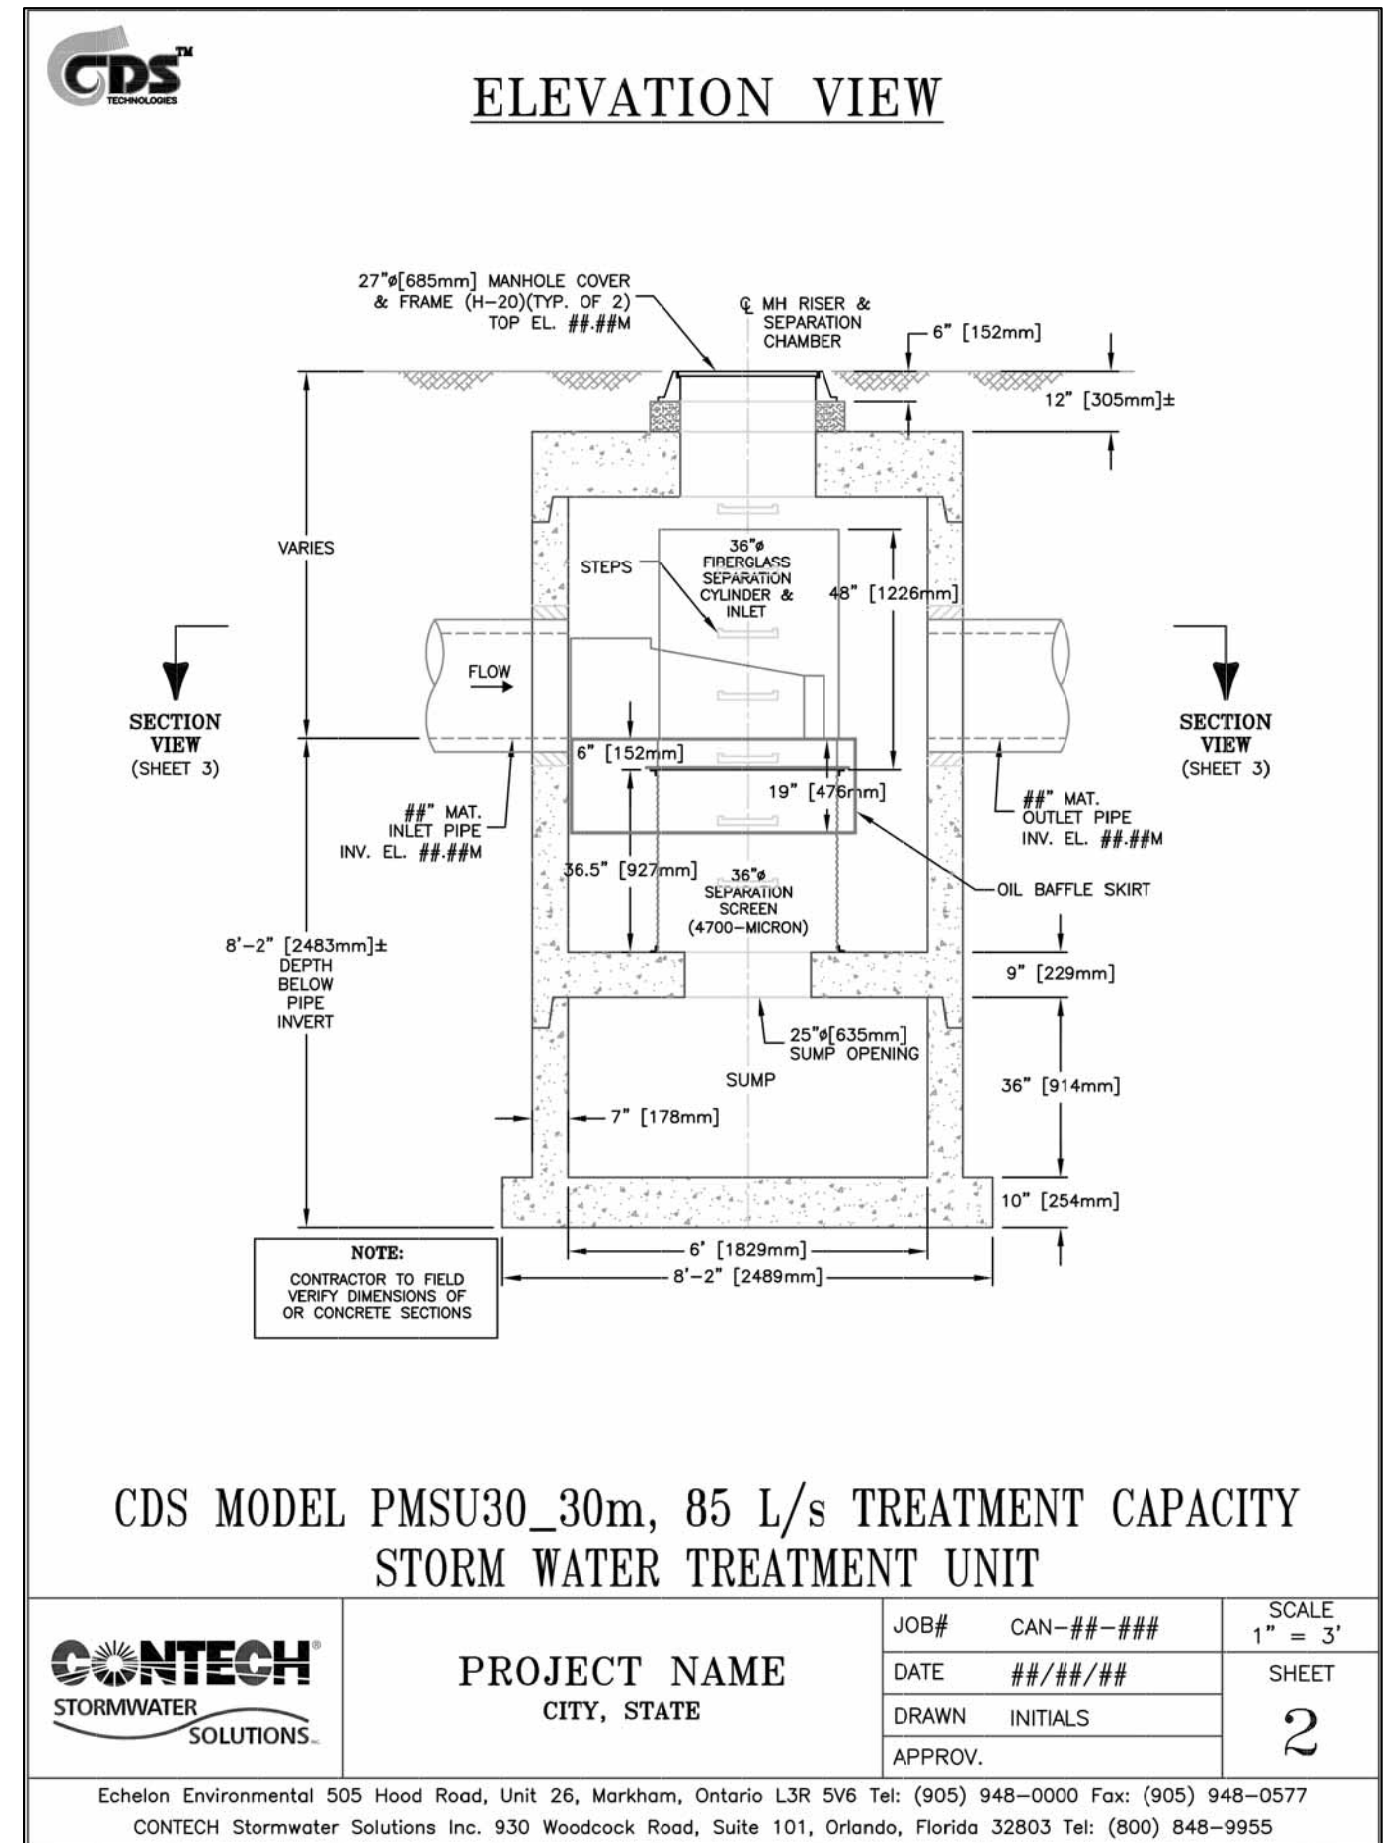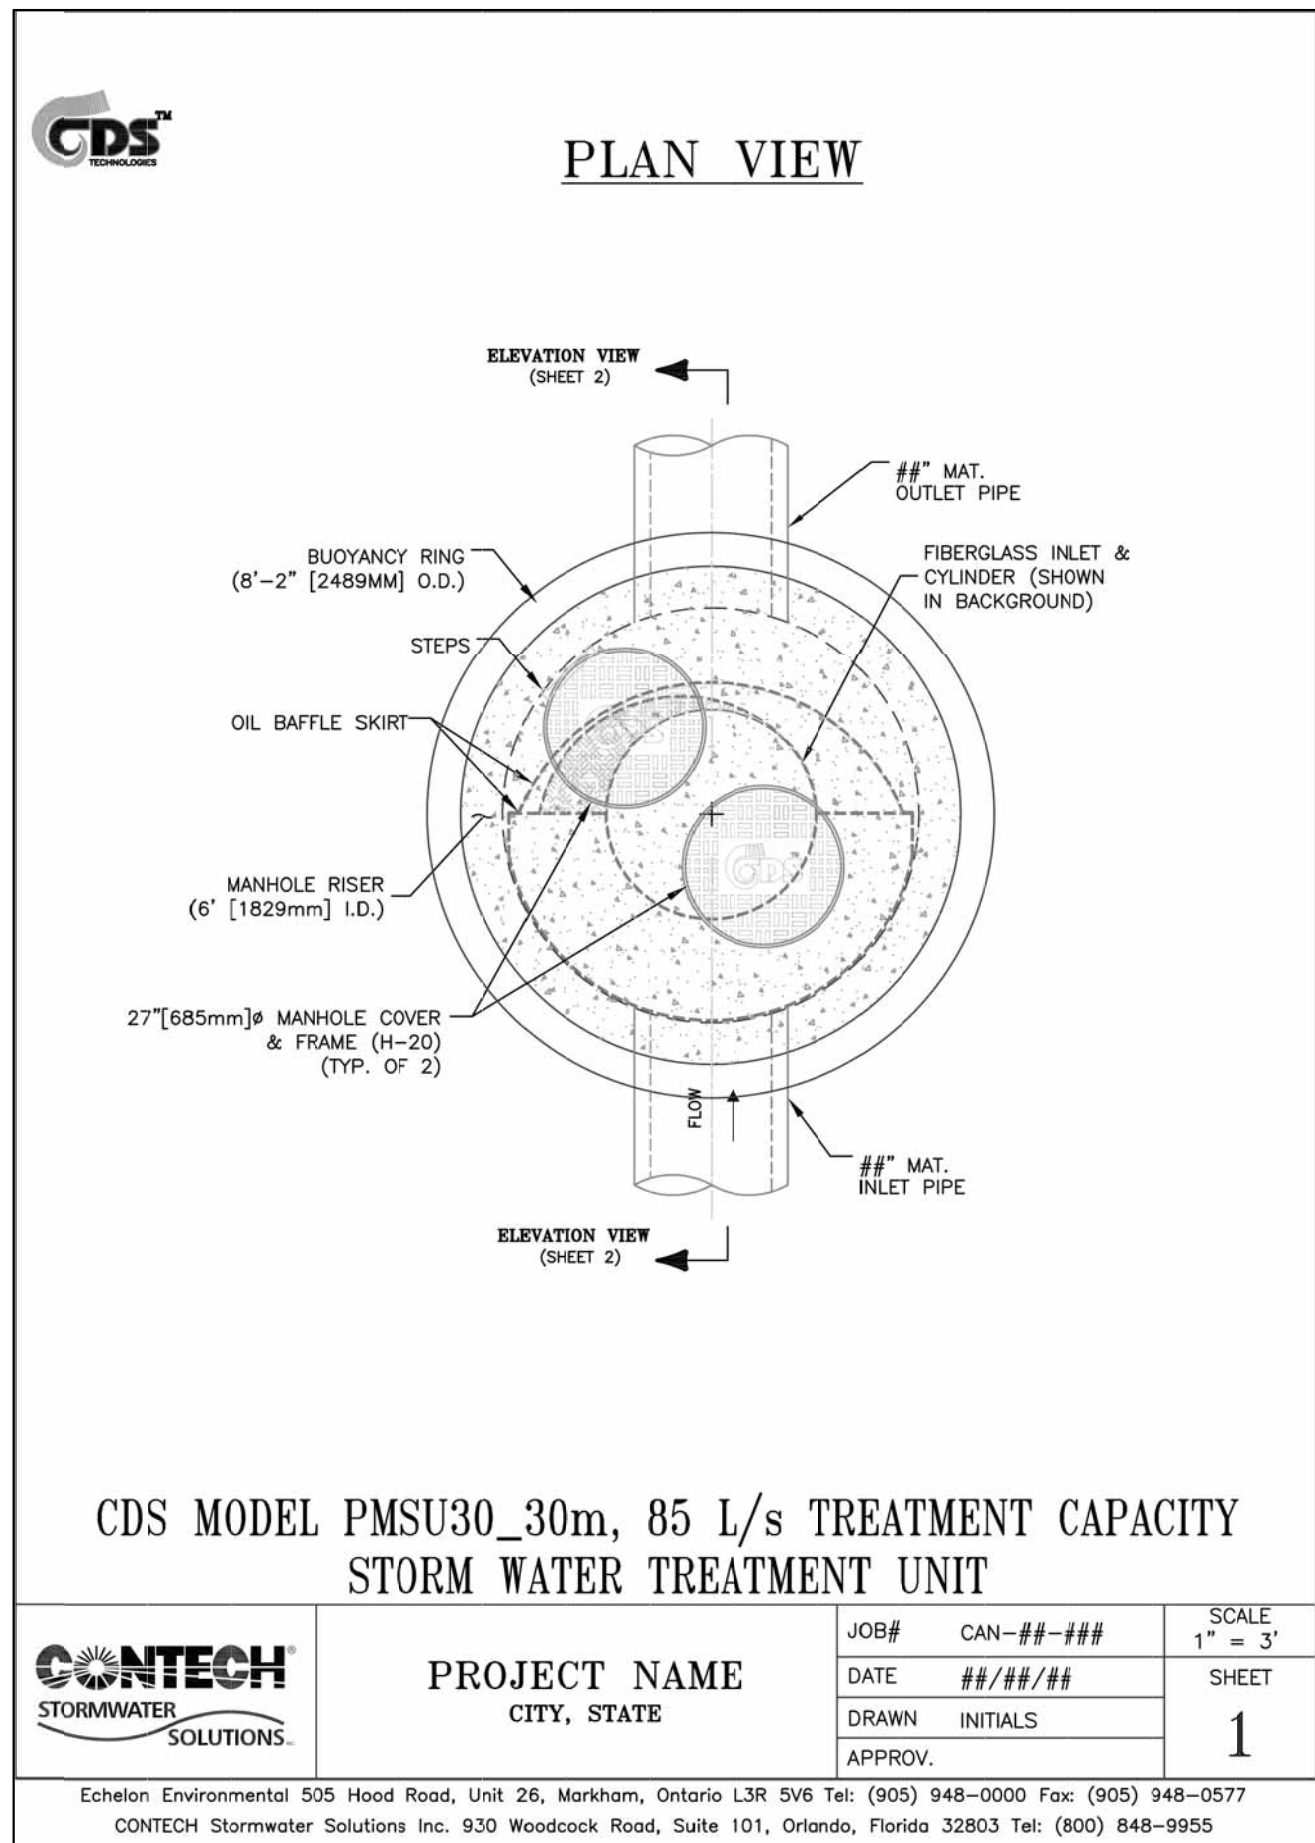

P:\AutoCAD\Working_Folders\20002 - MCL_2 Borland St. E., Orillia\Engineering\20002 - BASE.dwg Layout:ND-4 Plotted: Jan 29, 2021 @ 3:30pm by cadello @ PEARSON ENGINEERING LTD.

NO.	REVISION NOTE	DATE	BY
1.	REVISED AS PER CITY ORILLIA COMMENTS	01/26/21	AA

BENCHMARK	





COUNTY OF SIMCOE
 AFFORDABLE HOUSING
 ORILLIA, 2 BORLAND STREET EAST

NOTES AND DETAILS 4 OF 4

PEARSON ENGINEERING LTD.
 PEARSONENG.COM PH. 705.719.4785

DESIGNED BY	AA	HORIZ SCALE	PROJECT #	20002
DRAWN BY	AA	VERT SCALE	DRAWING #	ND-4
CHECKED BY	MWD	DATE	REVISION #	NOVEMBER 2020


P:\Projects\2020\202002 - MCL 2 Borland St. E., Orillia\Working Folders\200202 - BASE.dwg Layout:SG-1 Plotted Jan 29, 2021 @ 3:30pm by aedilio @ PEARSON ENGINEERING LTD.

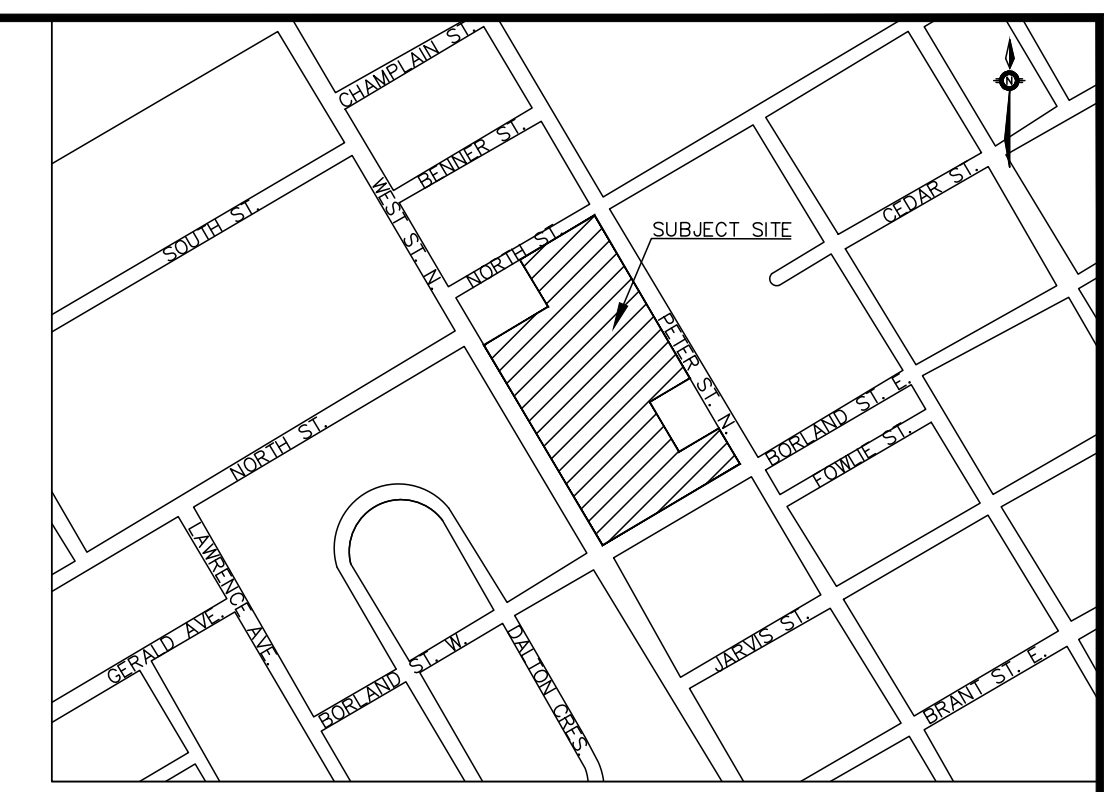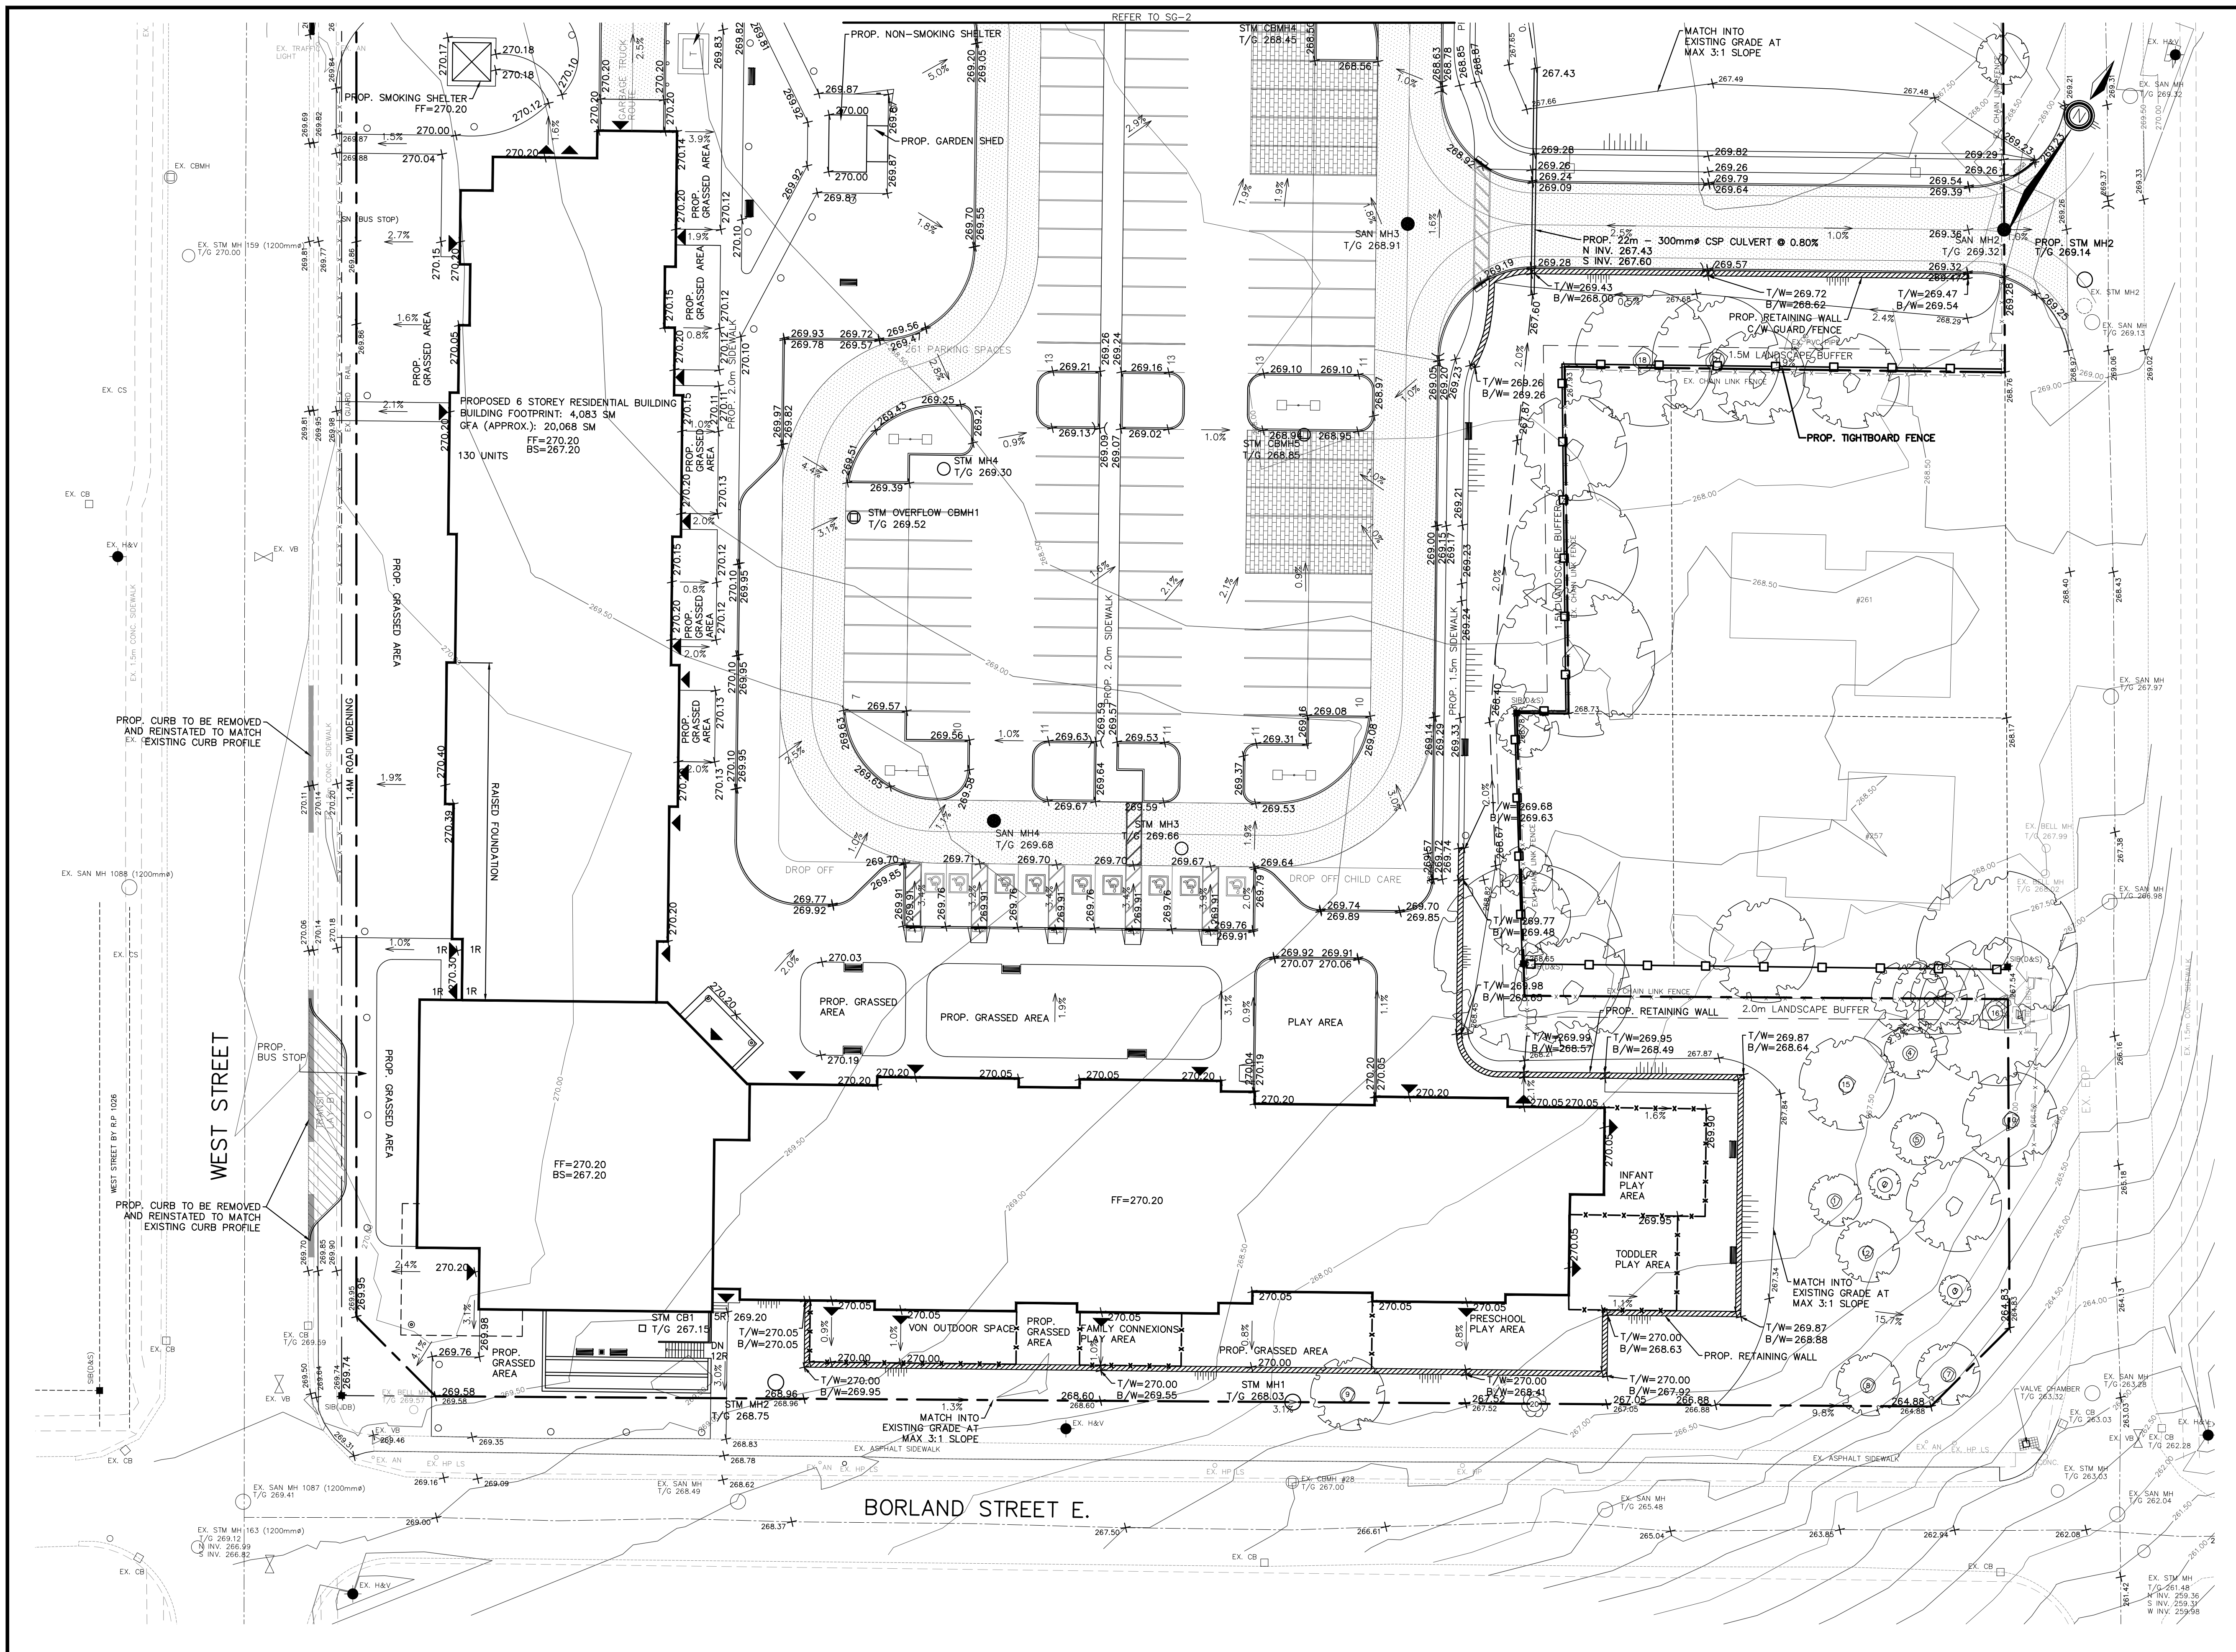

- LEGEND**
- CB CATCH BASIN
 - DCB DOUBLE CATCH BASIN
 - CBMH CATCH BASIN
 - MH STORM MANHOLE
 - MH SANITARY MANHOLE
 - SERVICE CAP
 - ◆ HYD. FIRE HYDRANT
 - ◆ VB WATER VALVE
 - CS CURB STOP W/ SERVICE
 - × 254.63 PROPOSED ELEVATION
 - 254.09 EXISTING ELEVATION
 - 1.5% PROPOSED DIRECTION AND GRADE
 - BACK OF CURB
 - EDGE OF PAVEMENT
 - CURB CUT LOCATION
 - () HIGH POINT
 - - - - - EX. CHAINLINK FENCE
 - EX. BELL BOX
 - EX. TREE
 - PROP. RETAINING WALL
 - PROP. TIGHTBOARD FENCE
 - PROP. LIGHT STANDARD
 - PROP. BOLLARD LIGHT
 - ▨ PROP. PERMEABLE PAVERS AS PER N0-4
 - ▨ PROP. HEAVY DUTY ASPHALT

NO.	REVISION NOTE	DATE	BY
1.	REVISED AS PER CITY ORILLIA COMMENTS	01/26/21	AA

BENCHMARK			


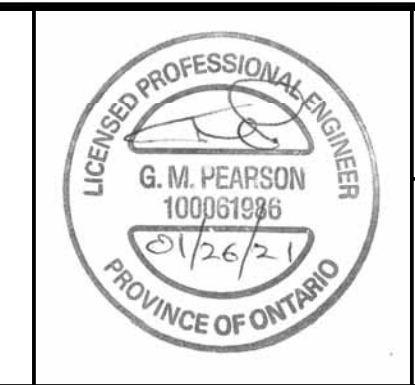


COUNTY OF SIMCOE
AFFORDABLE HOUSING
ORILLIA, 2 BORLAND STREET EAST

SITE GRADING PLAN
1 OF 3

PEARSON ENGINEERING LTD.
PEARSONENG.COM PH. 705.719.4785

DESIGNED BY	AA	HORIZ SCALE	1:300	PROJECT #	20002
DRAWN BY	AA	VERT SCALE		DRAWING #	SG-1
CHECKED BY	MWD	DATE	NOVEMBER 2020	REVISION #	1

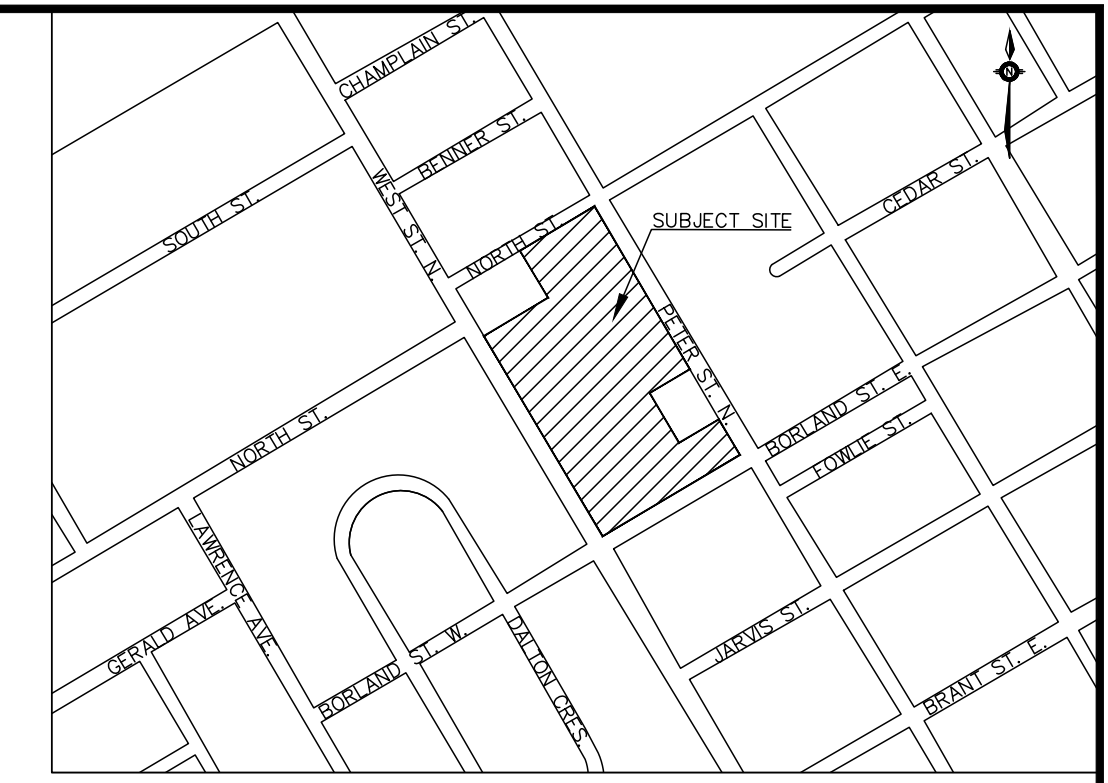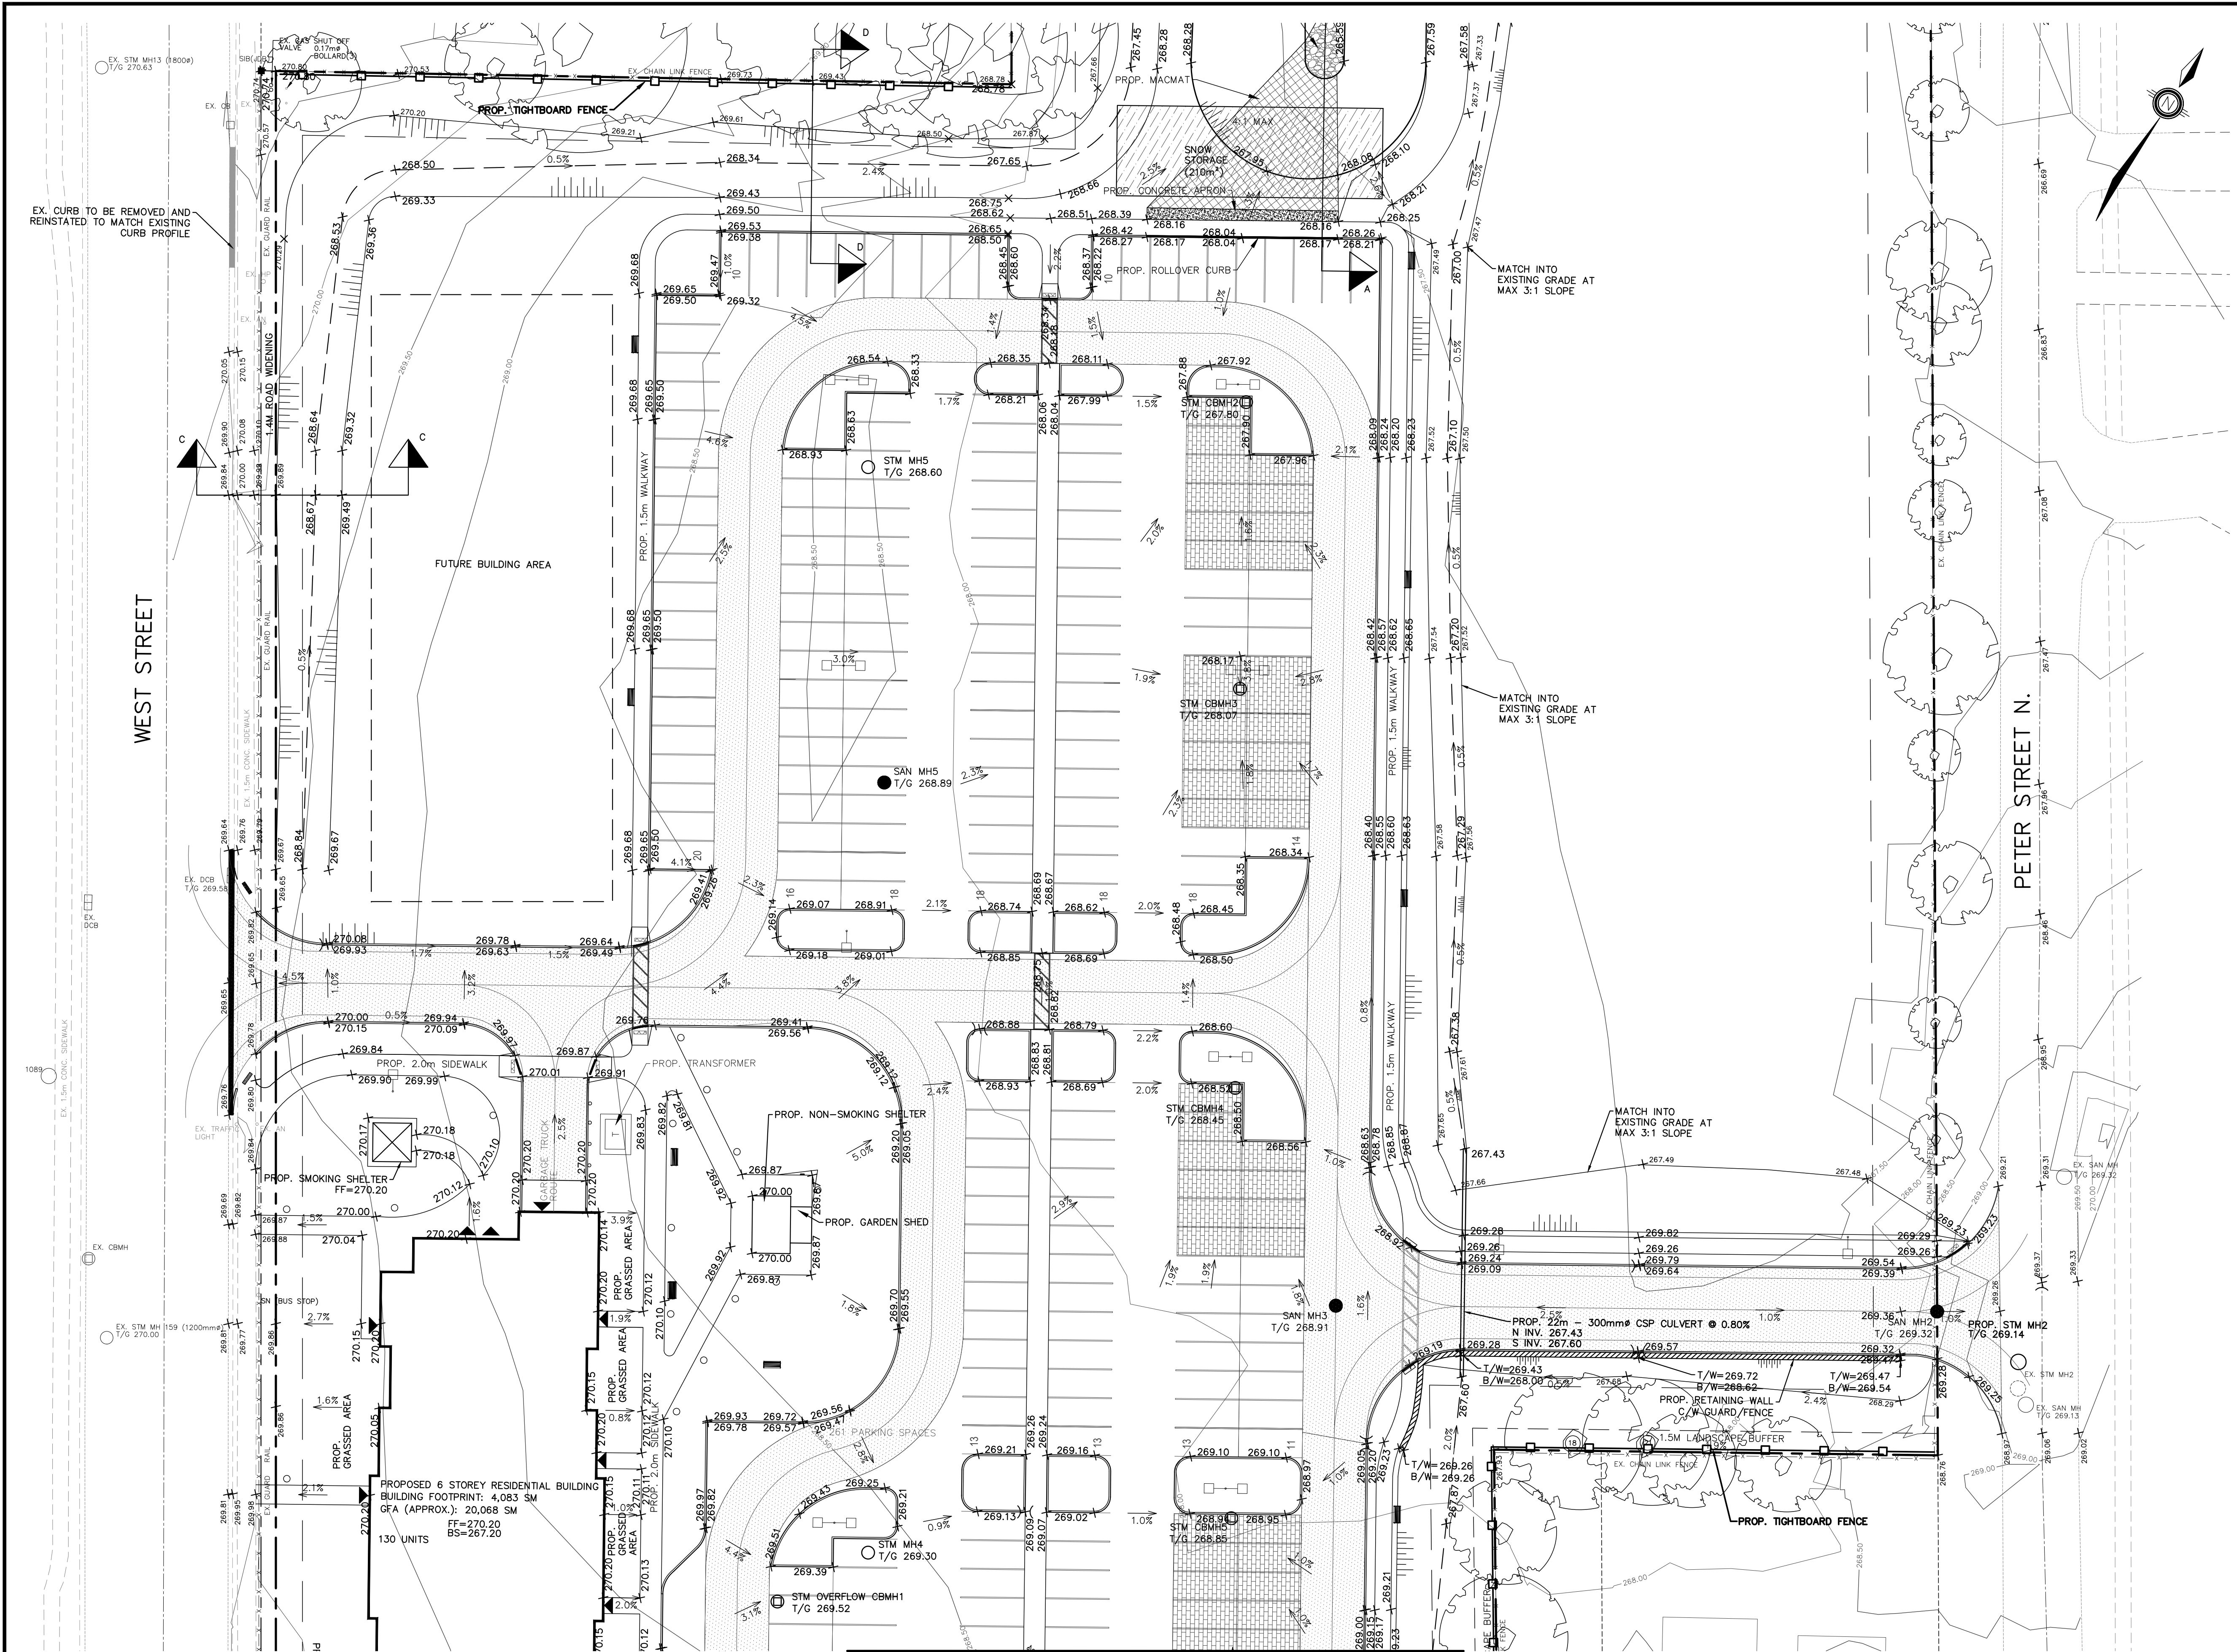

KEY MAP
NTS

LEGEND

- CB CATCH BASIN
- DCB DOUBLE CATCH BASIN
- CBMH CATCH BASIN
- MH STORM MANHOLE
- SMH SANITARY MANHOLE
- SERVICE CAP
- ◆ HYD. FIRE HYDRANT
- ◆ VB WATER VALVE
- CS CURB STOP W/ SERVICE
- × 254.63 PROPOSED ELEVATION
- 254.09 EXISTING ELEVATION
- 1.5% PROPOSED DIRECTION AND GRADE
- BACK OF CURB
- EDGE OF PAVEMENT
- CURB CUT LOCATION
- () HIGH POINT
- - - EX. CHAINLINK FENCE
- EX. BELL BOX
- EX. TREE
- PROP. RETAINING WALL
- PROP. TIGHTBOARD FENCE
- PROP. LIGHT STANDARD
- ▨ PROP. PERMEABLE PAVERS AS PER ND-4
- ▨ PROP. HEAVY DUTY ASPHALT

NO.	REVISION NOTE	DATE	BY
1.	REVISED AS PER CITY ORILLIA COMMENTS	01/26/21	AA

BENCHMARK	





COUNTY OF SIMCOE
AFFORDABLE HOUSING
ORILLIA, 2 BORLAND STREET EAST

SITE GRADING PLAN
2 OF 3

PEARSON ENGINEERING LTD.
PEARSONENG.COM PH. 705.719.4785

DESIGNED BY	AA	HORIZ SCALE	1:300	PROJECT #	20002
DRAWN BY	AA	VERT SCALE		DRAWING #	SG-2
CHECKED BY	MWD	DATE	NOVEMBER 2020	REVISION #	1

P:\AutoCAD\Working\Folders\20002 - MCL 2 Borland St. E., Orillia\Engineering\20002 - BASE.dwg Layout:SG-3 Plotted Jan 29, 2021 @ 3:31pm by adalio @ PEARSON ENGINEERING LTD.

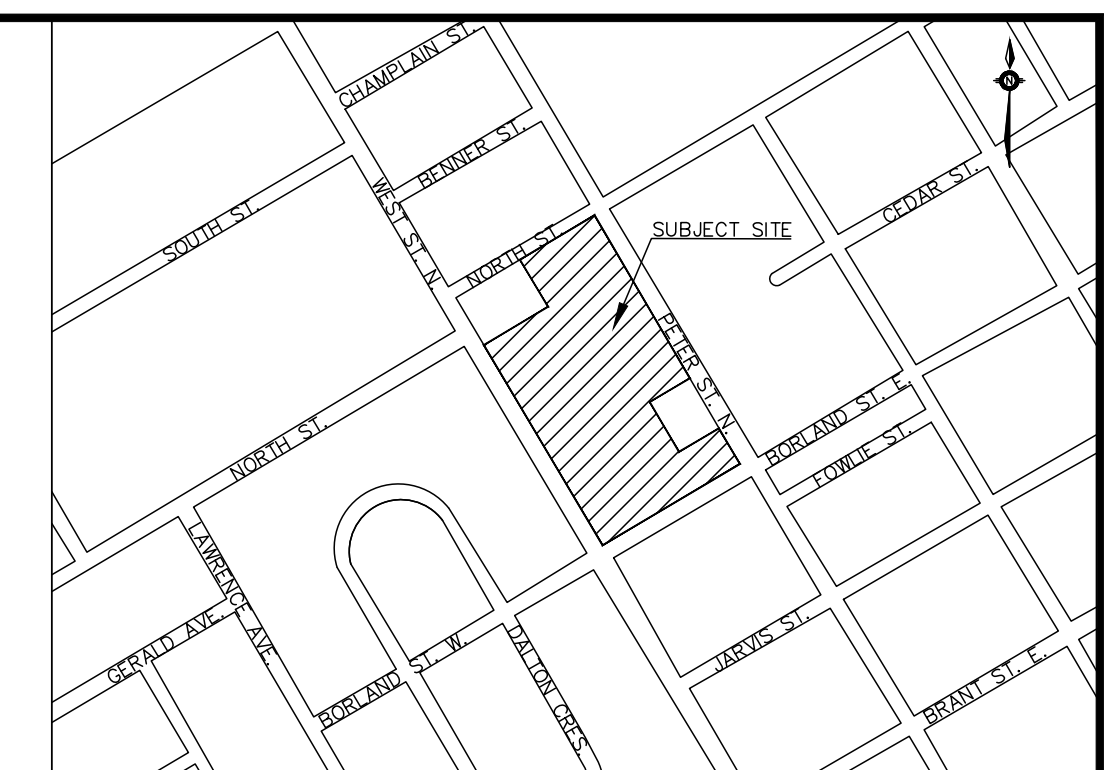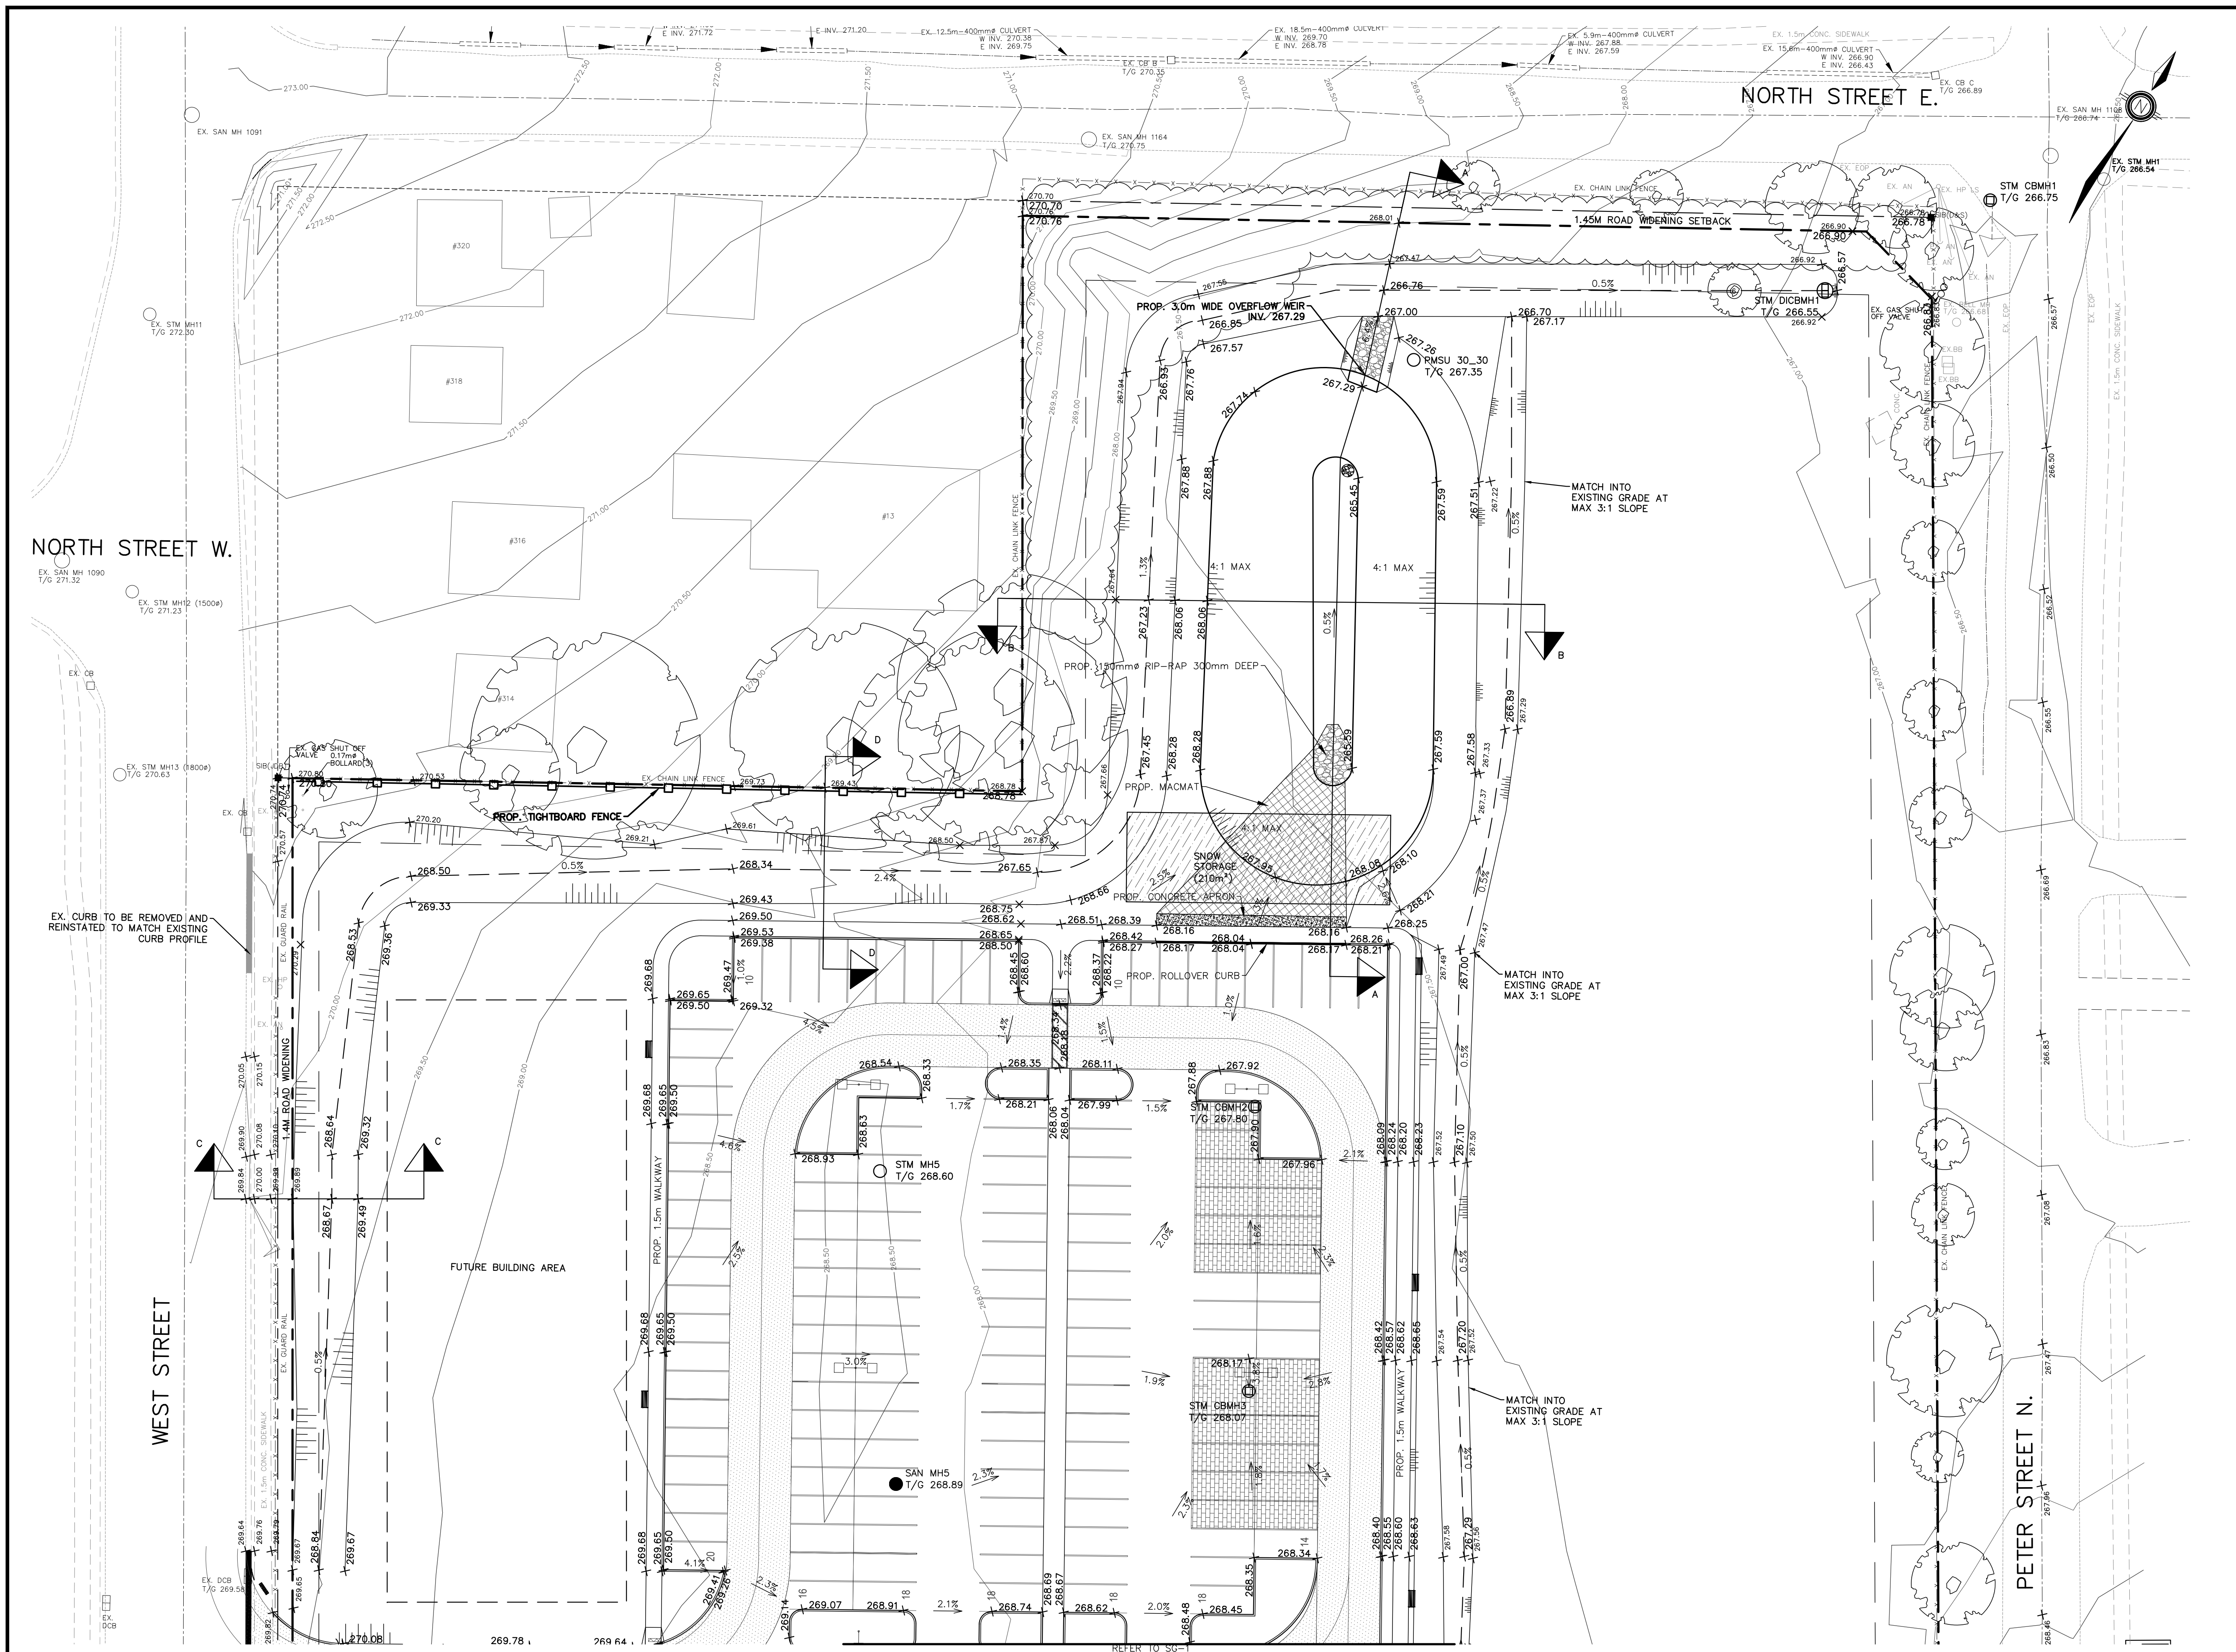

KEY MAP
NTS

LEGEND

- CB CATCH BASIN
- DCB DOUBLE CATCH BASIN
- CBMH CATCH BASIN
- MH STORM MANHOLE
- SMH SANITARY MANHOLE
- SERVICE CAP
- ◆ HYD. FIRE HYDRANT
- ◆ VB WATER VALVE
- CS CURB STOP W/ SERVICE
- × 254.63 PROPOSED ELEVATION
- 254.09 EXISTING ELEVATION
- 1.5% PROPOSED DIRECTION AND GRADE
- BACK OF CURB
- EDGE OF PAVEMENT
- CURB CUT LOCATION
- () HIGH POINT
- - - - EX. CHAINLINK FENCE
- EX. BELL BOX
- EX. TREE
- ▬ PROP. RETAINING WALL
- ▬ PROP. TIGHTBOARD FENCE
- PROP. LIGHT STANDARD
- ▬ PROP. PERMEABLE PAVERS AS PER ND-4
- ▬ PROP. HEAVY DUTY ASPHALT

NO.	REVISION NOTE	DATE	BY
1.	REVISED AS PER CITY ORILLIA COMMENTS	01/26/21	AA

BENCHMARK			





COUNTY OF SIMCOE
AFFORDABLE HOUSING
ORILLIA, 2 BORLAND STREET EAST

SITE GRADING PLAN
3 OF 3


PEARSON ENGINEERING LTD.
PEARSONENG.COM PH. 705.719.4785

DESIGNED BY	AA	HORIZ SCALE	1:300	PROJECT #	20002
DRAWN BY	AA	VERT SCALE		DRAWING #	SG-3
CHECKED BY	MWD	DATE	NOVEMBER 2020	REVISION #	1

P:\Projects\2020\202002 - MCL 2 Borland St. E., Orillia\Working Folders\20002 - BASE.dwg Layout:SS-1 Plotted Jan 29, 2021 @ 3:31pm by aelilo @ PEARSON ENGINEERING LTD.

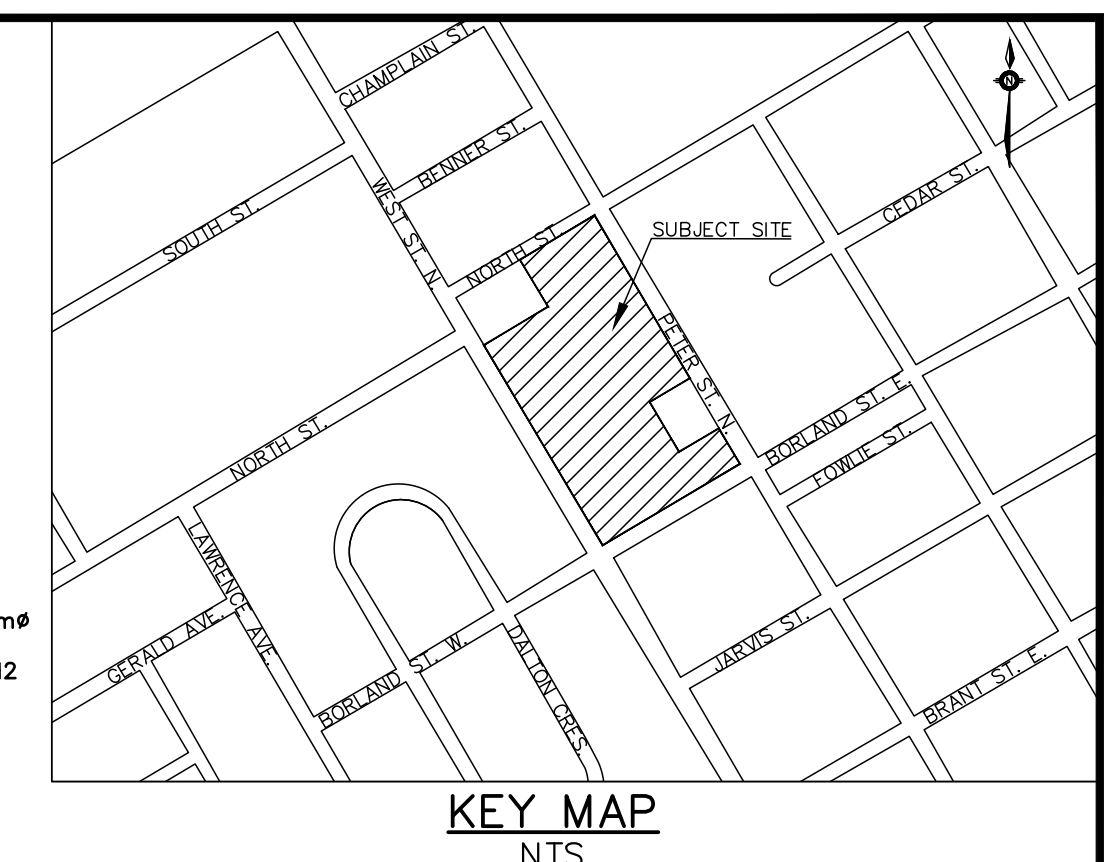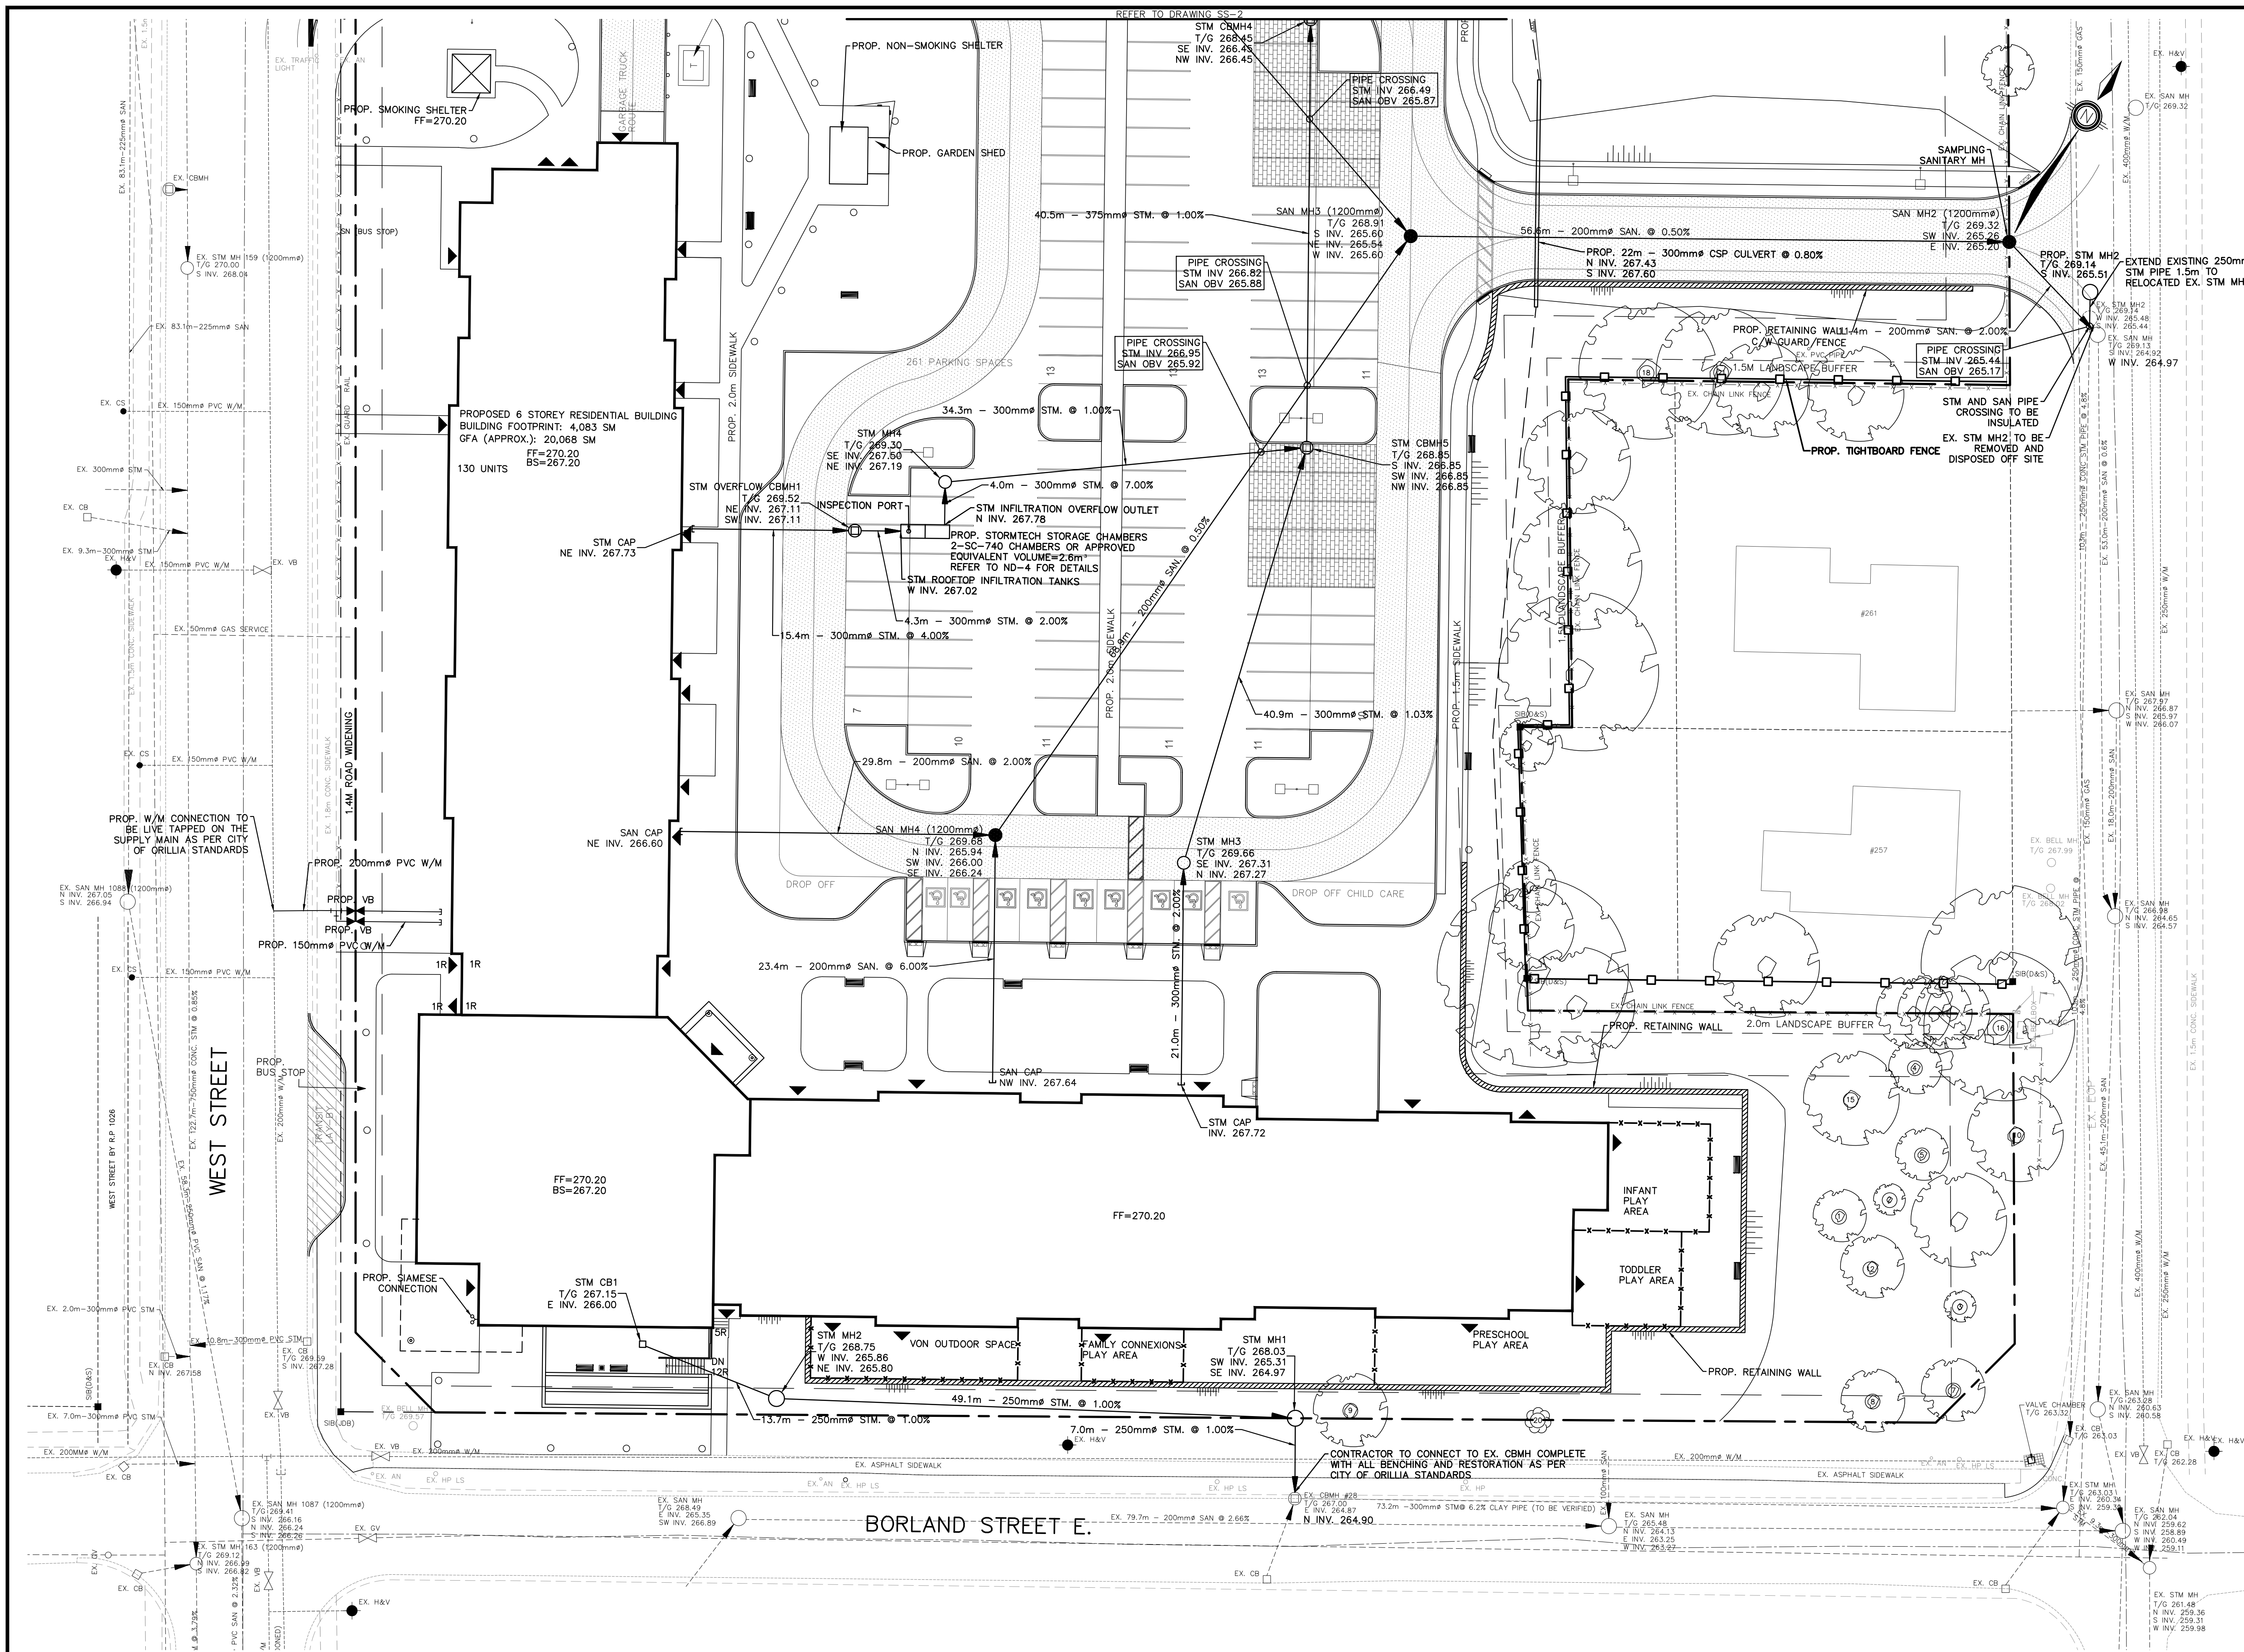


- LEGEND**
- CB CATCH BASIN
 - DCB DOUBLE CATCH BASIN
 - CBM# CATCH BASIN
 - MH STORM MANHOLE
 - MH SANITARY MANHOLE
 - SERVICE CAP
 - ◆ HYD. FIRE HYDRANT
 - ◆ VB WATER VALVE
 - CS CURB STOP W/ SERVICE
 - × 254.63 PROPOSED ELEVATION
 - 254.09 EXISTING ELEVATION
 - 1.5% PROPOSED DIRECTION AND GRADE
 - BACK OF CURB
 - EDGE OF PAVEMENT
 - CURB CUT LOCATION
 - () HIGH POINT
 - - - - - EX. CHAINLINK FENCE
 - EX. BELL BOX
 - EX. TREE
 - PROP. RETAINING WALL
 - PROP. TIGHTBOARD FENCE
 - PROP. LIGHT STANDARD
 - ▨ PROP. PERMEABLE PAVERS AS PER ND-4
 - ▨ PROP. HEAVY DUTY ASPHALT

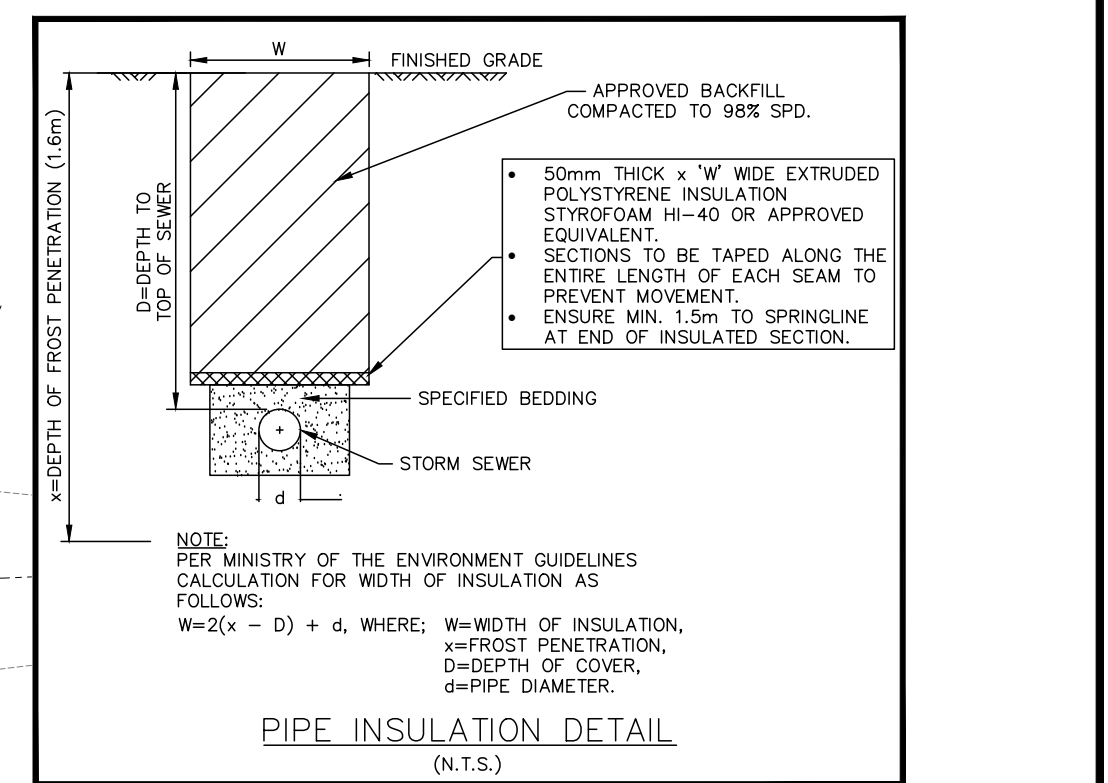

NO.	REVISION NOTE	DATE	BY
1.	REVISED AS PER CITY OF ORILLIA COMMENTS	01/26/21	AA

BENCHMARK			

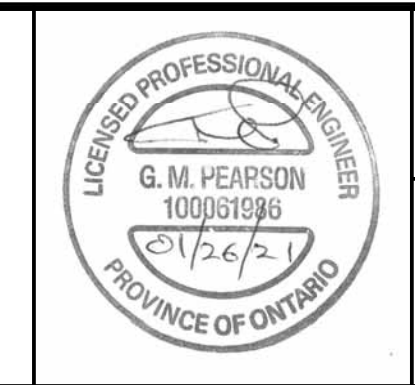



COUNTY OF SIMCOE
AFFORDABLE HOUSING
ORILLIA, 2 BORLAND STREET EAST

SITE SERVICING PLAN
1 OF 3

PEARSON ENGINEERING LTD.
PEARSONENG.COM PH. 705.719.4785

DESIGNED BY	AA	HORIZ SCALE	1:300	PROJECT #	20002
DRAWN BY	AA	VERT SCALE		DRAWING #	SS-1
CHECKED BY	MWD	DATE	NOVEMBER 2020	REVISION #	1


P:\Projects\Working_Folders\20002 - MCL_2 Borland St. E., Orillia\Engineering\20002 - BASE.dwg Layout:SS-2 Plotted Jan 29, 2021 @ 3:31pm by cadellio @ PEARSON ENGINEERING LTD.

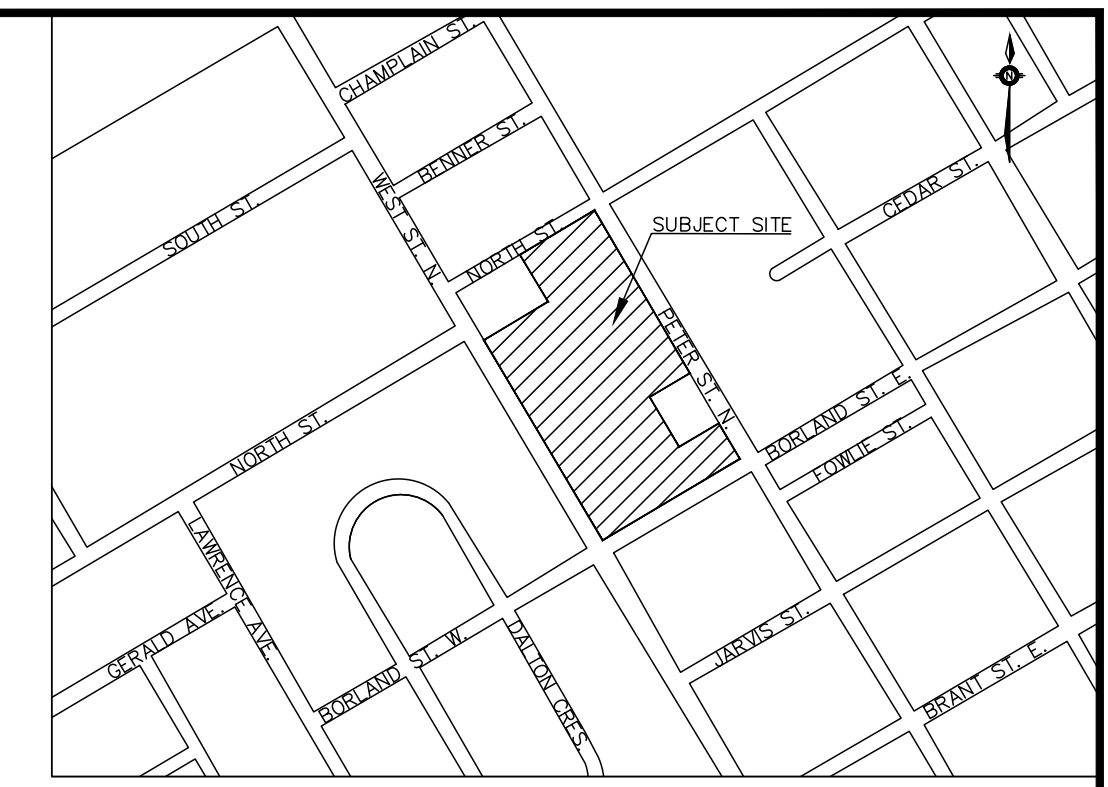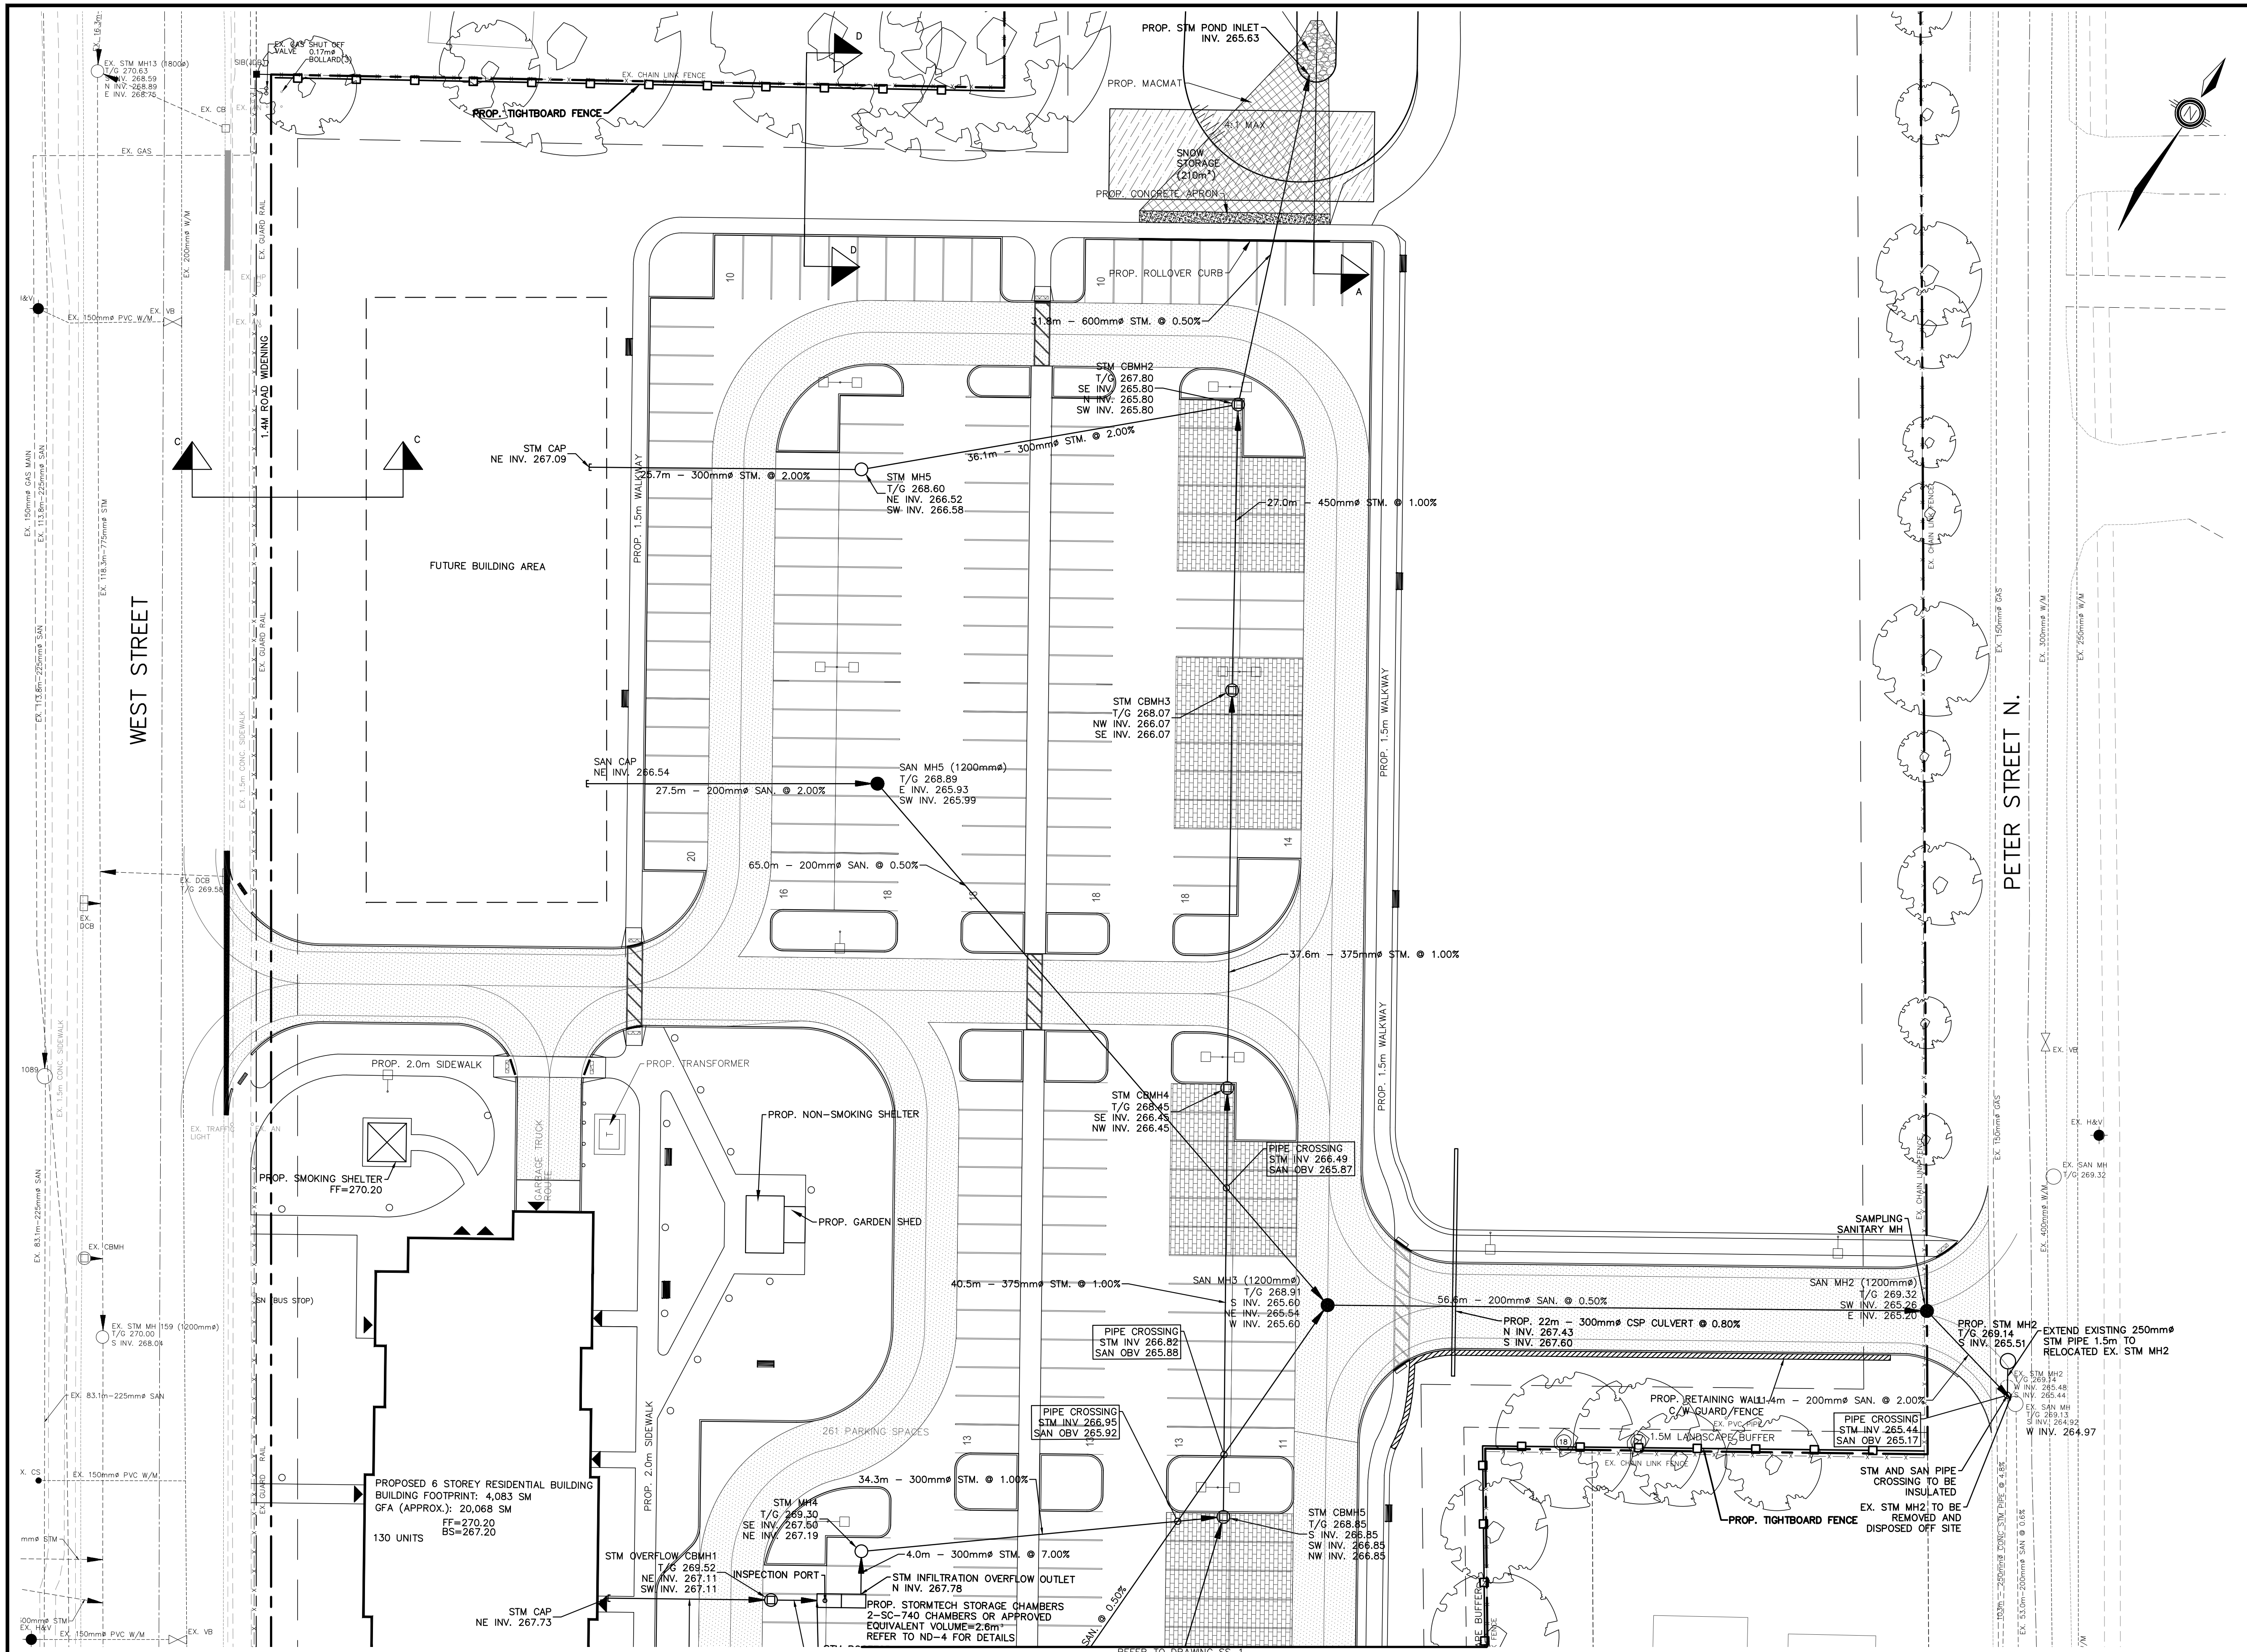

KEY MAP
NTS

LEGEND

- CB CATCH BASIN
- DCB DOUBLE CATCH BASIN
- CBMH CATCH BASIN
- MH STORM MANHOLE
- SMH SANITARY MANHOLE
- SERVICE CAP
- ◆ HYD. FIRE HYDRANT
- ▲ VB WATER VALVE
- CS CURB STOP
- W/ SERVICE
- × 254.63 PROPOSED ELEVATION
- 254.09 EXISTING ELEVATION
- 1.5% PROPOSED DIRECTION AND GRADE
- BACK OF CURB
- EDGE OF PAVEMENT
- CURB CUT LOCATION
-) (HIGH POINT
- - - EX. CHAINLINK FENCE
- EX. BELL BOX
- EX. TREE
- PROP. TIGHTBOARD FENCE
- PROP. LIGHT STANDARD
- ▨ PROP. PERMEABLE PAVERS AS PER ND-4
- ▨ PROP. HEAVY DUTY ASPHALT

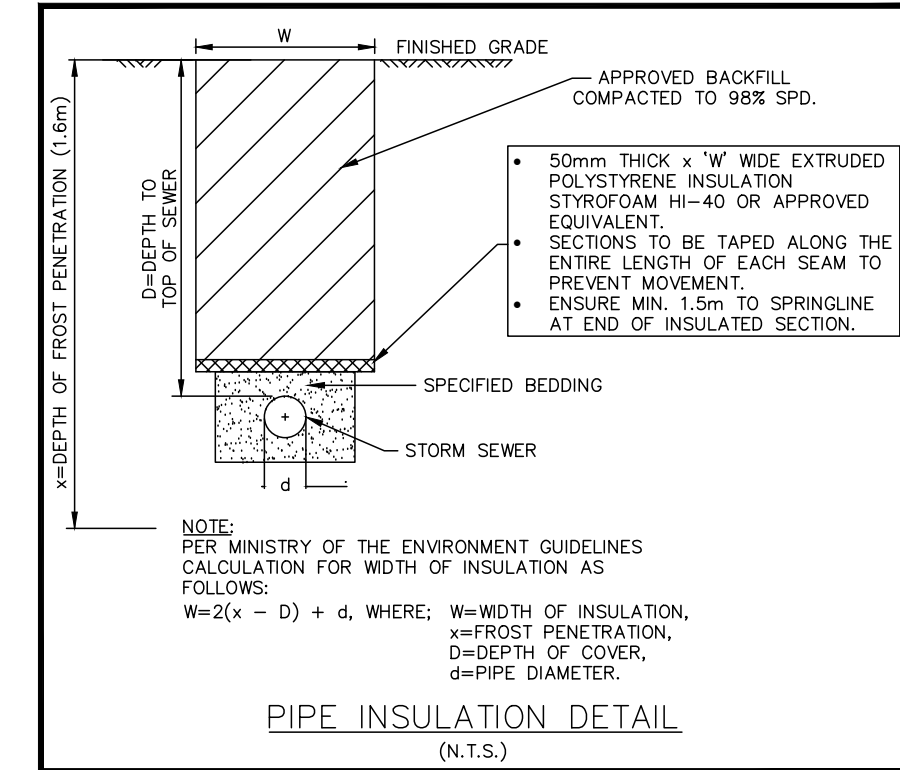

DESIGNED BY	AA	HORIZ SCALE	1:300	PROJECT #	20002
DRAWN BY	AA	VERT SCALE		DRAWING #	SS-2
CHECKED BY	MWD	DATE	NOVEMBER 2020	REVISION #	1


COUNTY OF SIMCOE
AFFORDABLE HOUSING
ORILLIA, 2 BORLAND STREET EAST

SITE SERVICING PLAN
2 OF 3



NO.	REVISION NOTE	DATE	BY
1.	REVISED AS PER CITY ORILLIA COMMENTS	01/26/21	AA

BENCHMARK

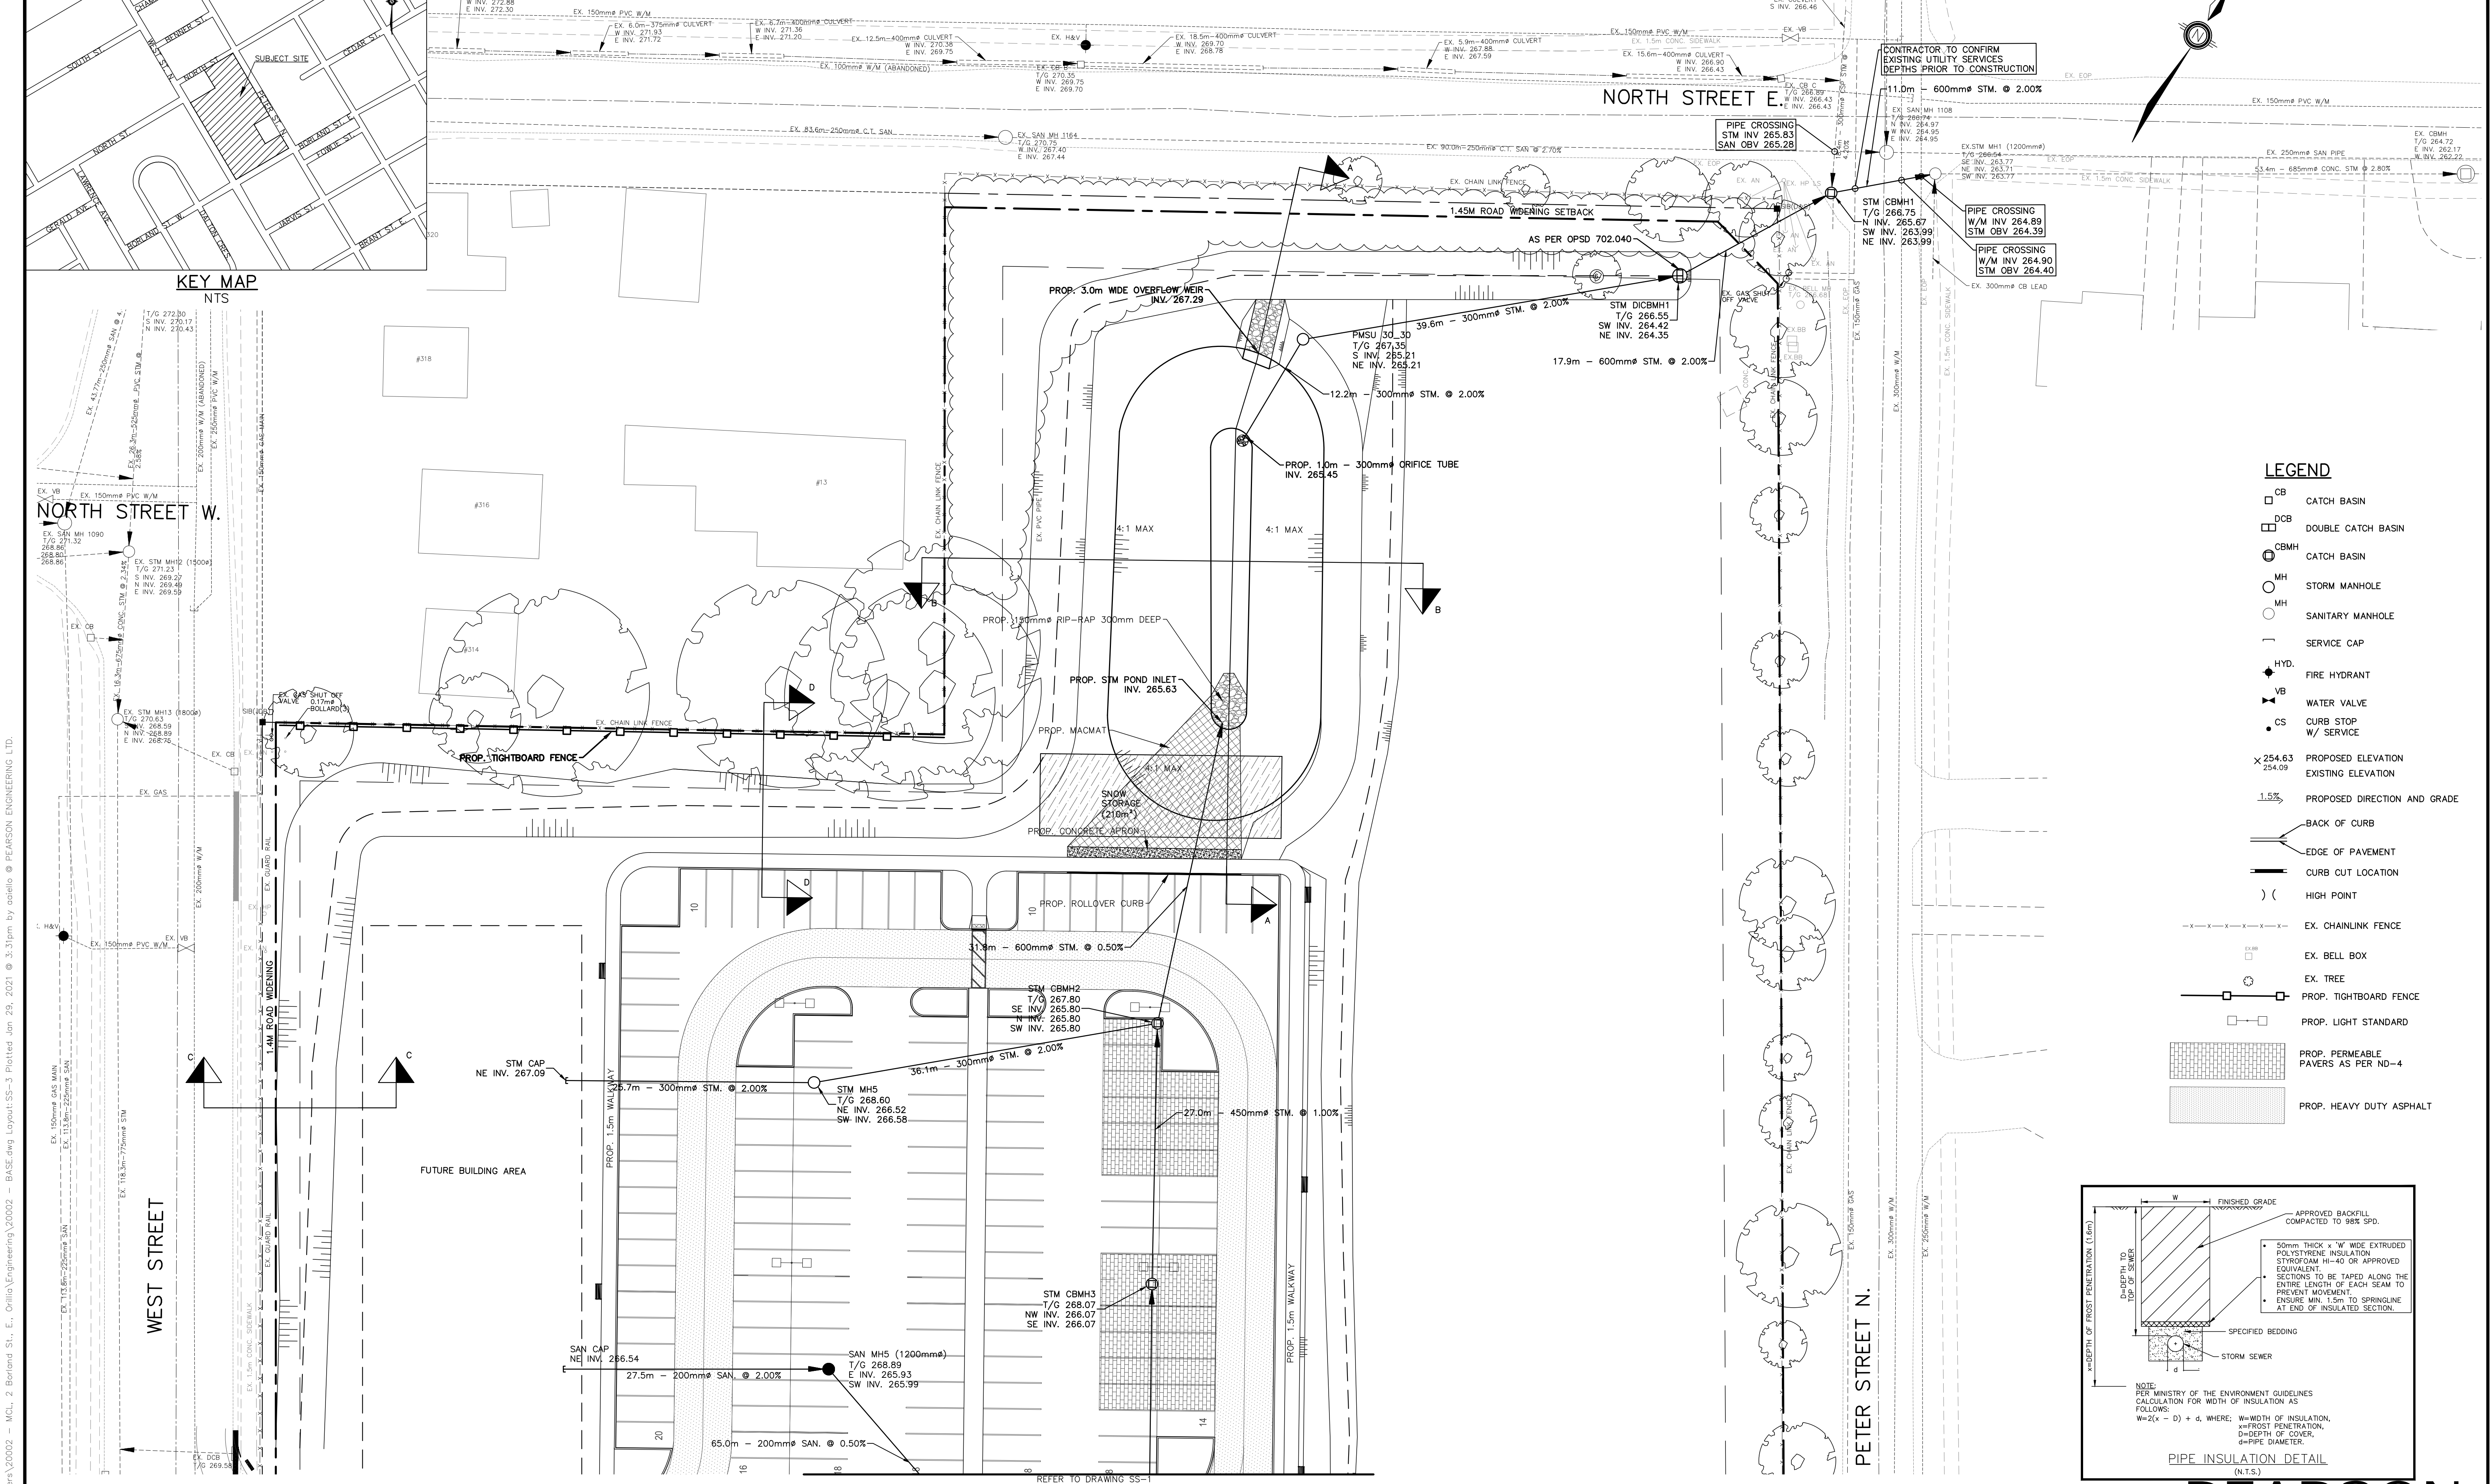

KEY MAP
NTS


NORTH STREET W.
NTS

WEST STREET

NORTH STREET E

PETER STREET N.

- LEGEND**
- CB CATCH BASIN
 - DCB DOUBLE CATCH BASIN
 - CBMH CATCH BASIN
 - MH STORM MANHOLE
 - MH SANITARY MANHOLE
 - SERVICE CAP
 - ◆ HYD. FIRE HYDRANT
 - ▲ VB WATER VALVE
 - CS CURB STOP W/ SERVICE
 - × 254.63 PROPOSED ELEVATION
 - 254.09 EXISTING ELEVATION
 - 1.5% PROPOSED DIRECTION AND GRADE
 - BACK OF CURB
 - EDGE OF PAVEMENT
 - CURB CUT LOCATION
 -) (HIGH POINT
 - - - - EX. CHAINLINK FENCE
 - EX. BELL BOX
 - EX. TREE
 - PROP. TIGHTBOARD FENCE
 - PROP. LIGHT STANDARD
 - ▨ PROP. PERMEABLE PAVERS AS PER ND-4
 - ▨ PROP. HEAVY DUTY ASPHALT

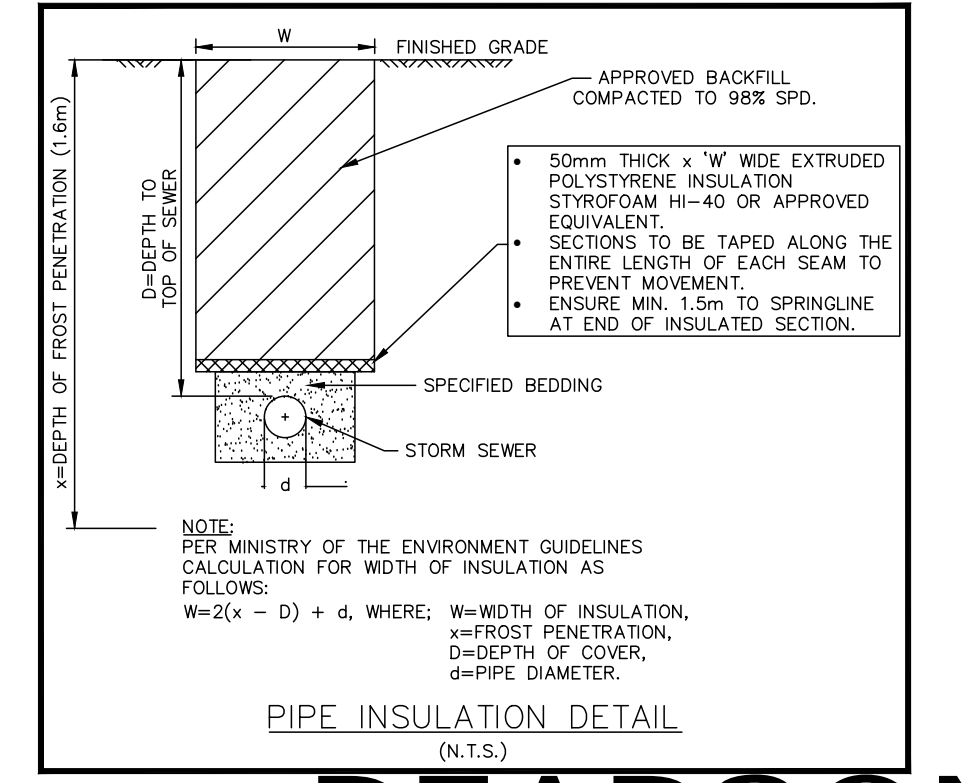

NO.	REVISION NOTE	DATE	BY
1.	REVISED AS PER CITY ORILLIA COMMENTS	01/26/21	AA

BENCHMARK			



COUNTY OF SIMCOE
AFFORDABLE HOUSING
ORILLIA, 2 BORLAND STREET EAST



SITE SERVICING PLAN
3 OF 3

PEARSON ENGINEERING LTD.
PEARSONENG.COM PH. 705.719.4785

DESIGNED BY	AA	HORIZ SCALE	1:300	PROJECT #	20002
DRAWN BY	AA	VERT SCALE		DRAWING #	SS-3
CHECKED BY	MWD	DATE	NOVEMBER 2020	REVISION #	1

P:\AutoCAD\Working Folders\20002 - MCL 2 Borland St. E., Orillia\Engineering\20002 - BASE.dwg Layout:SS-3 Plotted Jan 29, 2021 @ 3:31pm by cadellio @ PEARSON ENGINEERING LTD.

P:\Projects\2020\202002 - MCL - 2 Borland St. E., Orillia\Engineering\202002 - BASE.dwg Layout:STM-1 Plotted Jan 29, 2021 @ 3:31pm by antelli @ PEARSON ENGINEERING LTD.

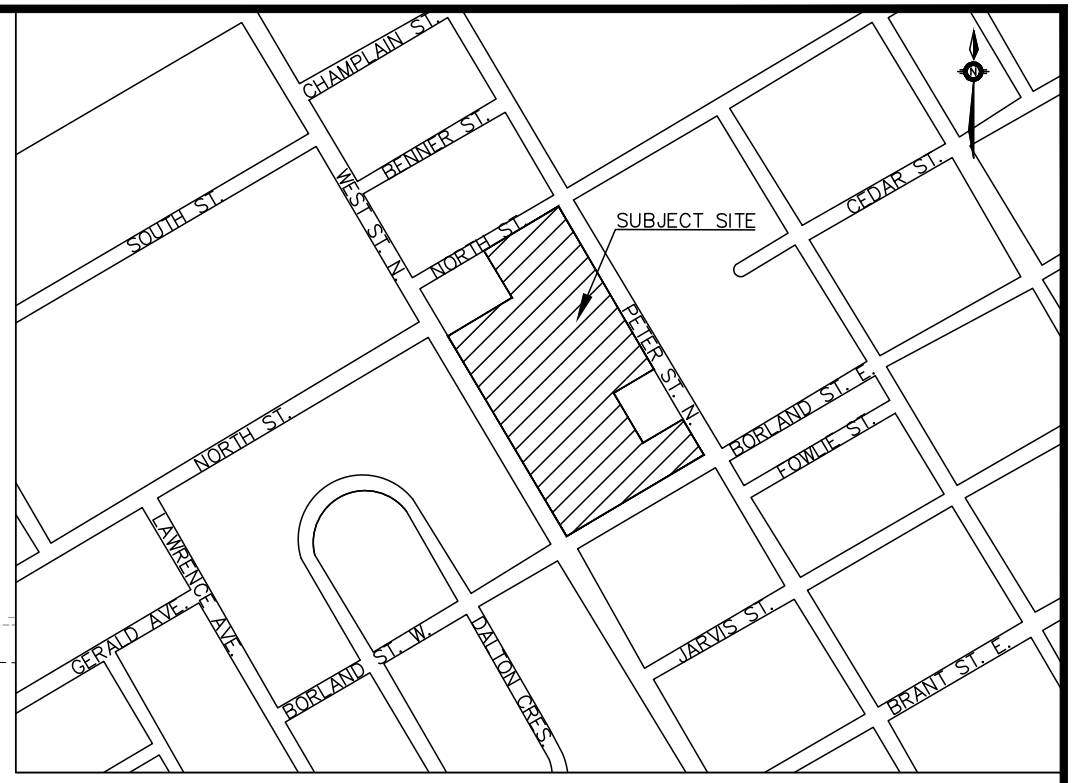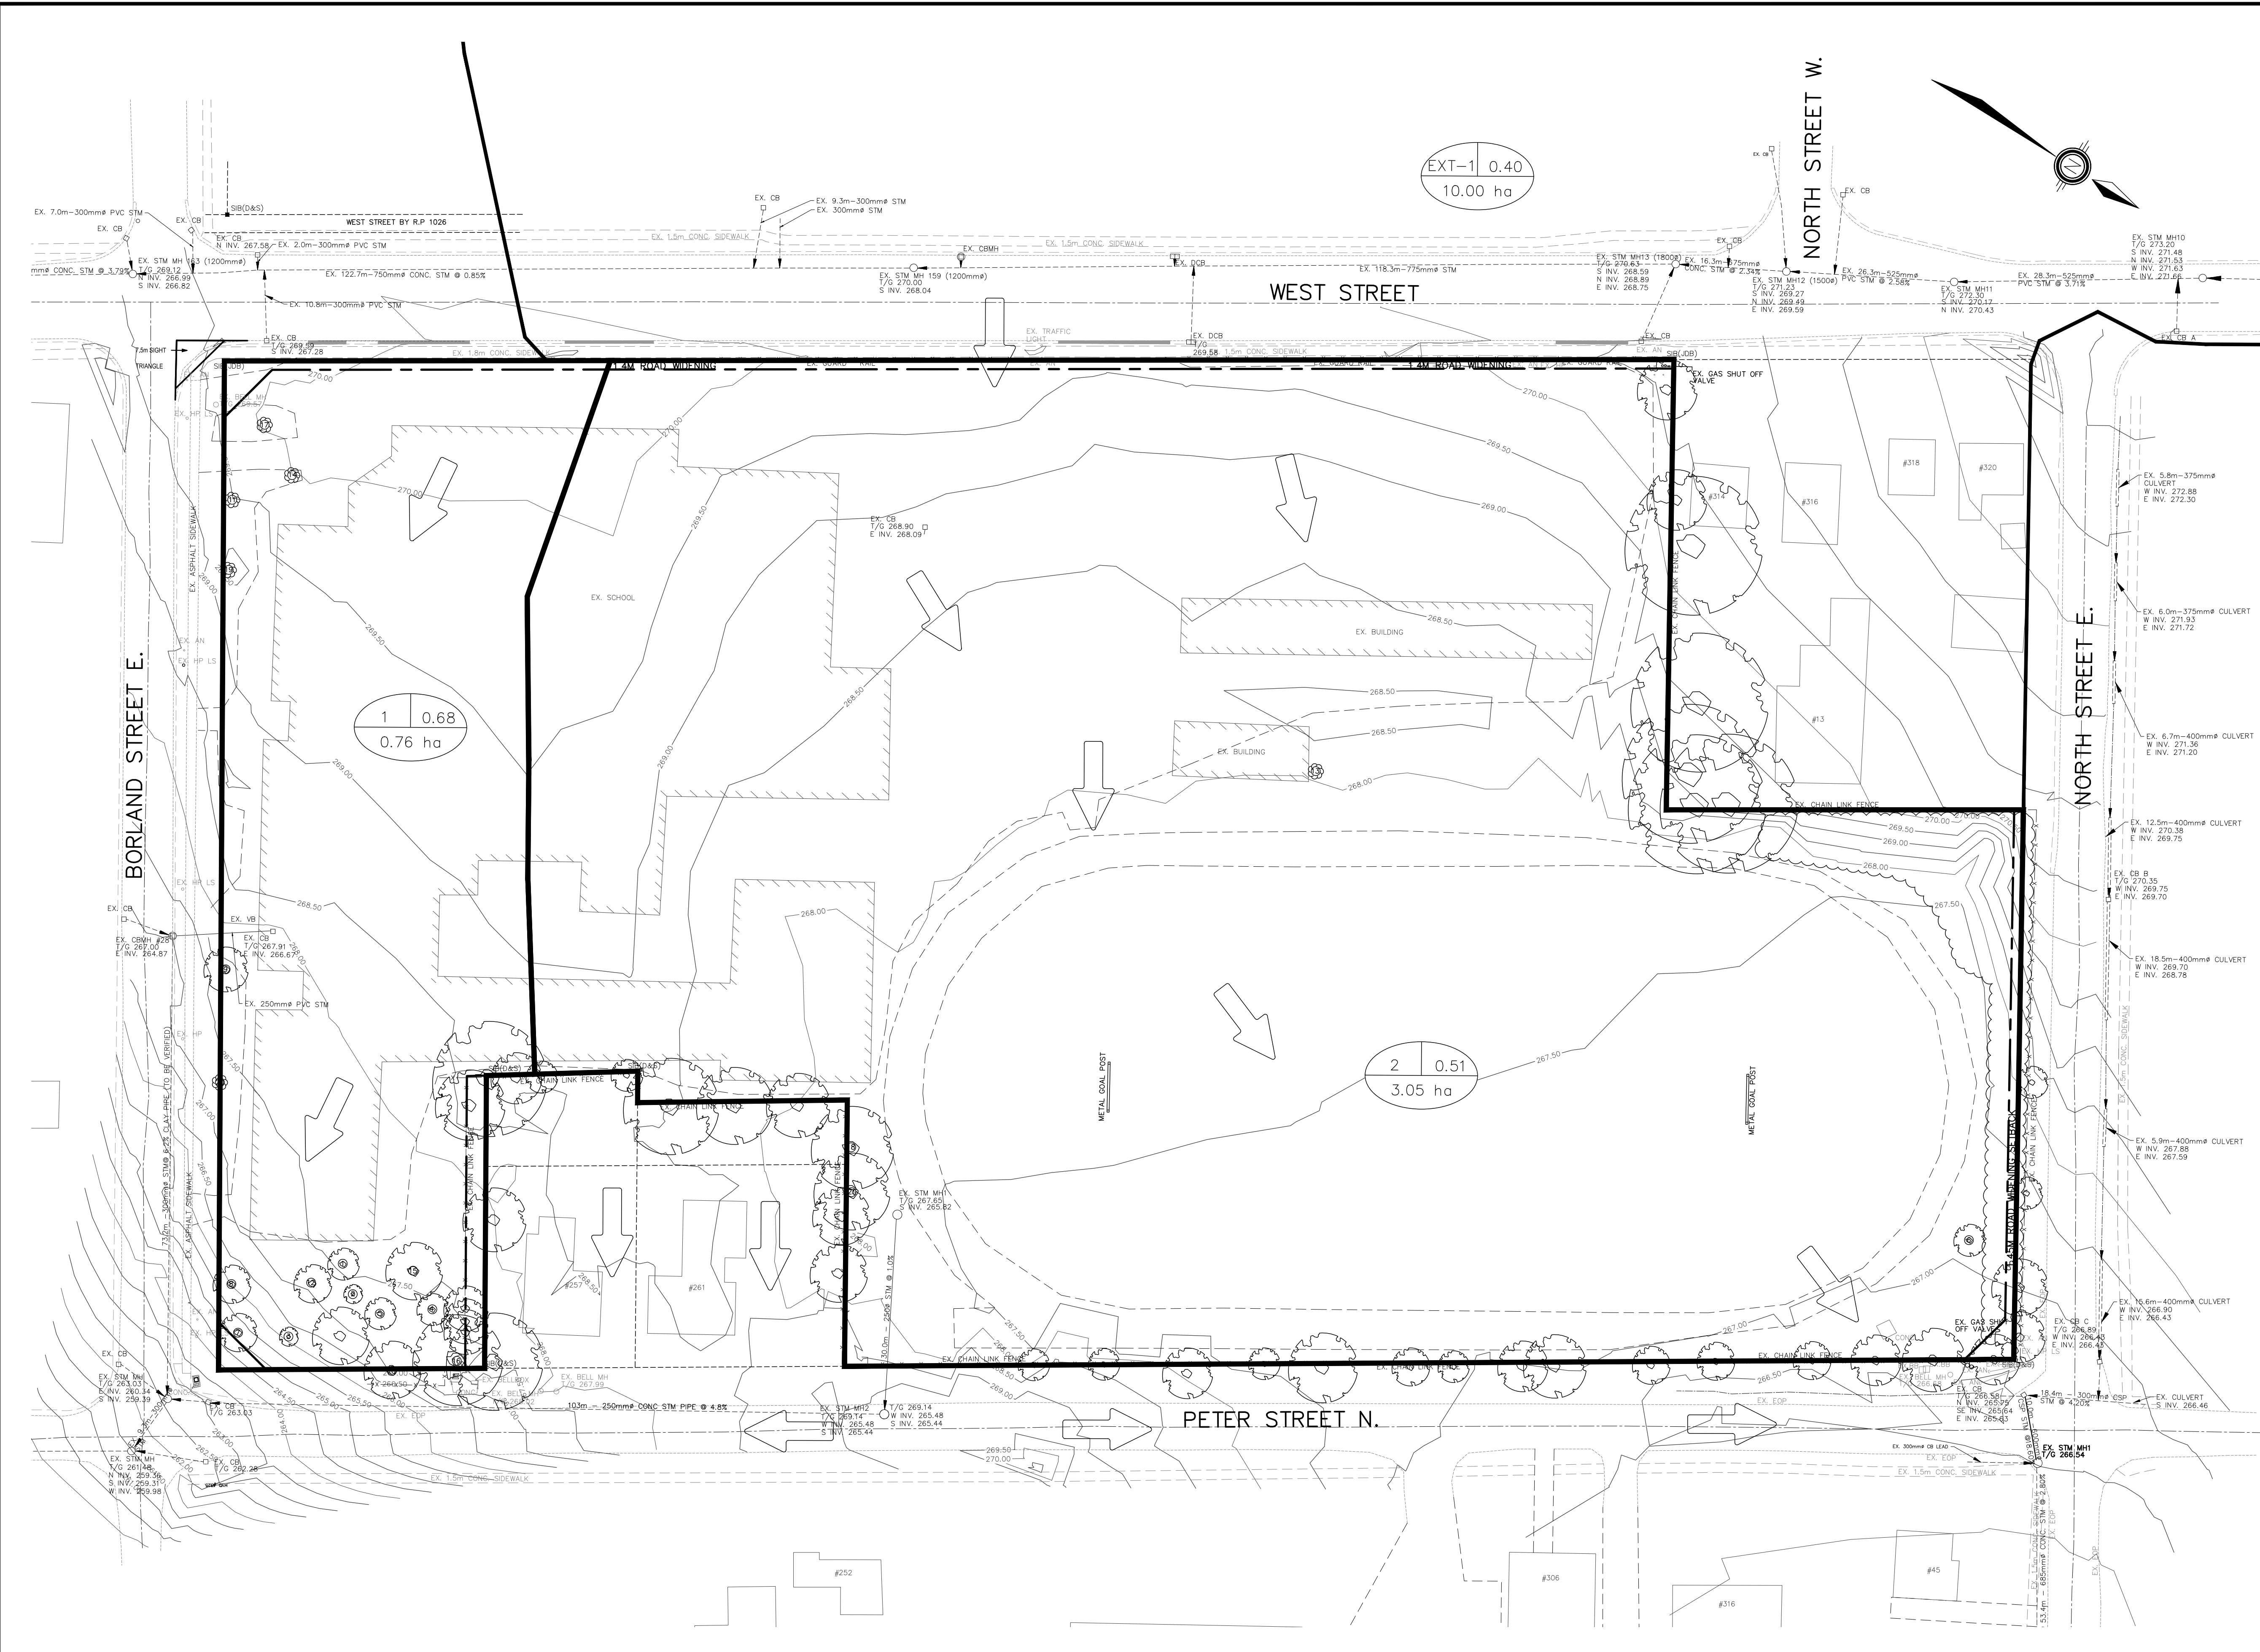

KEY MAP
NTS

LEGEND

- CB CATCH BASIN
- DCB DOUBLE CATCH BASIN
- CBMH CATCH BASIN
- MH STORM MANHOLE
- ➔ OVERLAND FLOW DIRECTION
- CATCHMENT AREA $\frac{1}{1.00}$ RUNOFF COEFFICIENT
- AREA IN HECTARES
- CATCHMENT BOUNDARY
- - - - EX. CHAINLINK FENCE

NO.	REVISION NOTE	DATE	BY
1.	REVISED AS PER CITY ORILLIA COMMENTS	01/26/21	AA

BENCHMARK			






COUNTY OF SIMCOE
AFFORDABLE HOUSING
ORILLIA, 2 BORLAND STREET EAST

PRE-DEVELOPMENT STORM
CATCHMENT PLAN

PEARSON ENGINEERING LTD.
PEARSONENG.COM PH. 705.719.4785

DESIGNED BY	AA	HORIZ SCALE	1:500	PROJECT #	20002
DRAWN BY	AA	VERT SCALE		DRAWING #	STM-1
CHECKED BY	MWD	DATE	NOVEMBER 2020	REVISION #	1

P:\Projects\2020\202002 - MCL 2 Borland St. E., Orillia\Engineering\202002 - BASE.dwg Layout:STM-2 Plotted Jun 29, 2021 @ 3:37pm by cadiella @ PEARSON ENGINEERING LTD.

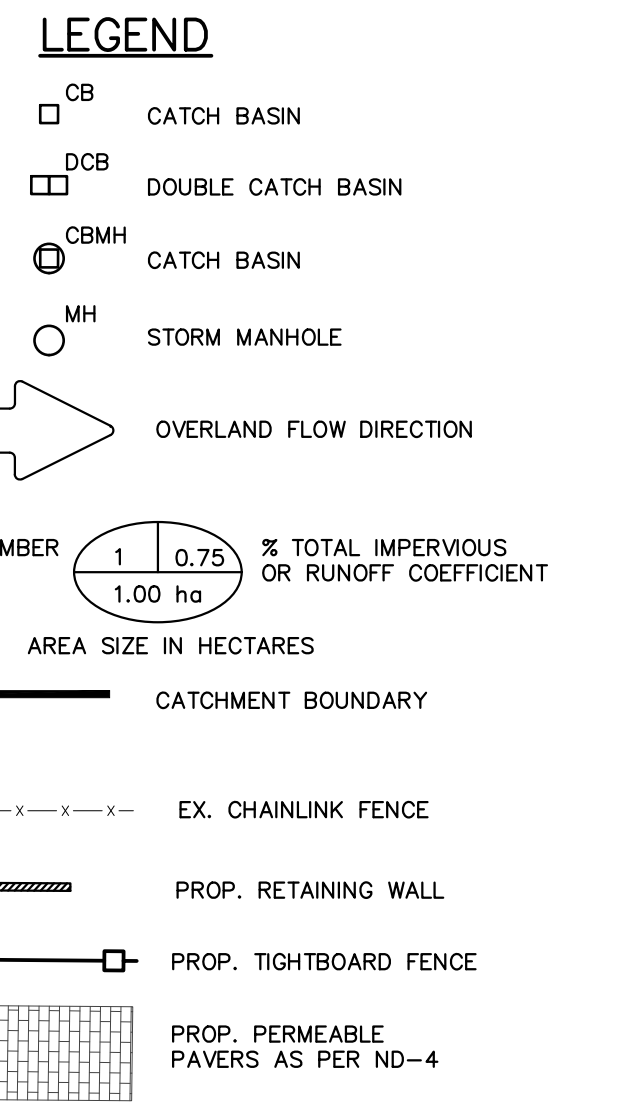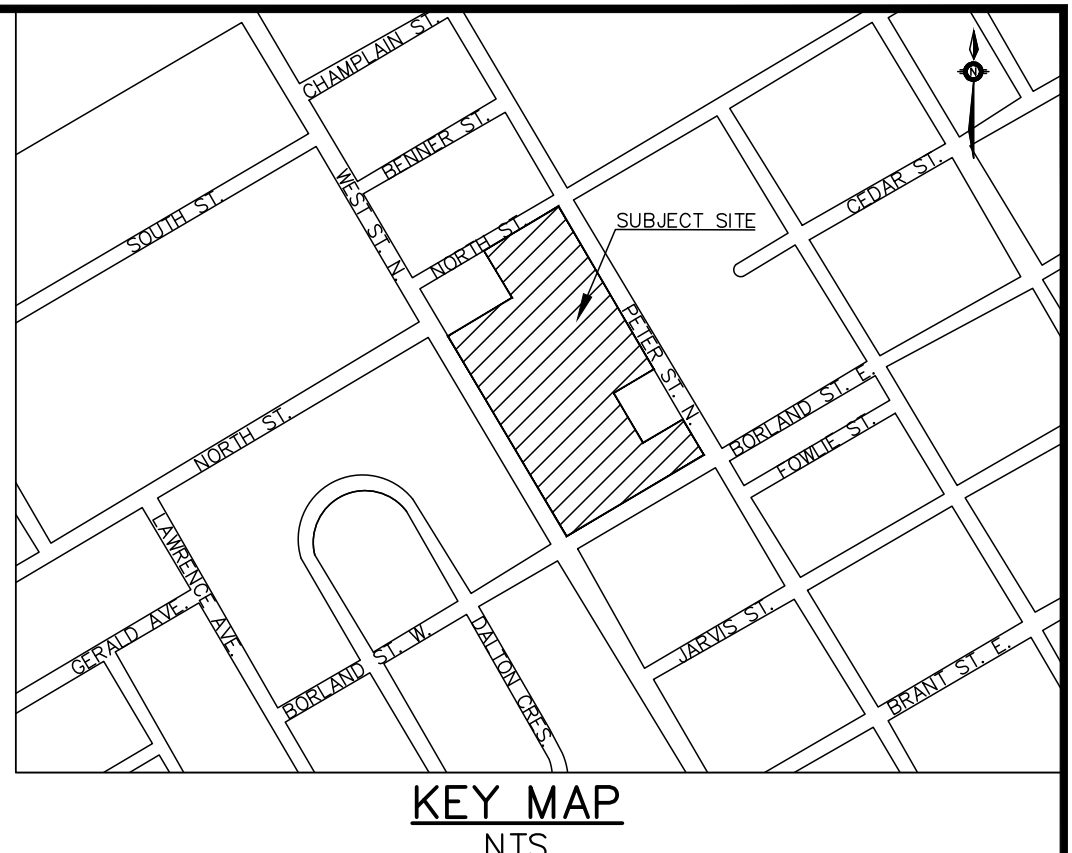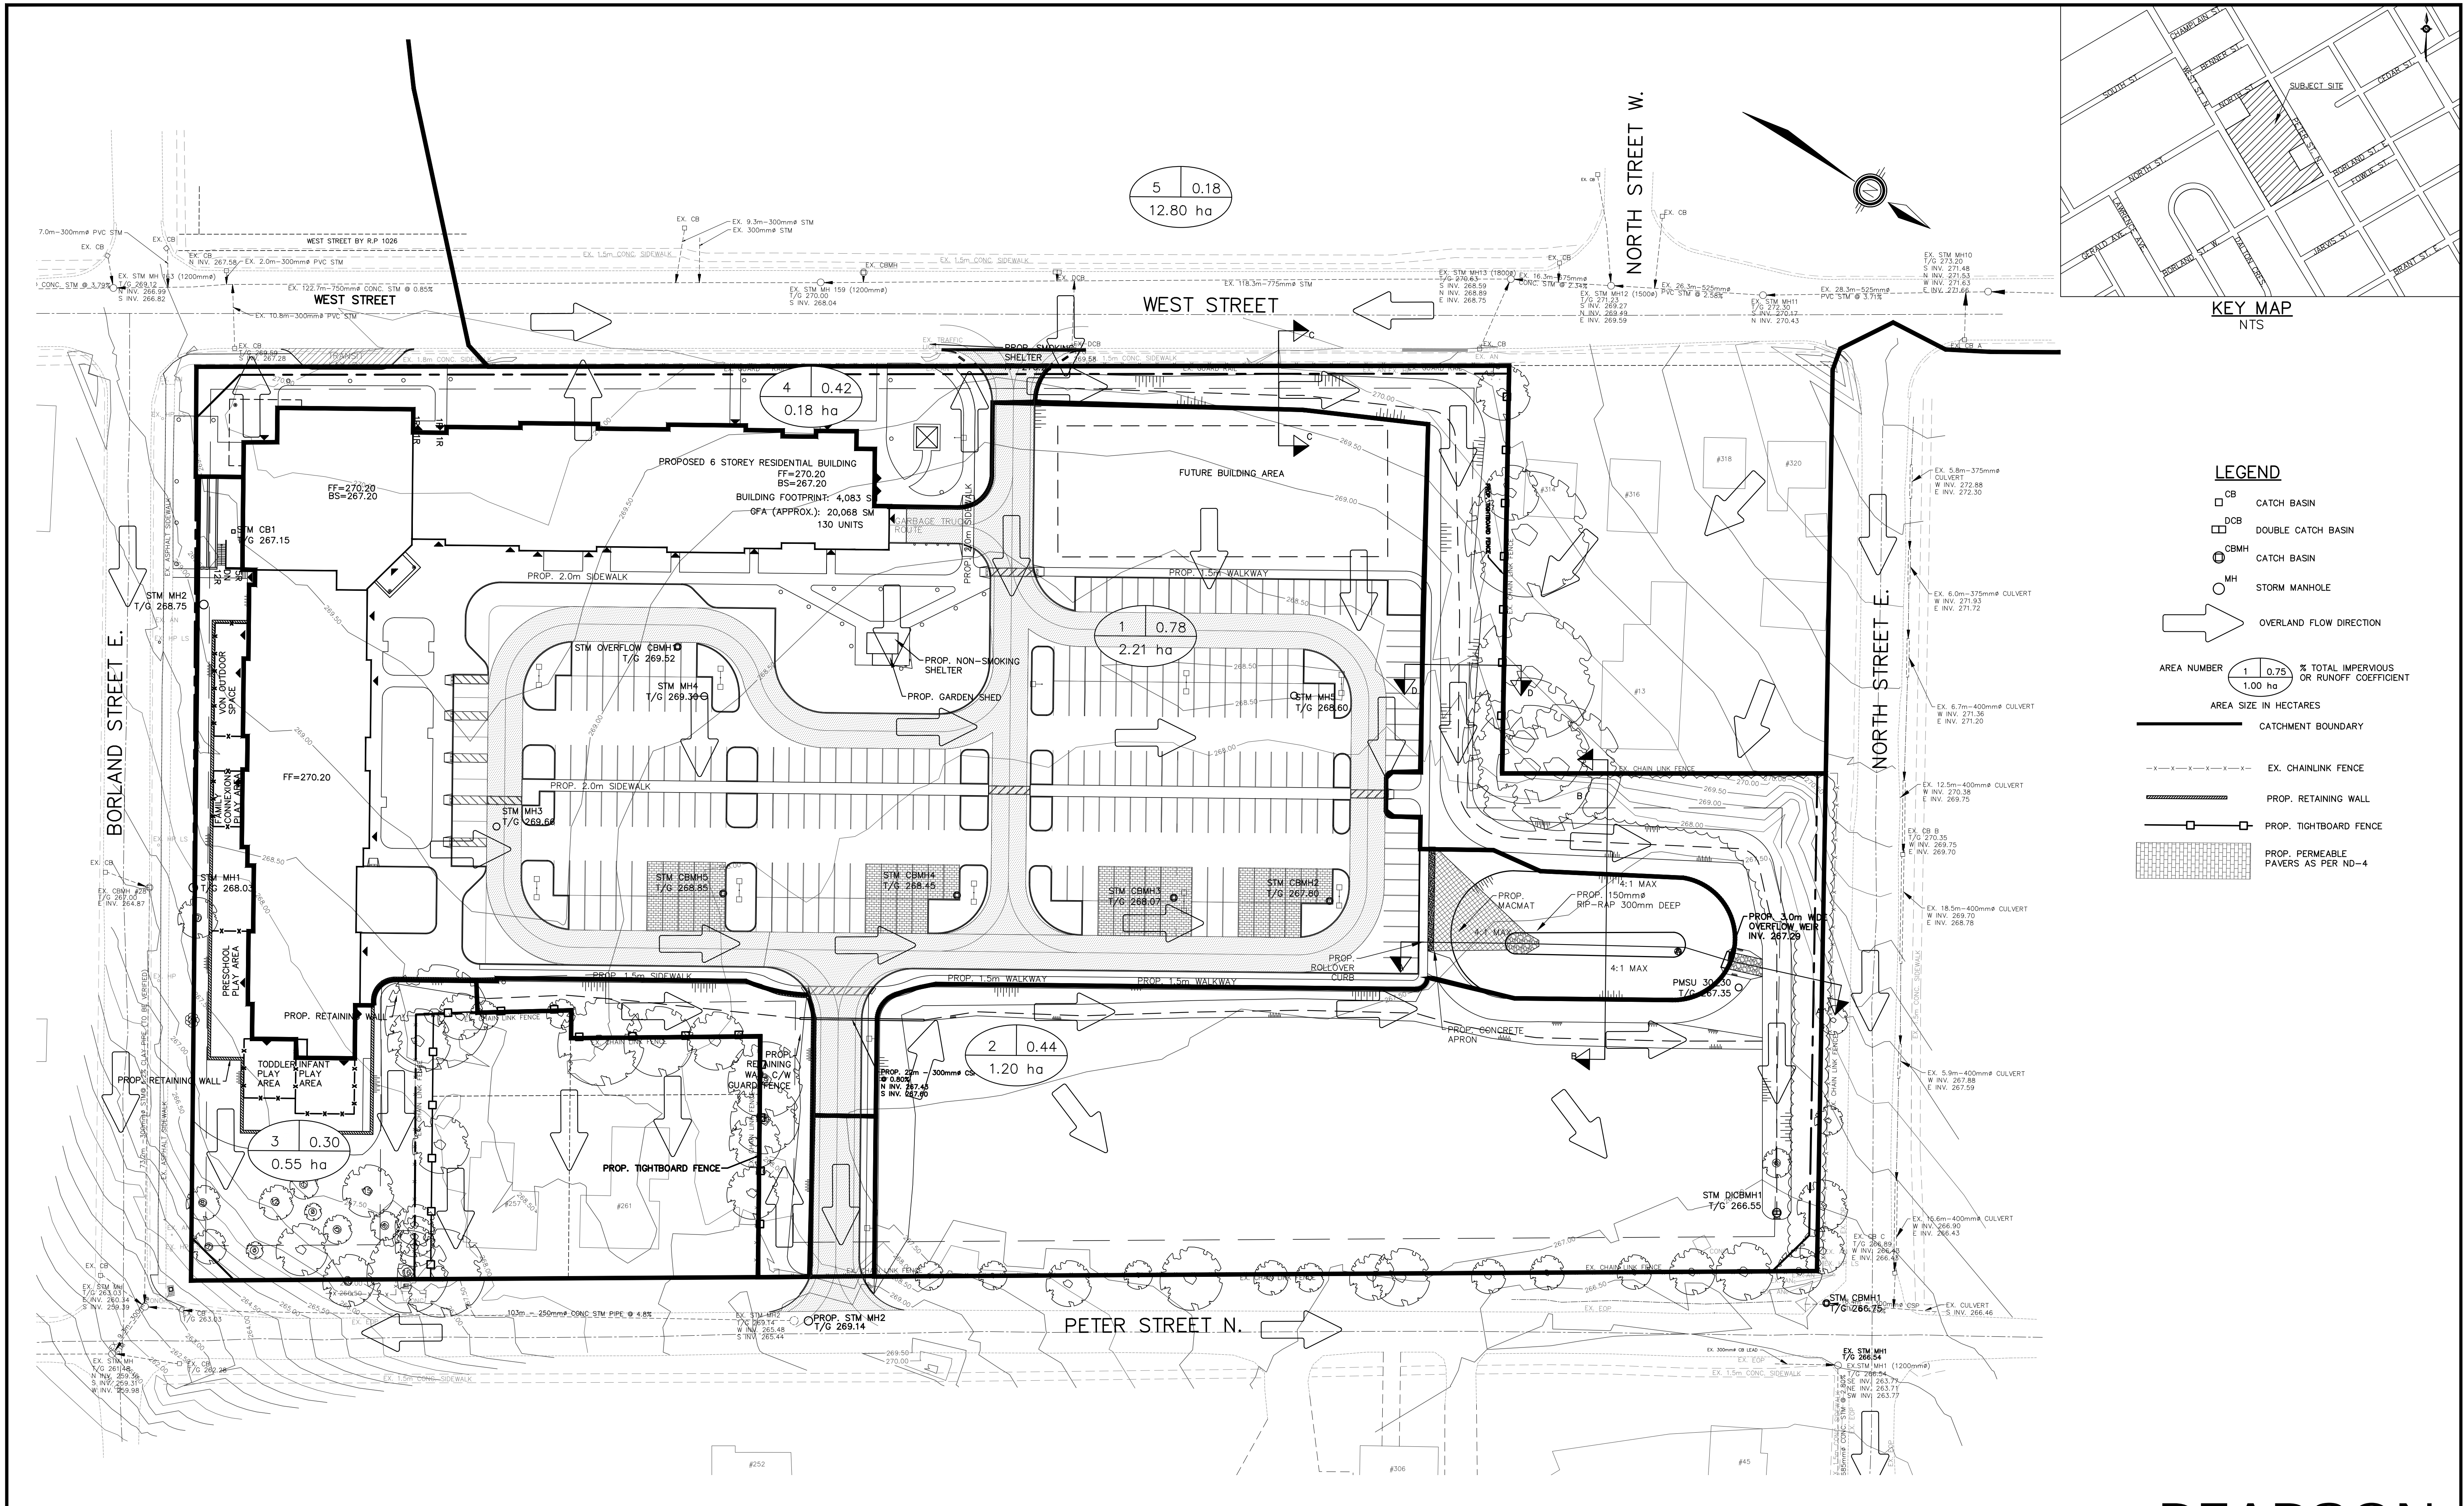

NO.	REVISION NOTE	DATE	BY
1.	REVISED AS PER CITY ORILLIA COMMENTS	01/26/21	AA

BENCHMARK




G.M. PEARSON
10003596
21/26/21
PROVINCE OF ONTARIO

COUNTY OF SIMCOE
AFFORDABLE HOUSING
ORILLIA, 2 BORLAND STREET EAST

POST-DEVELOPMENT STORM
CATCHMENT PLAN

PEARSON
ENGINEERING LTD.
PEARSONENG.COM PH. 705.719.4785

DESIGNED BY	AA	HORIZ SCALE	1:500	PROJECT #	20002
DRAWN BY	AA	VERT SCALE		DRAWING #	STM-2
CHECKED BY	MWD	DATE	NOVEMBER 2020	REVISION #	1

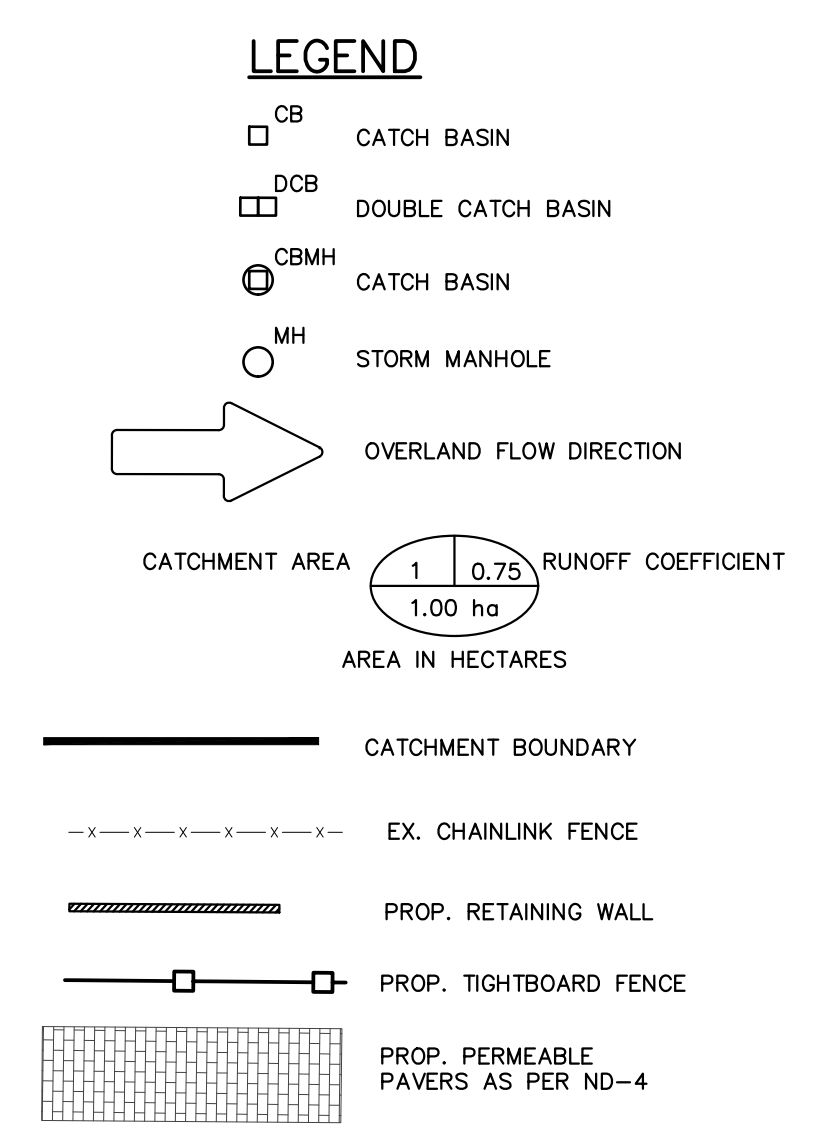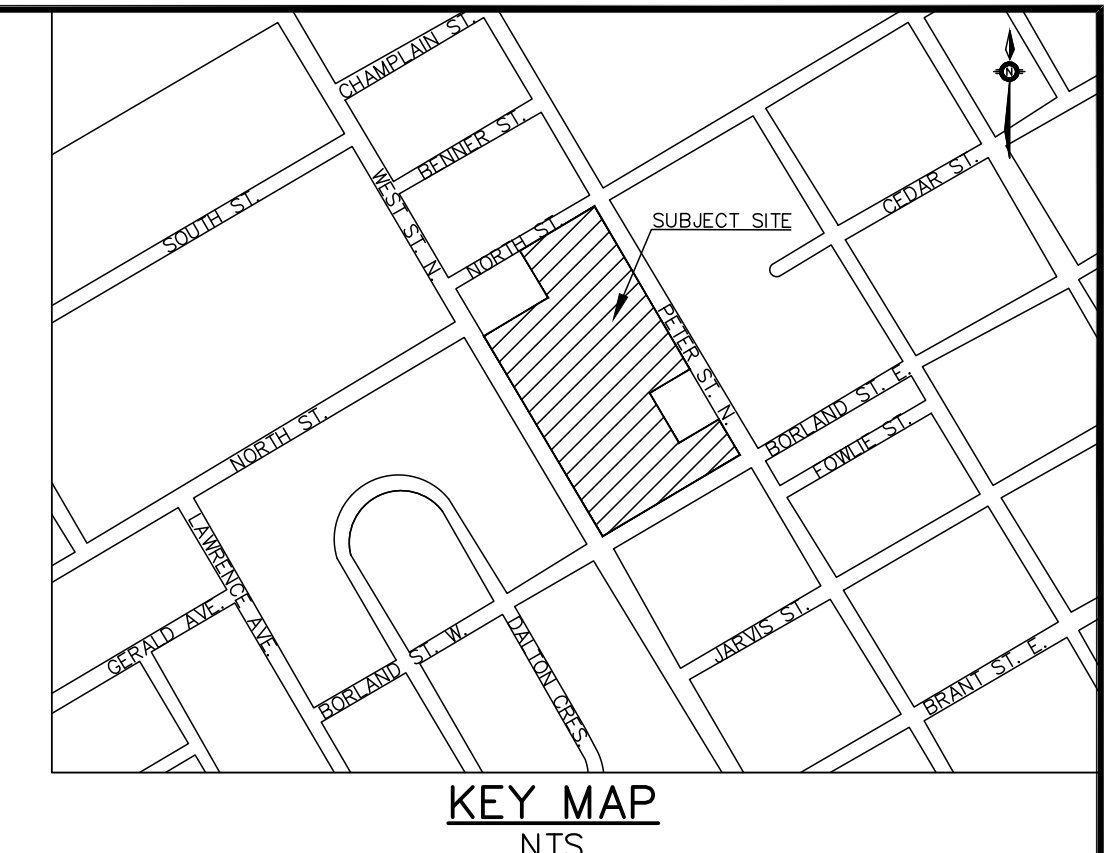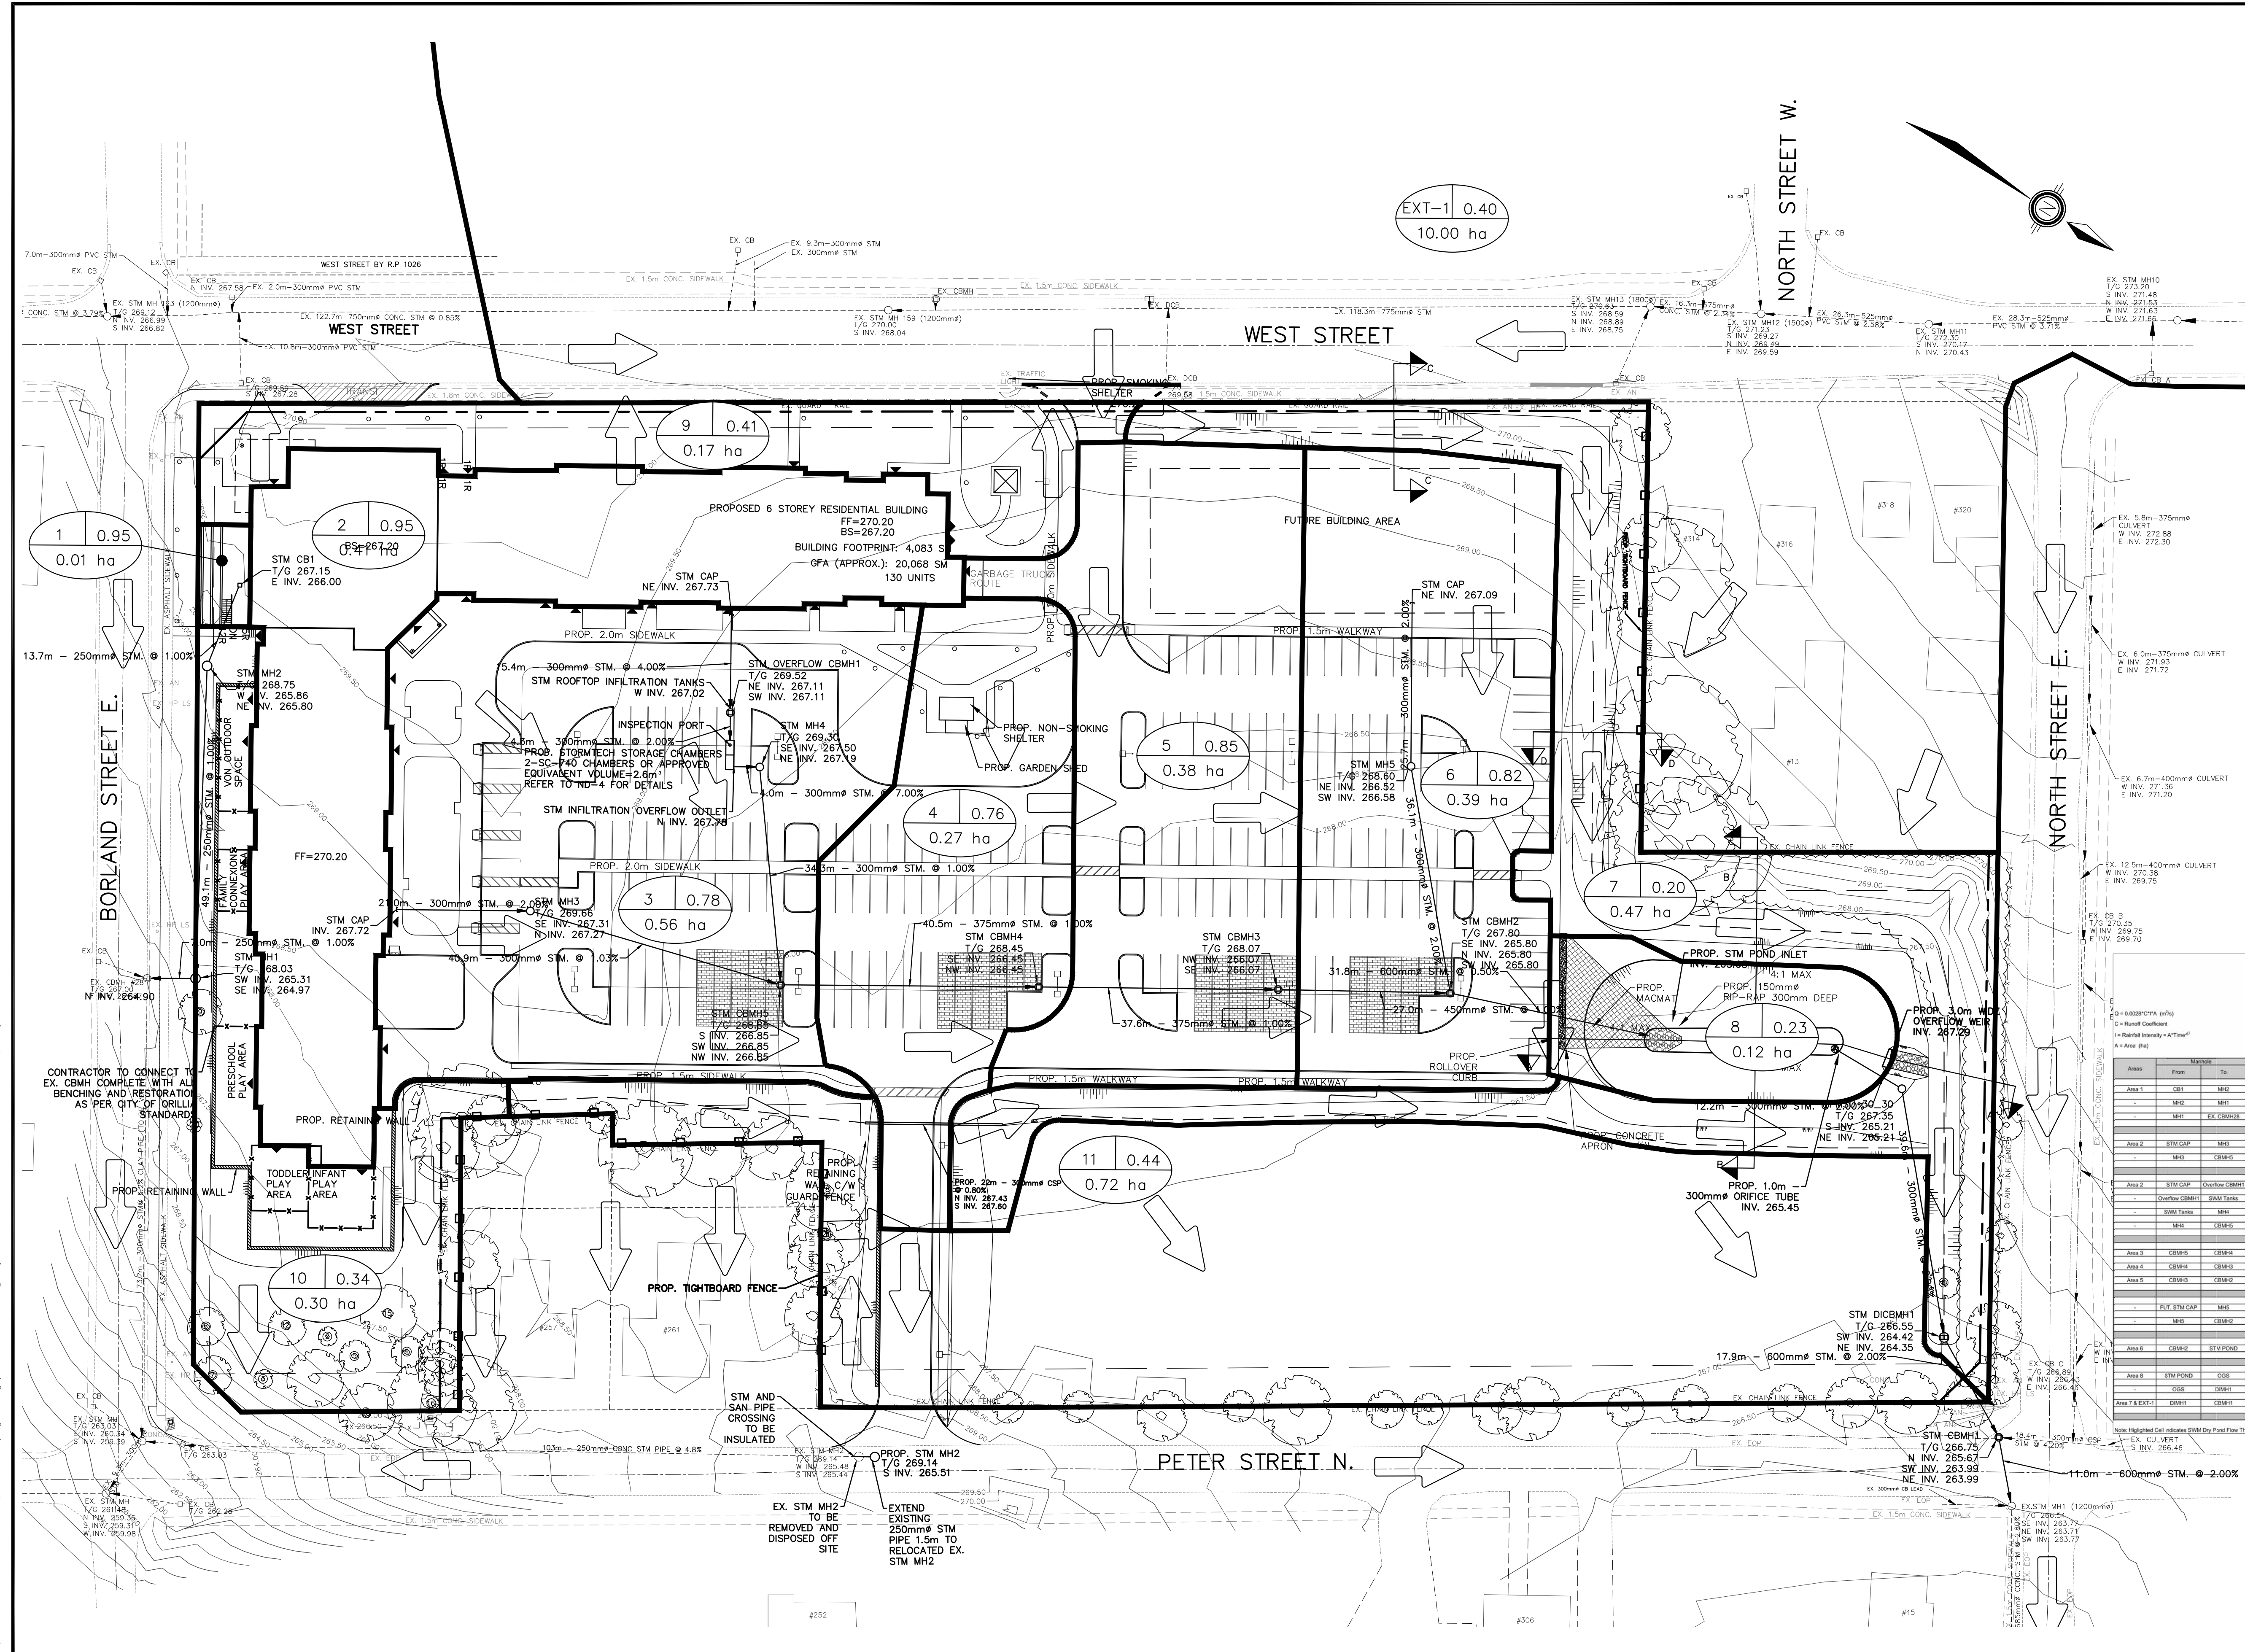

County of Simcoe Affordable Housing - Orillia
Storm Sewer Design
2-Year Storm Event

Area	From	To	Length (m)	Invert (m)	Flow (L/s)	Velocity (m/s)	Time (min)	Volume (m³)	Peak (L/s)	Time (min)	Volume (m³)
Area 1	CB1	MH2	13.1	0.95	0.01	0.01	0.01	0.01	0.01	0.01	0.01
	MH2	MH1	48.1	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	MH1	EX CBMH2	7.9	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Area 2	STM CAP	MH3	31.7	0.95	0.41	0.39	0.39	0.39	0.39	0.39	0.39
	MH3	STM CAP	46.0	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Area 3	STM CAP	Overflow CBMH1	15.4	0.95	0.41	0.39	0.39	0.39	0.39	0.39	0.39
	Overflow CBMH1	BM1 Taps	4.3	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Area 4	BM1 Taps	MH4	4.8	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	MH4	CBMH5	34.3	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Area 5	CBMH4	CBMH4	46.1	0.76	0.26	0.43	0.37	0.37	0.43	0.37	0.37
	CBMH4	CBMH3	37.2	0.76	0.27	0.20	0.20	0.20	0.20	0.20	0.20
Area 6	CBMH3	CBMH3	37.2	0.65	0.28	0.30	0.30	0.30	0.30	0.30	0.30
	CBMH3	STM CAP	25.7	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Area 7	STM CAP	MH5	25.7	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	MH5	CBMH2	36.1	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Area 8	CBMH2	STM POND	34.8	0.82	0.38	0.32	0.32	0.32	0.32	0.32	0.32
	STM POND	OSB	12.2	0.23	0.12	0.00	0.00	0.00	0.00	0.00	0.00
Area 9	OSB	CBMH1	38.2	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	CBMH1	CBMH1	17.2	0.39	0.28	0.19	0.20	0.20	0.20	0.20	0.20
Area 10	STM MH2	STM MH2	18.4	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	STM MH2	STM MH2	18.4	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
Area 11	STM MH2	STM MH2	18.4	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
	STM MH2	STM MH2	18.4	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00

P:\AutoCAD\Working\Folders\200002 - MCL 2 Borland St. E., Orillia\Engineering\200002 - BASE.dwg Layout:STM-3 Plotted Jan 29, 2021 @ 3:32pm by aelle @ PEARSON ENGINEERING LTD.

NO.	REVISION NOTE	DATE	BY
1.	REVISED AS PER CITY ORILLIA COMMENTS	01/26/21	AA

BENCHMARK

PROFESSIONAL ENGINEER
G.M. PEARSON
10032980
21/26/21
PROVINCE OF ONTARIO

COUNTY OF SIMCOE
AFFORDABLE HOUSING
ORILLIA, 2 BORLAND STREET EAST

STORM DRAINAGE AREA PLAN

PEARSON ENGINEERING LTD.
PEARSONENG.COM PH. 705.719.4785

DESIGNED BY	AA	HORIZ SCALE	1:500	PROJECT #	20002
DRAWN BY	AA	VERT SCALE		DRAWING #	STM-3
CHECKED BY	MWD	DATE	NOVEMBER 2020	REVISION #	1




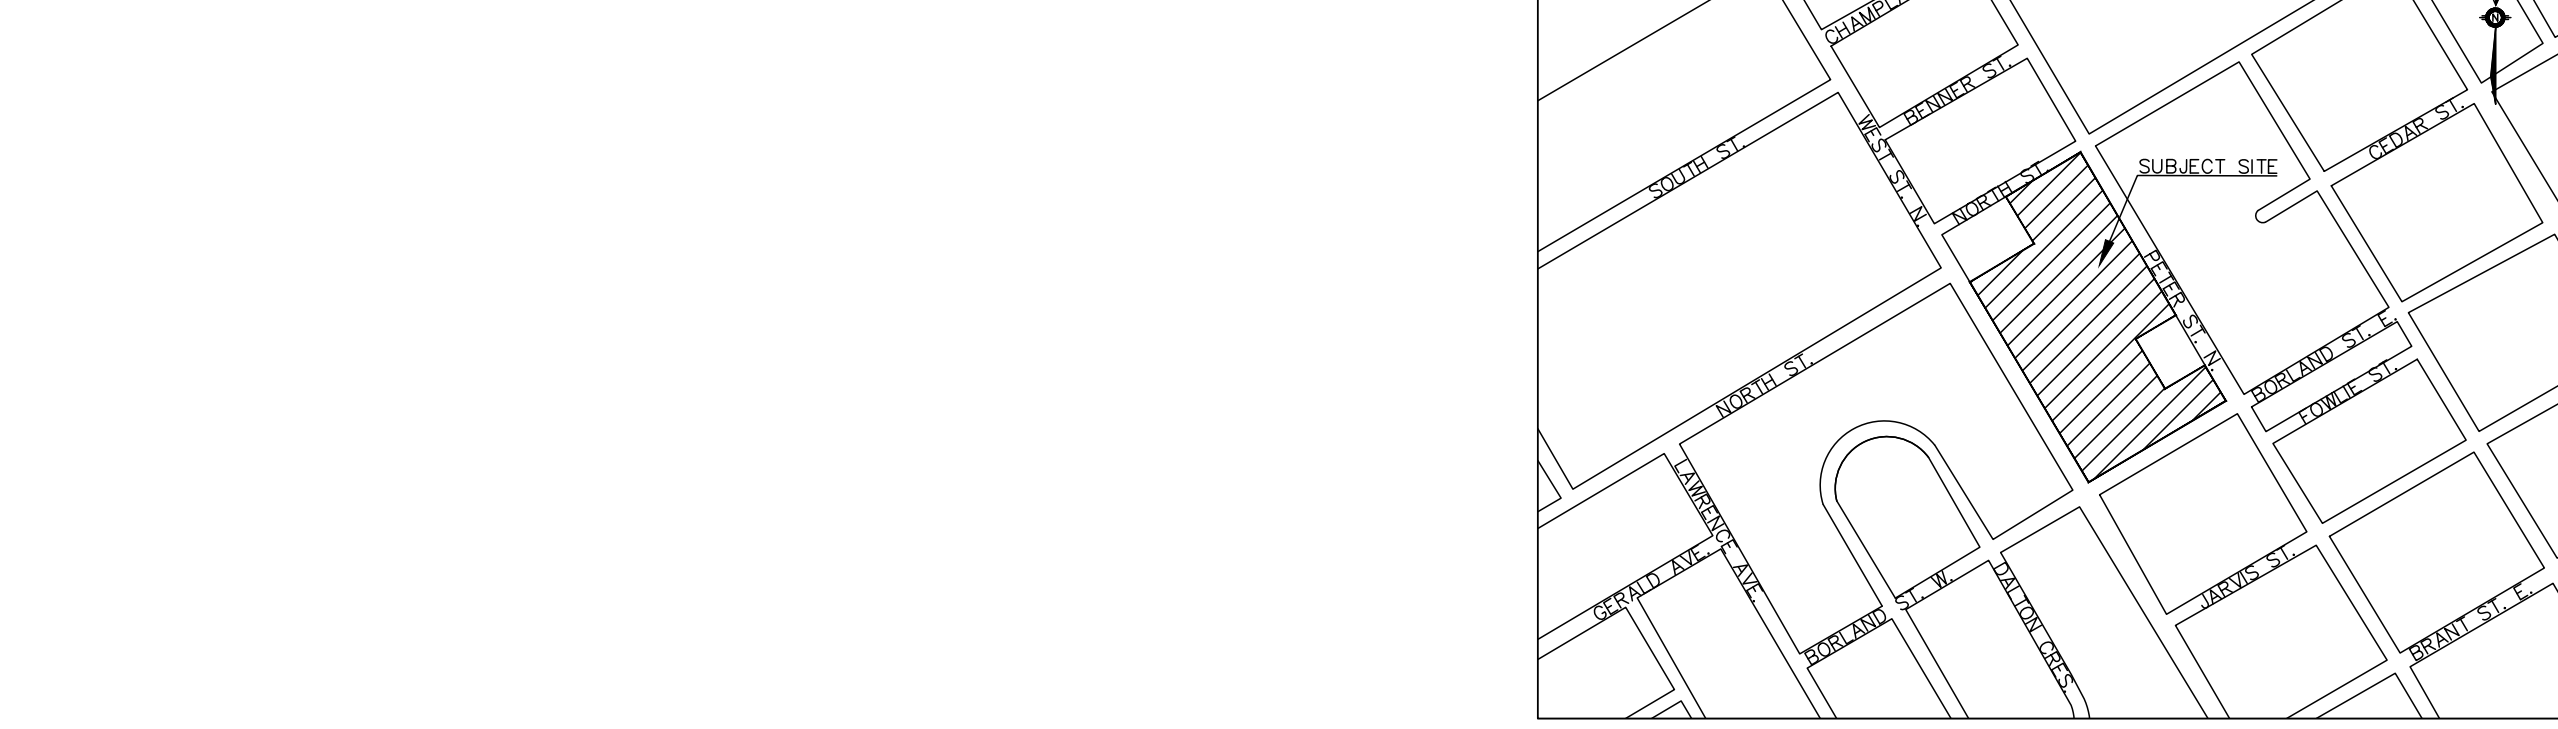



Table 3: SWM Pond Stage-Storage-Discharge

	2 Year Storm	5 Year Storm	10 Year Storm	25 Year Storm	50 Year Storm	100 Year Storm
Total Flow (m ³ /s)	0.19	0.22	0.23	0.26	0.29	0.30
Elevation (m)	266.16	266.35	266.47	266.71	266.91	267.07
Total Storage (m ³)	130	193	238	340	444	535

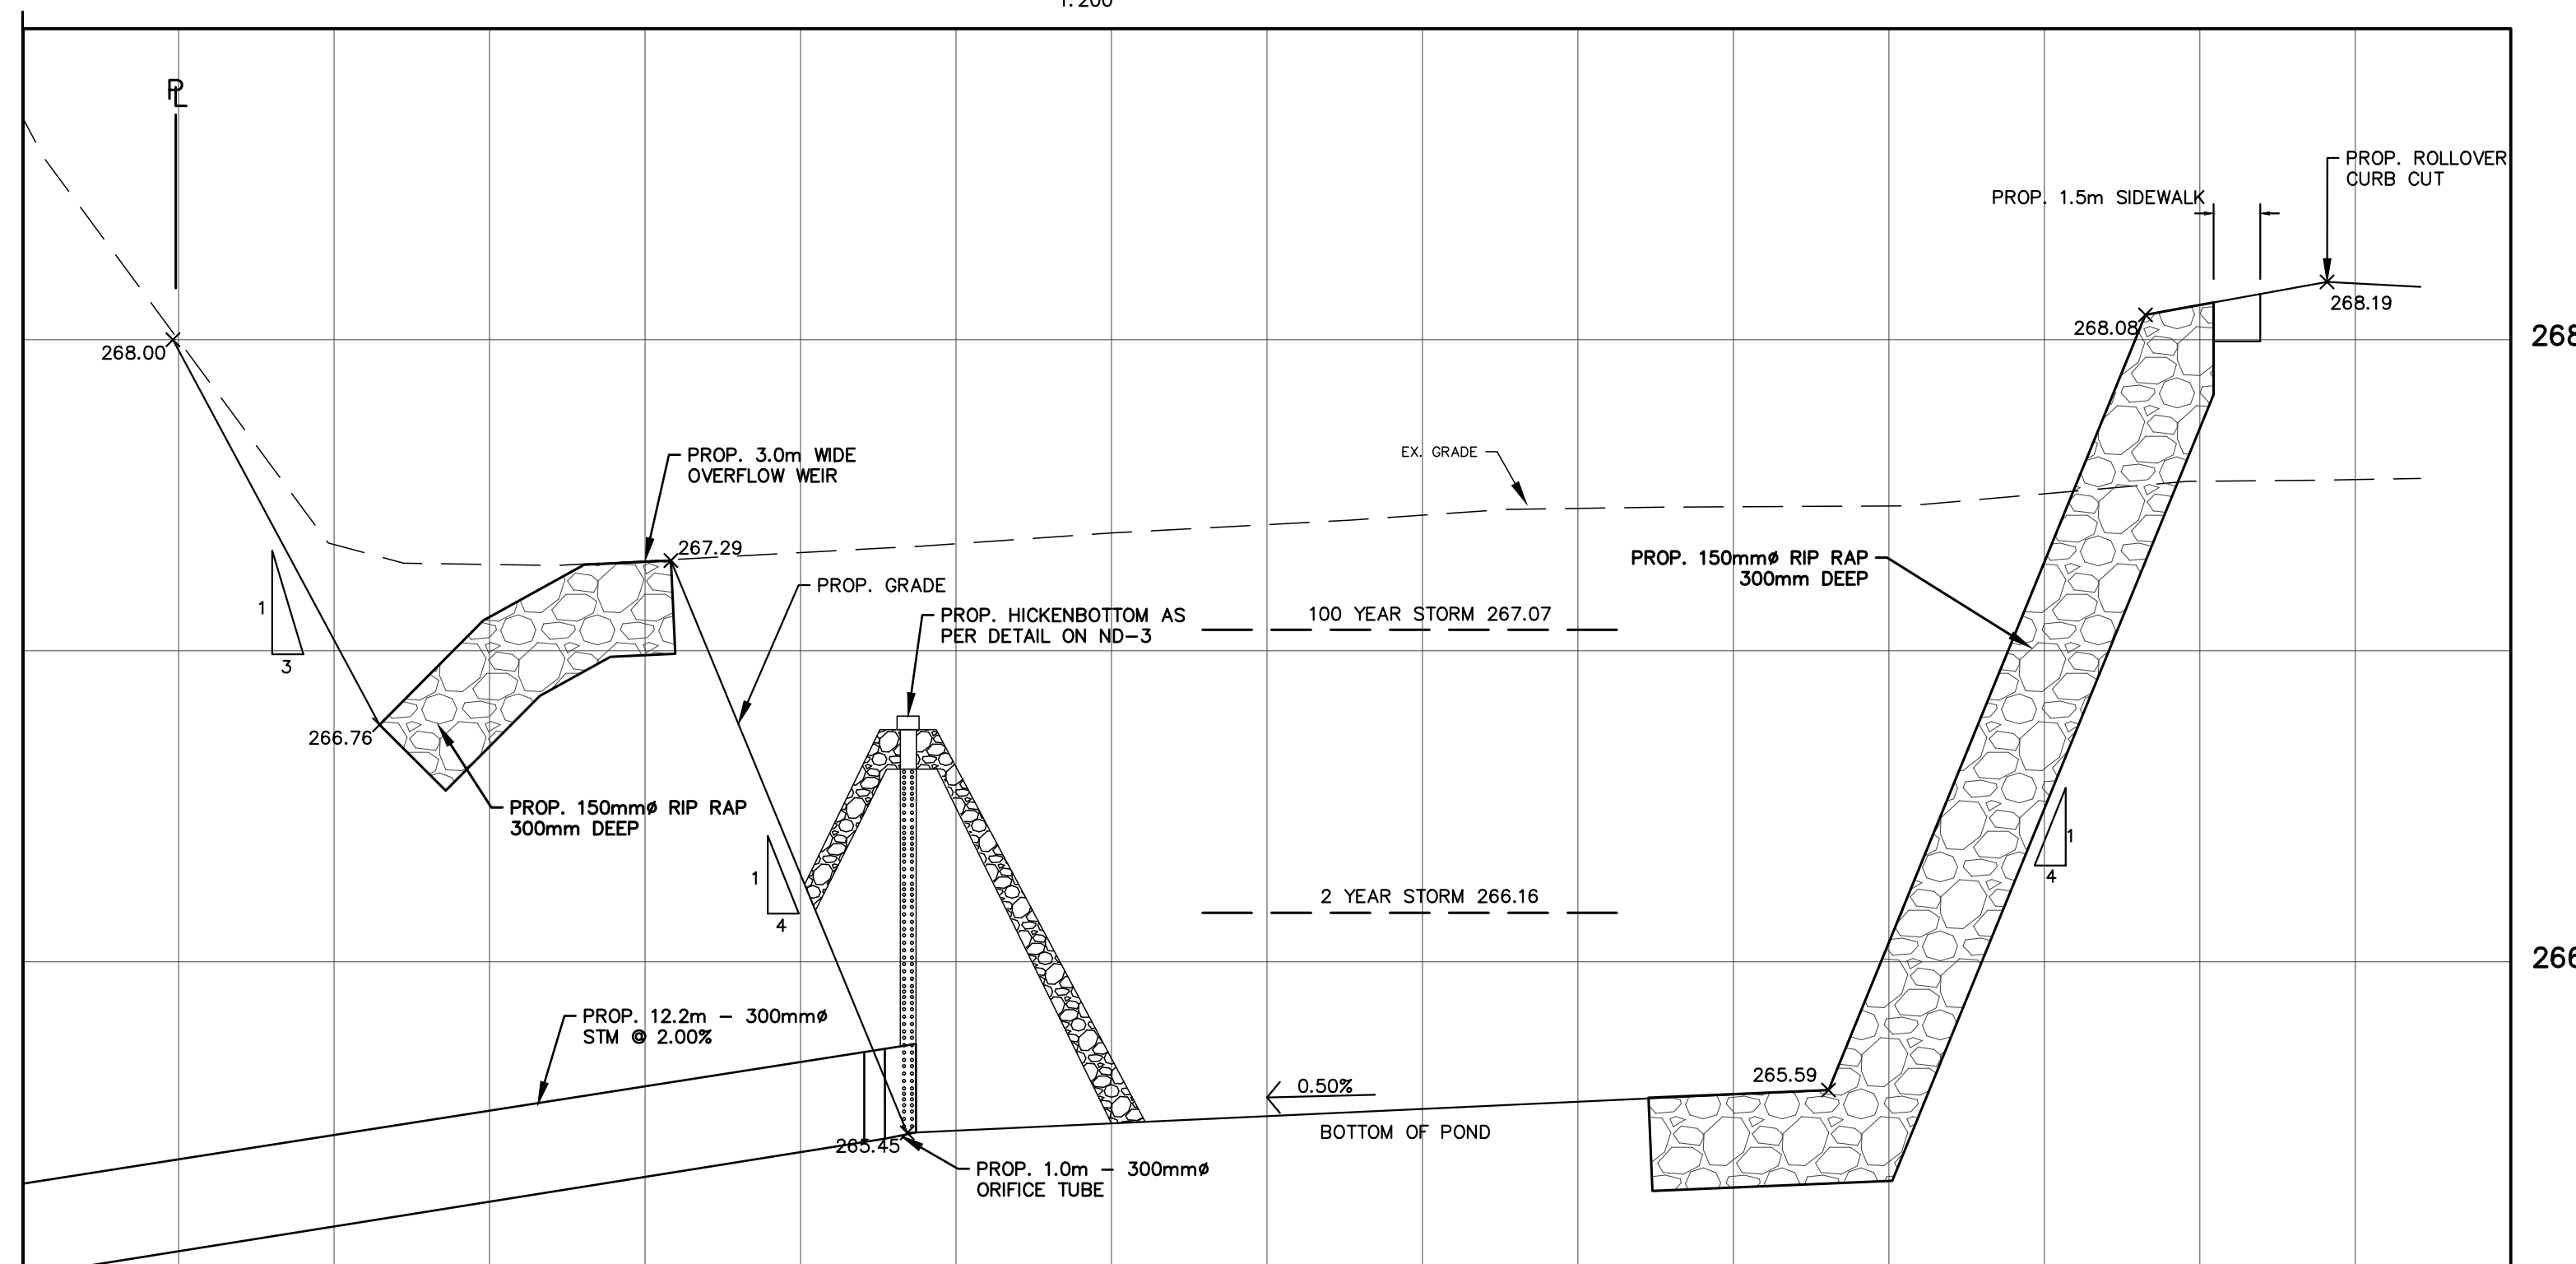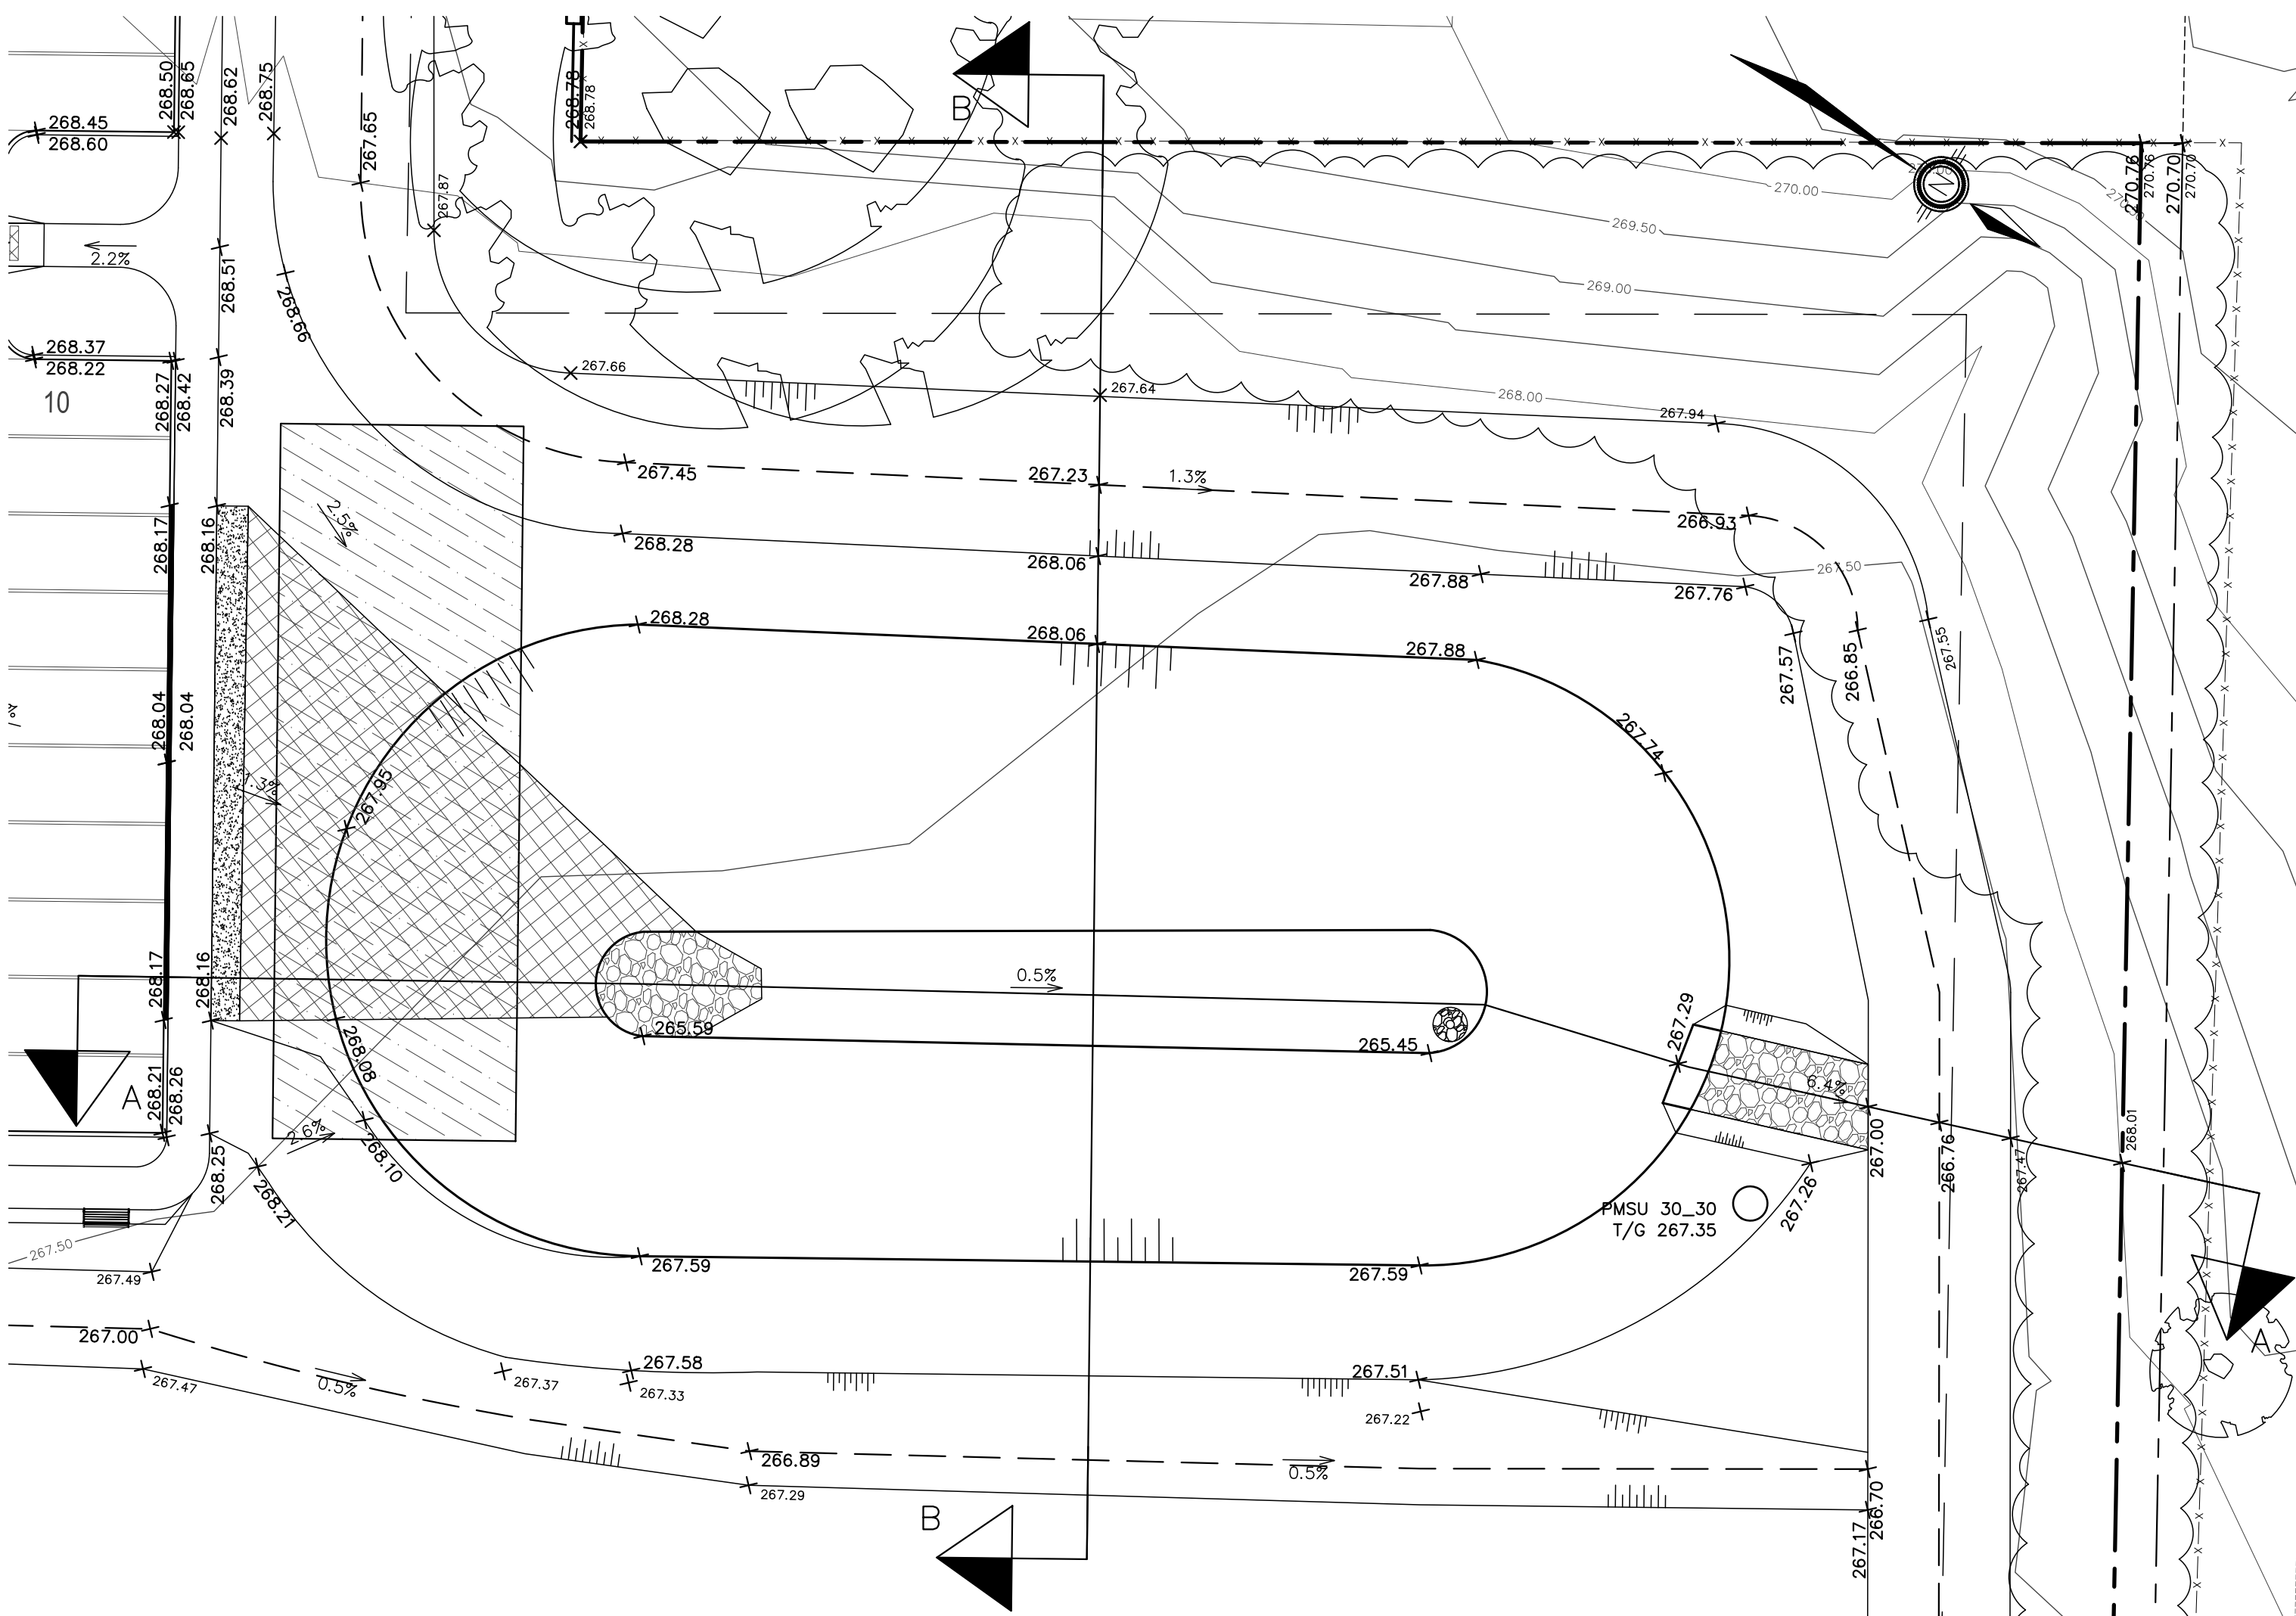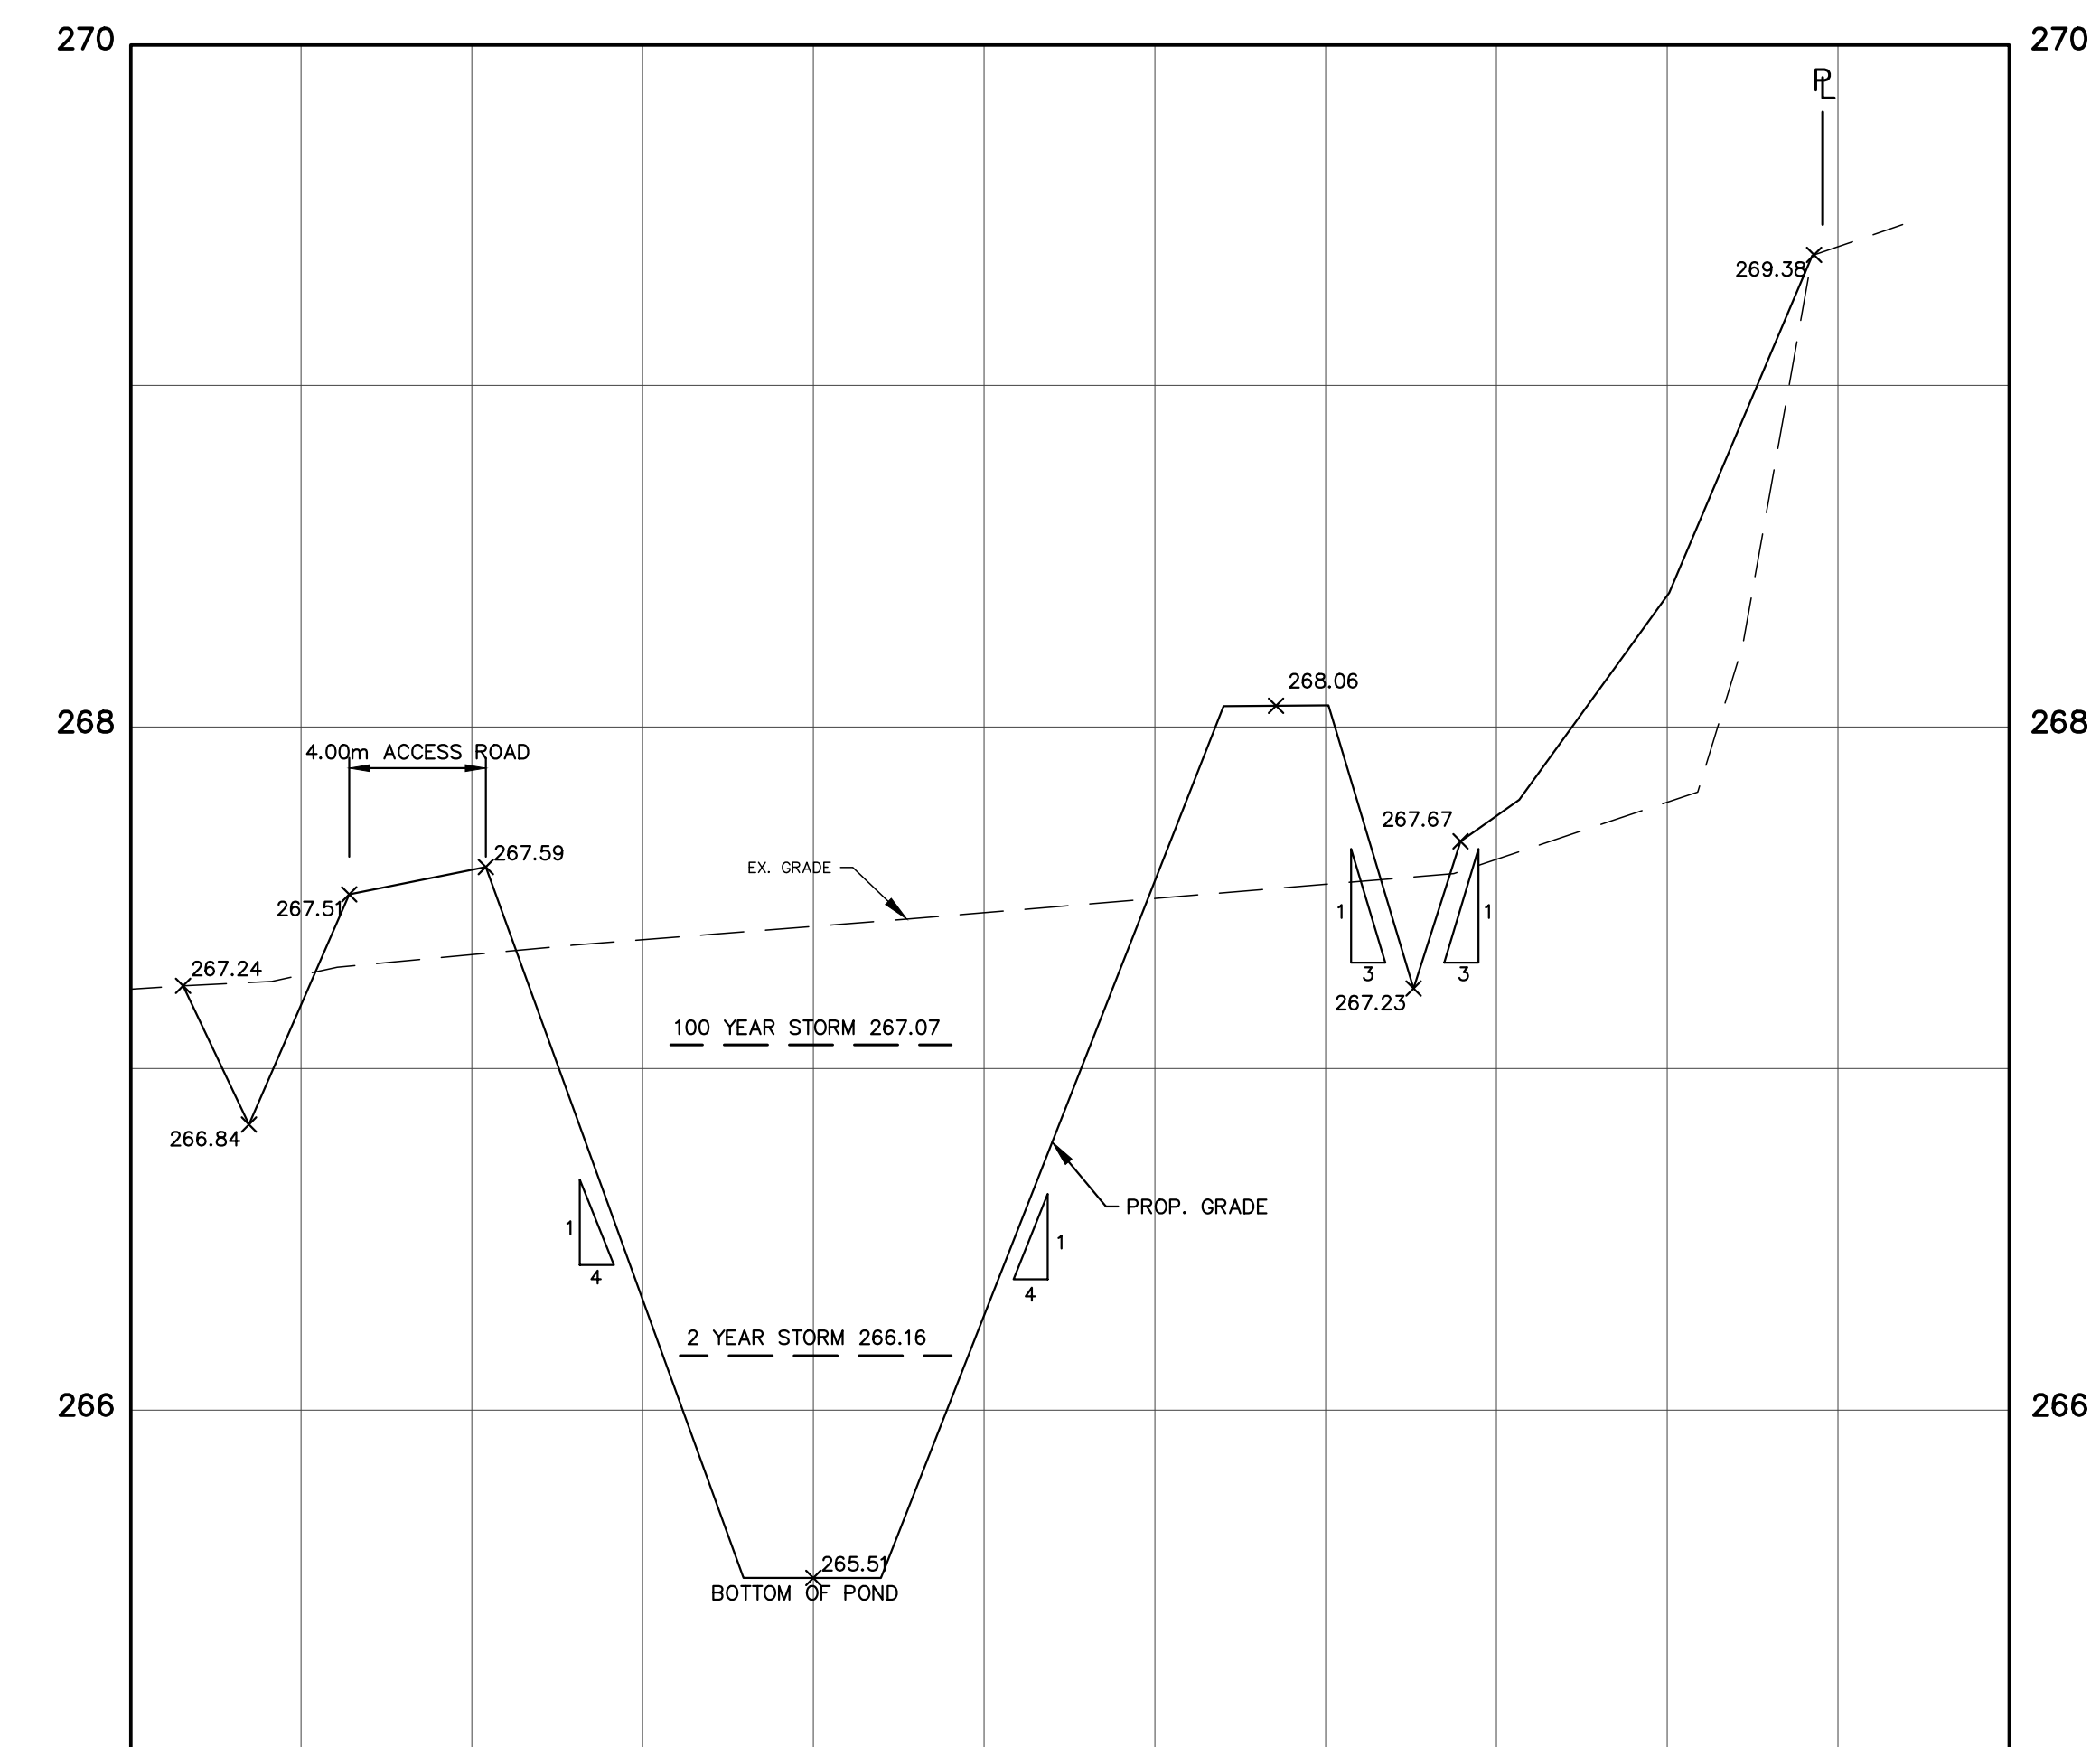

NO.	REVISION NOTE	DATE	BY
1.	REVISED AS PER CITY ORILLIA COMMENTS	01/26/21	AA

BENCHMARK	

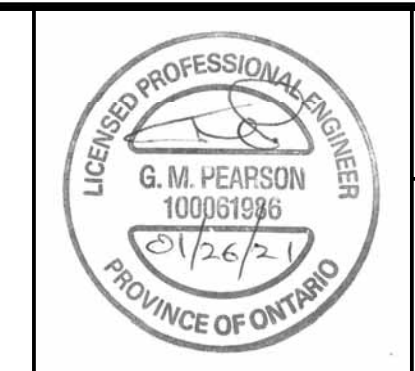



COUNTY OF SIMCOE
AFFORDABLE HOUSING
ORILLIA, 2 BORLAND STREET EAST

STORMWATER MANAGEMENT
POND DETAIL

PEARSON ENGINEERING LTD.
PEARSONENG.COM PH. 705.719.4785

DESIGNED BY	AA	HORIZ SCALE	1:200	PROJECT #	20002
DRAWN BY	AA	VERT SCALE	1:20	DRAWING #	PND-1
CHECKED BY	MWD	DATE	NOVEMBER 2020	REVISION #	1

P:\Projects\2020\202002 - MCL - 2 Borland St. E., Orillia\Working_Folders\200202 - BASE.dwg Layout:EPR-1 Plotted Jan 29, 2021 @ 3:32pm by antella @ PEARSON ENGINEERING LTD.

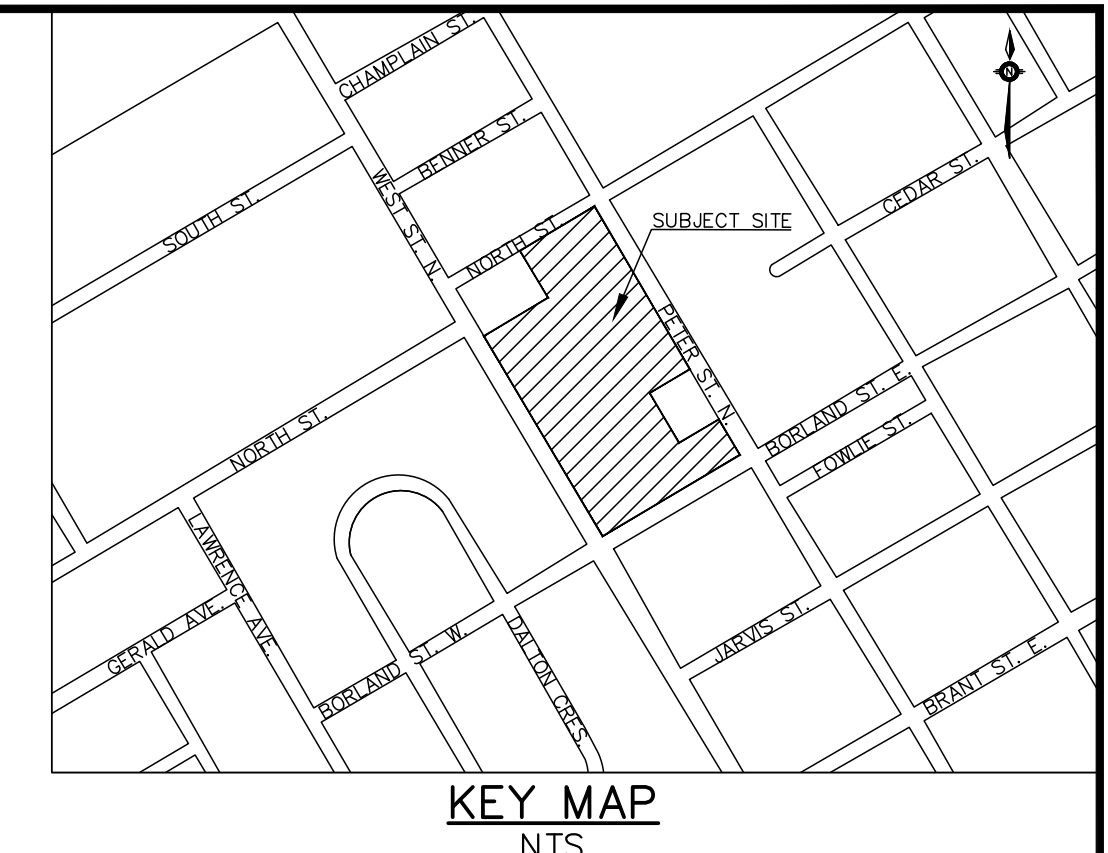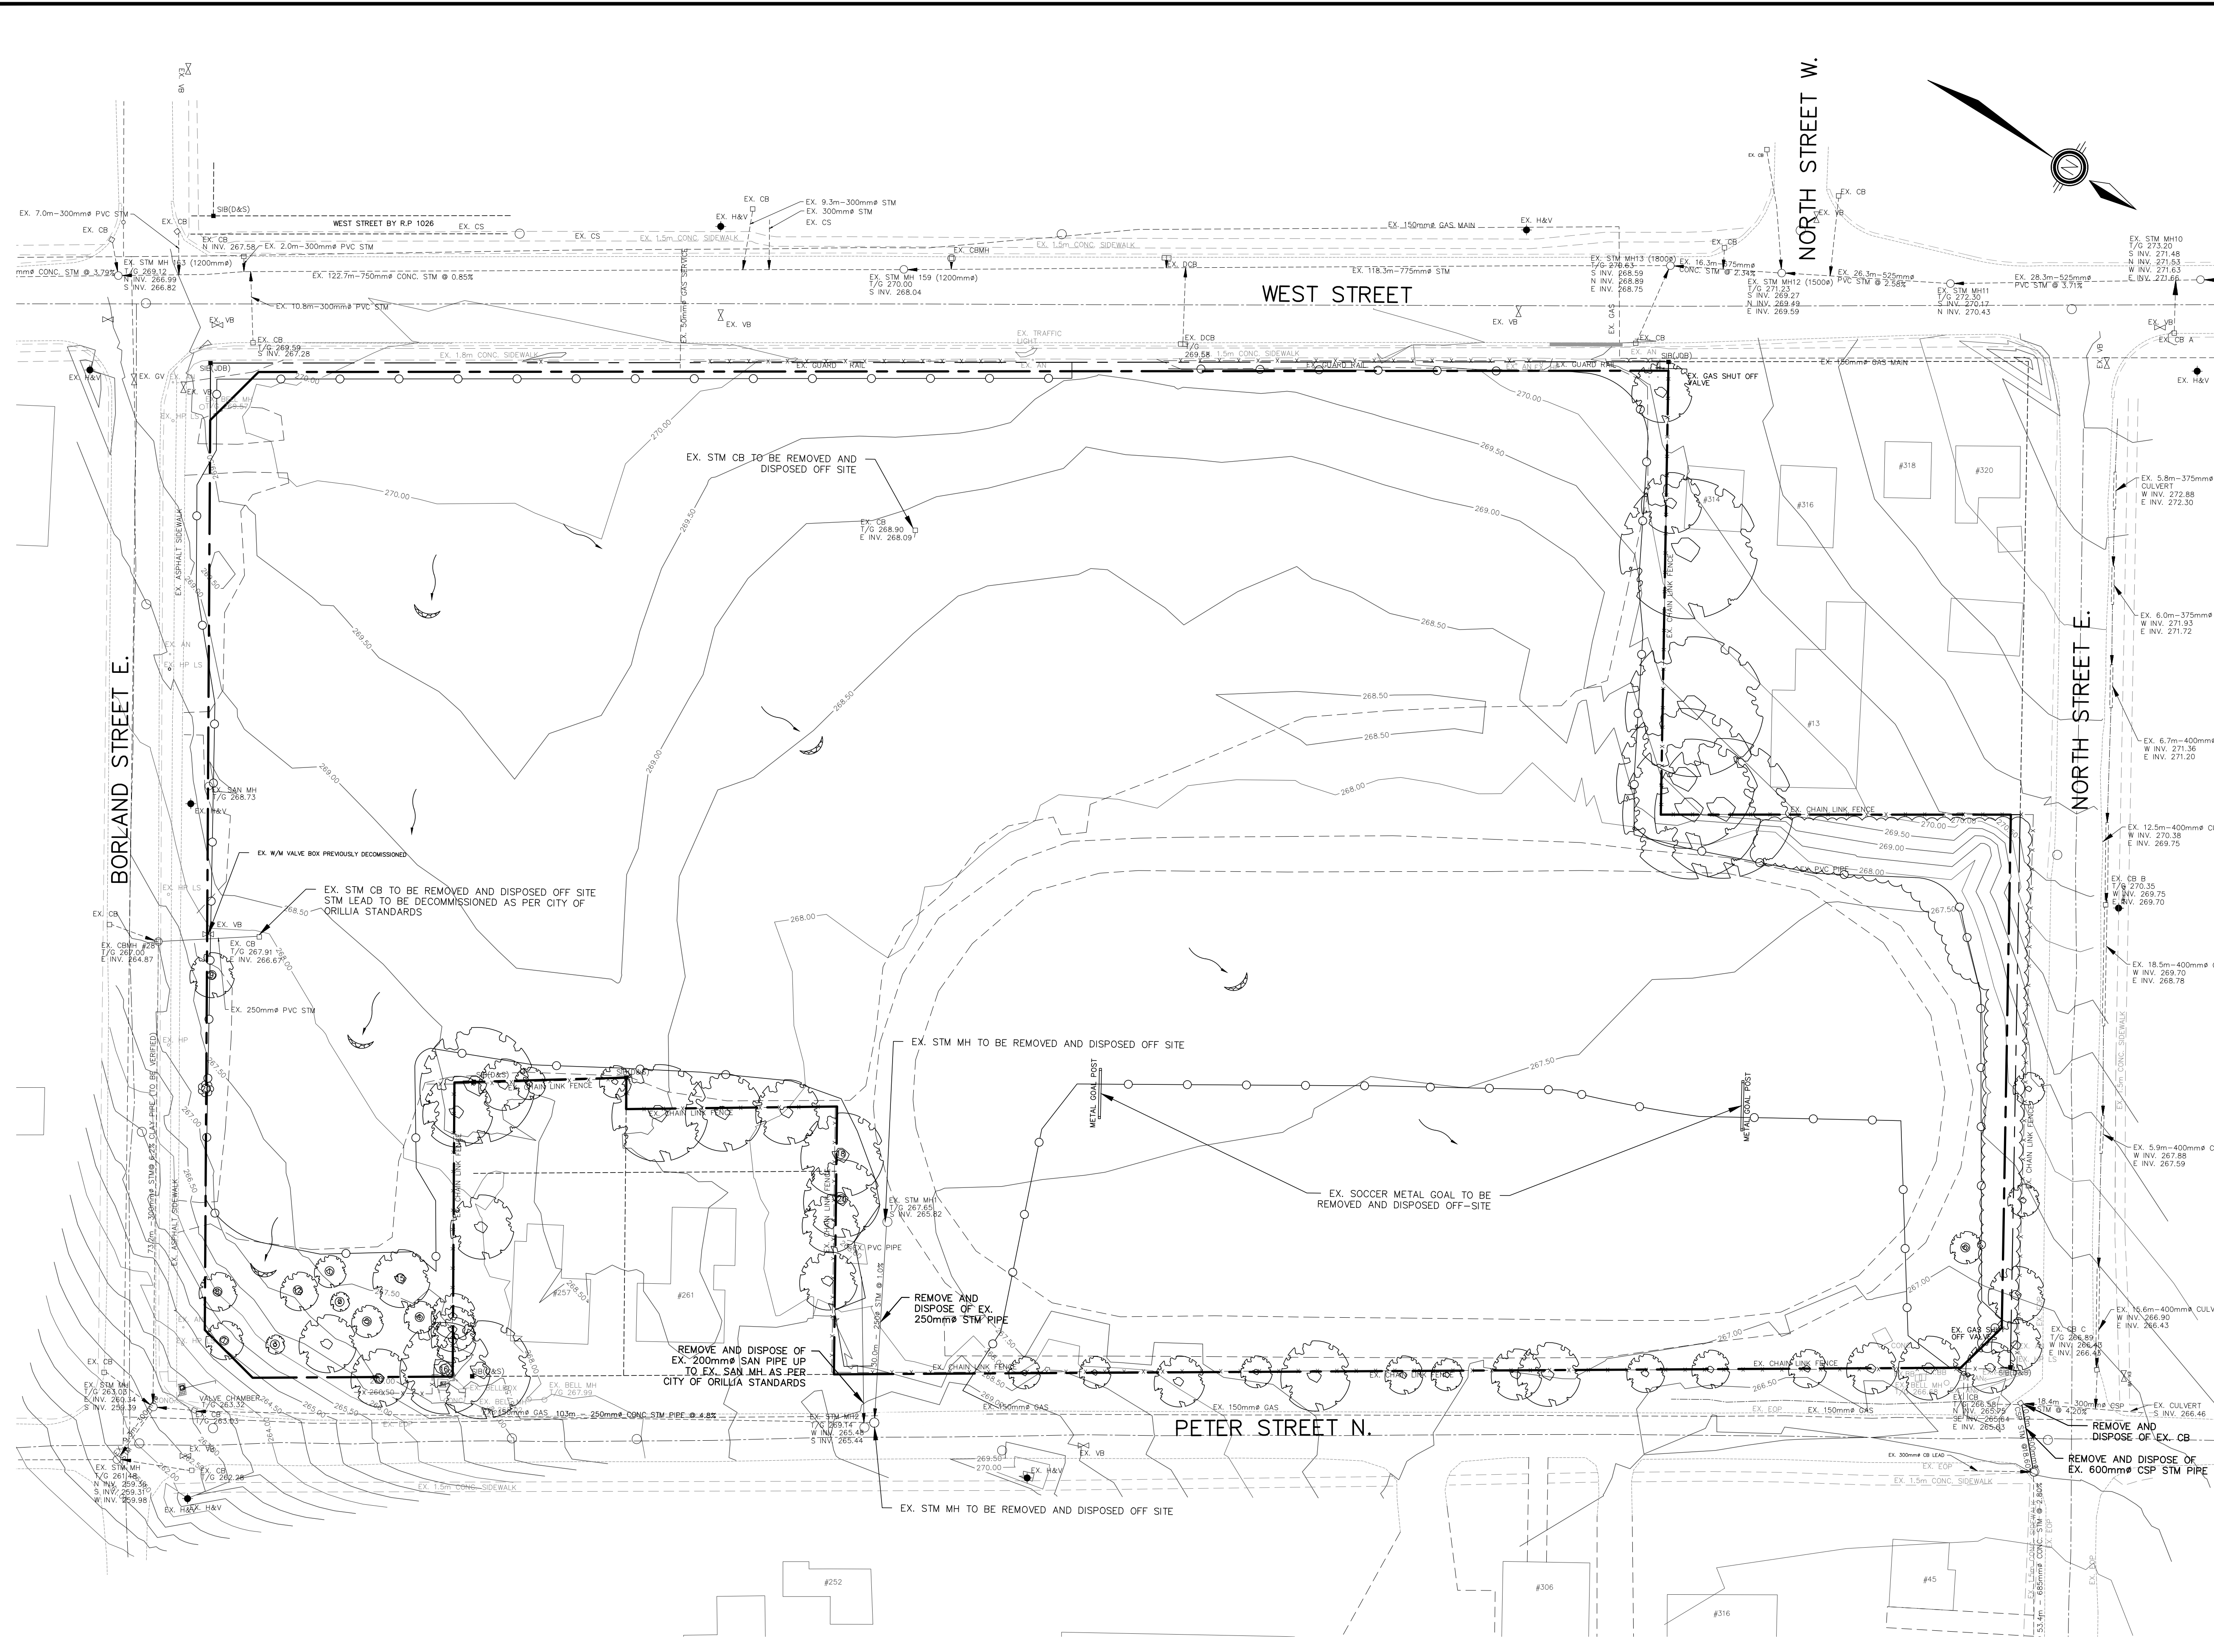

LEGEND

- SILT FENCE
- TEMPORARY SWALE
- TEMPORARY ROCK CHECK DAM
- - - EX. CHAINLINK FENCE
- EX. BELL BOX
- EX. TREE

SEQUENCE OF CONSTRUCTION


1. ENGINEER TO BE NOTIFIED PRIOR TO INITIATION OF ANY ON SITE WORKS.
2. SILT FENCE AS PER BSD-23, CONSTRUCTION ACCESS MATS, SWALE, AND CHECK DAMS AS PER DETAILS ON EPR-1 ARE TO BE INSTALLED PRIOR TO THE COMMENCEMENT OF ANY WORKS ONSITE.
3. VEGETATION REMOVAL MAY COMMENCE AFTER ALL SILT FENCE IS INSTALLED AND APPROVED BY THE ENGINEER.
4. COMMENCE WITH EARTH WORKS AND SITE SERVING.
5. EROSION CONTROL MEASURES TO BE MAINTAINED AS DIRECTED BY THE ENGINEER DURING THE CONSTRUCTION PERIOD. ADDITIONAL CONTROL MEASURES MAY BE REQUIRED AT THE DISCRETION OF THE ENGINEER.
6. ALL DISTURBED GROUND LEFT INACTIVE FOR MORE THAN 30 DAYS SHALL BE STABILIZED WITH SEED, SOD, MULCH OR OTHER ADEQUATE COVERING, AS INSTRUCTED BY THE ENGINEER.

NOTES FOR SEDIMENT & EROSION CONTROL

1. DISTURBED AREAS THAT HAVE FAILED TO HAVE STABLE GROUND COVER ESTABLISHED BY OCTOBER 30TH SHALL BE PROTECTED WITH A SILTATION CONTROL FENCE OR STRAW MULCH ETC. AND MAINTAINED BY THE CONTRACTOR UNTIL VEGETATION BECOMES ESTABLISHED IN THE SUBSEQUENT GROWING SEASON.
2. ANY DEWATERING WASTE SHALL BE DISCHARGED TO A VEGETATED AREA AT LEAST 30m FROM ANY WATERCOURSE AND FILTERED. FILTERING METHODS MUST BE APPROVED BY THE SITE ADMINISTRATOR.
3. SILT FENCE SHALL BE PUT IN PLACE PRIOR TO AND MAINTAINED DURING ALL GRADING. SILT FENCE TO BE INSPECTED PRIOR TO COMMENCEMENT OF EARTH GRADING ACTIVITIES. SILT FENCE TO BE INSPECTED AND REPAIRED OR REPLACED IF DAMAGED AS DIRECTED BY THE SITE ADMINISTRATOR. SILT CONTROLS TO BE INSPECTED ON A REGULAR BASIS AND AFTER EVERY RAIN EVENT. INSTALLATION SHALL BE TO THE MANUFACTURER'S RECOMMENDED SPECIFICATIONS.
4. THE CONTRACTOR SHALL BE PREPARED FOR UNEXPECTED CONDITIONS AND ACCORDINGLY HAVE STOCKPILED MATERIALS ON SITE FOR NECESSARY REPAIRS AS A RESULT OF FAILED OR INADEQUATE CONTROL MEASURES. ALL SEDIMENT AND EROSION CONTROL MEASURES SHALL BE INSPECTED AT LEAST ONCE A WEEK, AND AFTER EVERY RAINFALL EVENT.
5. MUD MATS AT ALL LOCATIONS WHERE CONSTRUCTION TRAFFIC ENTERS OR LEAVES THE SITE SHALL BE USED. 300mm of 50mm - 100mm CLEAR LIMESTONE PLACED IN A GEOTEXTILE FABRIC SUITABLE FOR ALLOWING EX-FILTRATION OF WATER AND PREVENTING THE QUARRY STONE FROM BECOMING CONTAMINATED WITH THE SUBSTRATE SOIL (TERRAFIX 270R OR APPROVED EQUAL). TO BE FLANKED BY SILT FENCES AND VEGETATIVE BUFFERS FORM THE PROPERTY LINE TO THE START OF ANY ON-SITE ROADWAYS.
6. CONTRACTOR SHALL OBTAIN A CURRENT COPY AND BECOME FAMILIAR WITH OPSS 577, CONSTRUCTION SPECIFICATION FOR TEMPORARY EROSION AND SEDIMENT CONTROL MEASURES AS WELL AS ALL APPLICABLE MUNICIPAL STANDARDS.
7. THE CONTRACTOR MAY CONSIDER ALTERNATIVE SEDIMENT AND EROSION CONTROL MEASURES. SUCH MEASURES SHOULD BE PRESENTED IN WRITING FOR APPROVAL OF THE SITE ADMINISTRATOR AND MUST BE APPROVED IN WRITING BY THE MUNICIPALITY AND CONSERVATION AUTHORITY.
8. THE TOPS OF ALL FILTER FABRIC MUST BE A MINIMUM OF 1.0 METRES ABOVE THE GROUND LEVEL AND ATTACHED TO THE FENCE WITH A CONTINUOUS STEEL WIRE. ALTERNATIVELY, THE FILTER FABRIC MUST BE FOLDED OVER THE TOP OF THE FENCE AND ATTACHED TO THE FENCE WITH WIRE LOOPED THROUGH THE FABRIC ON BOTH SIDES OF THE FENCE. FILTER FABRIC IS TO BE TERRAFIX 270R OR EQUIVALENT.
9. ALL DISTURBED GROUND LEFT FOR MORE THAN 30 DAYS SHALL BE STABILIZED BY SEEDING, SODDING, MULCHING, OR COVERING OR OTHER EQUIVALENT CONTROL MEASURES. THIS PERIOD OF INACTIVITY SHALL BE AT THE DISCRETION OF THE CITY OF ORILLIA'S MANAGER OF ENGINEERING BUT SHALL NOT EXCEED THIRTY DAYS OR SUCH LONGER PERIOD DEEMED ADVISABLE BY THE CITY OF ORILLIA'S MANAGER OF ENGINEERING.
10. CONTRACTOR RESPONSIBLE FOR MUD TRACKING, PREVENTION, AND MAINTENANCE ON SURROUNDING ROADS.

NO.	REVISION NOTE	DATE	BY
1.	REVISED AS PER CITY ORILLIA COMMENTS	01/26/21	AA

BENCHMARK			

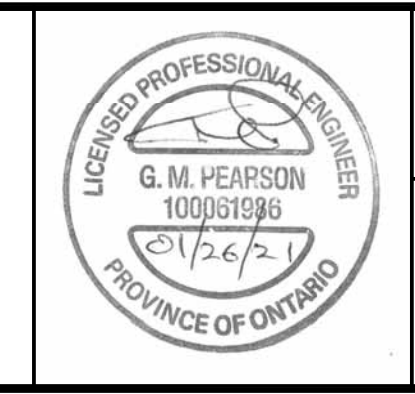

COUNTY OF SIMCOE
AFFORDABLE HOUSING
ORILLIA, 2 BORLAND STREET EAST

ENVIRONMENTAL PROTECTION AND
REMOVALS PLAN

PEARSON ENGINEERING LTD.
PEARSONENG.COM PH. 705.719.4785

DESIGNED BY	AA	HORIZ SCALE	1:500	PROJECT #	20002
DRAWN BY	AA	VERT SCALE		DRAWING #	EPR-1
CHECKED BY	MWD	DATE	NOVEMBER 2020	REVISION #	1